


Schedule

Symbol	Label	Image	Quantity	Manufacturer	Catalog Number	Description	Filename	Light Loss Factor	Total Lamp Lumens	Wattage	Plot
  	S1		2	Lithonia Lighting	RSX1 LED P1 40K R4 *TWIN HEADS	RSX Area Fixture Size 1 P1 Lumen Package 4000K CCT Type R4 Distribution	RSX1_LED_P1_40K_R4.ies	0.8	14377	102.68	 Max: 4240cd


Statistics

Description	Symbol	Avg	Max	Min	Max/Min	Avg/Min
LIGHT SPILL	+	0.0 fc	0.5 fc	0.0 fc	N/A	N/A
PARKING LOT	+	1.0 fc	3.6 fc	0.2 fc	18.0:1	5.0:1

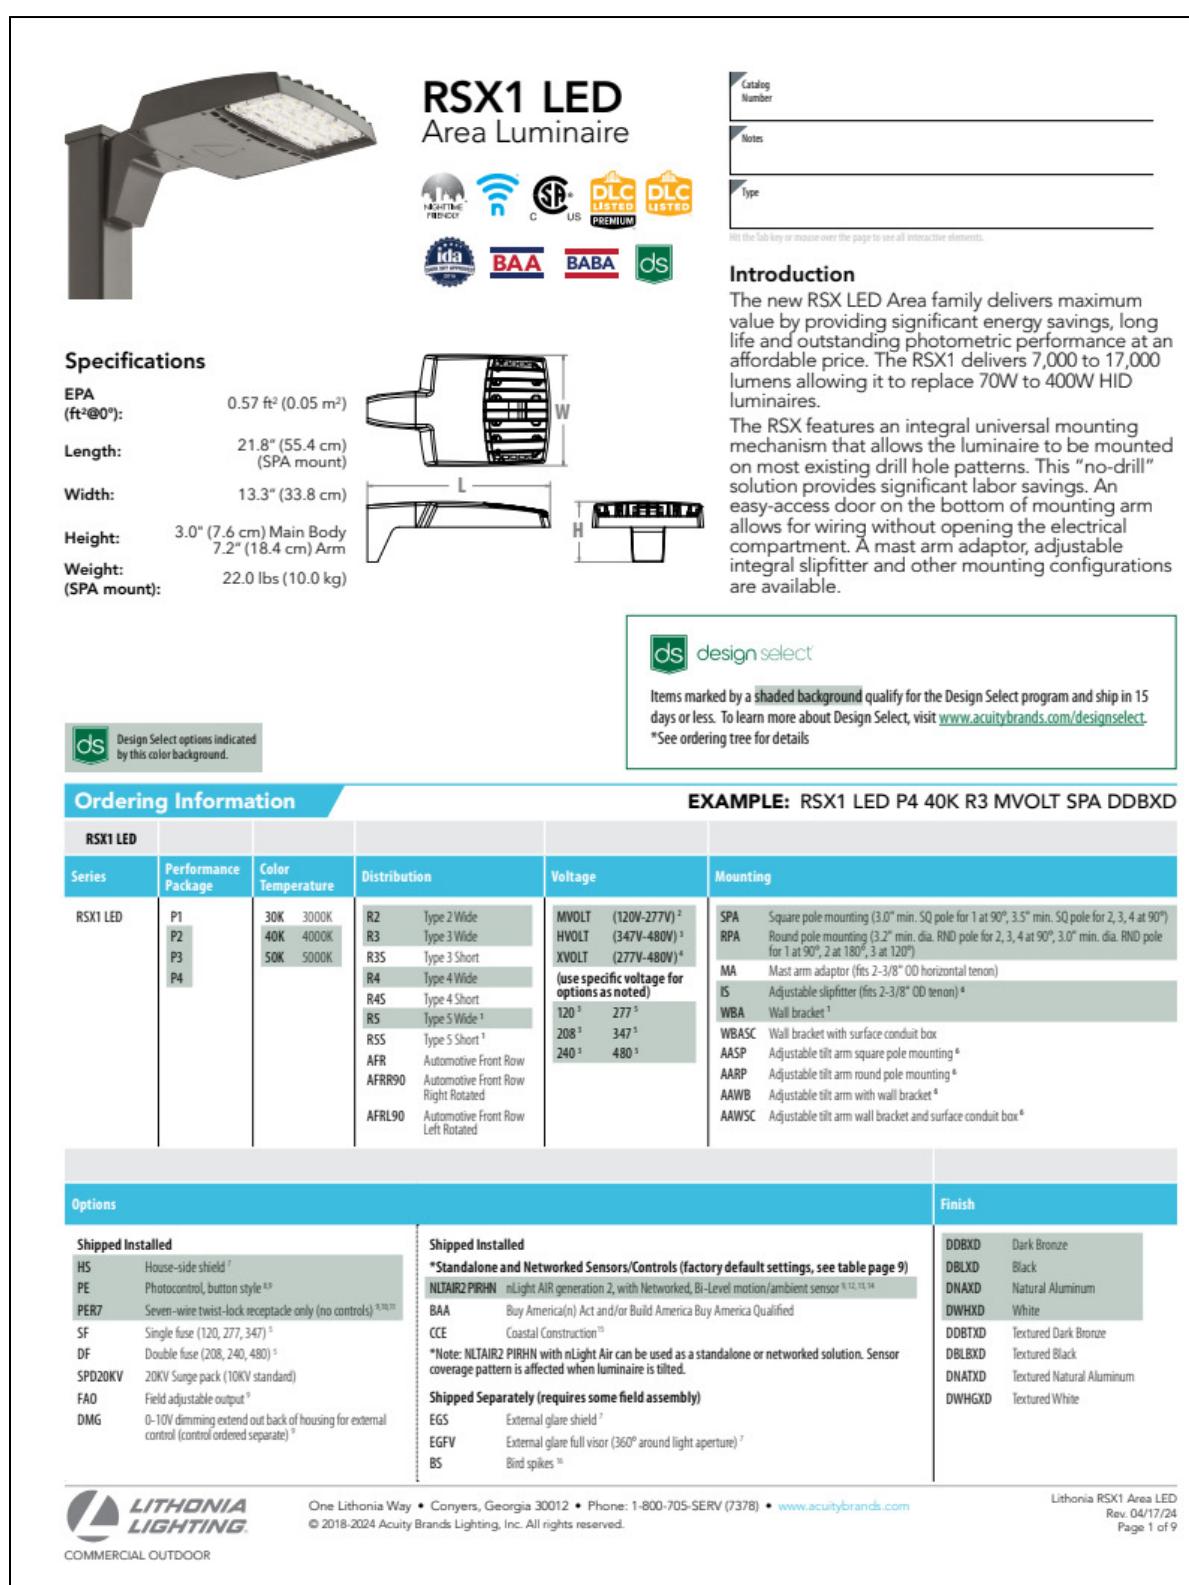

Note

- MEASUREMENTS TAKEN @ GRADE
- MOUNTING HEIGHT IS NOTED ON EACH FIXTURE

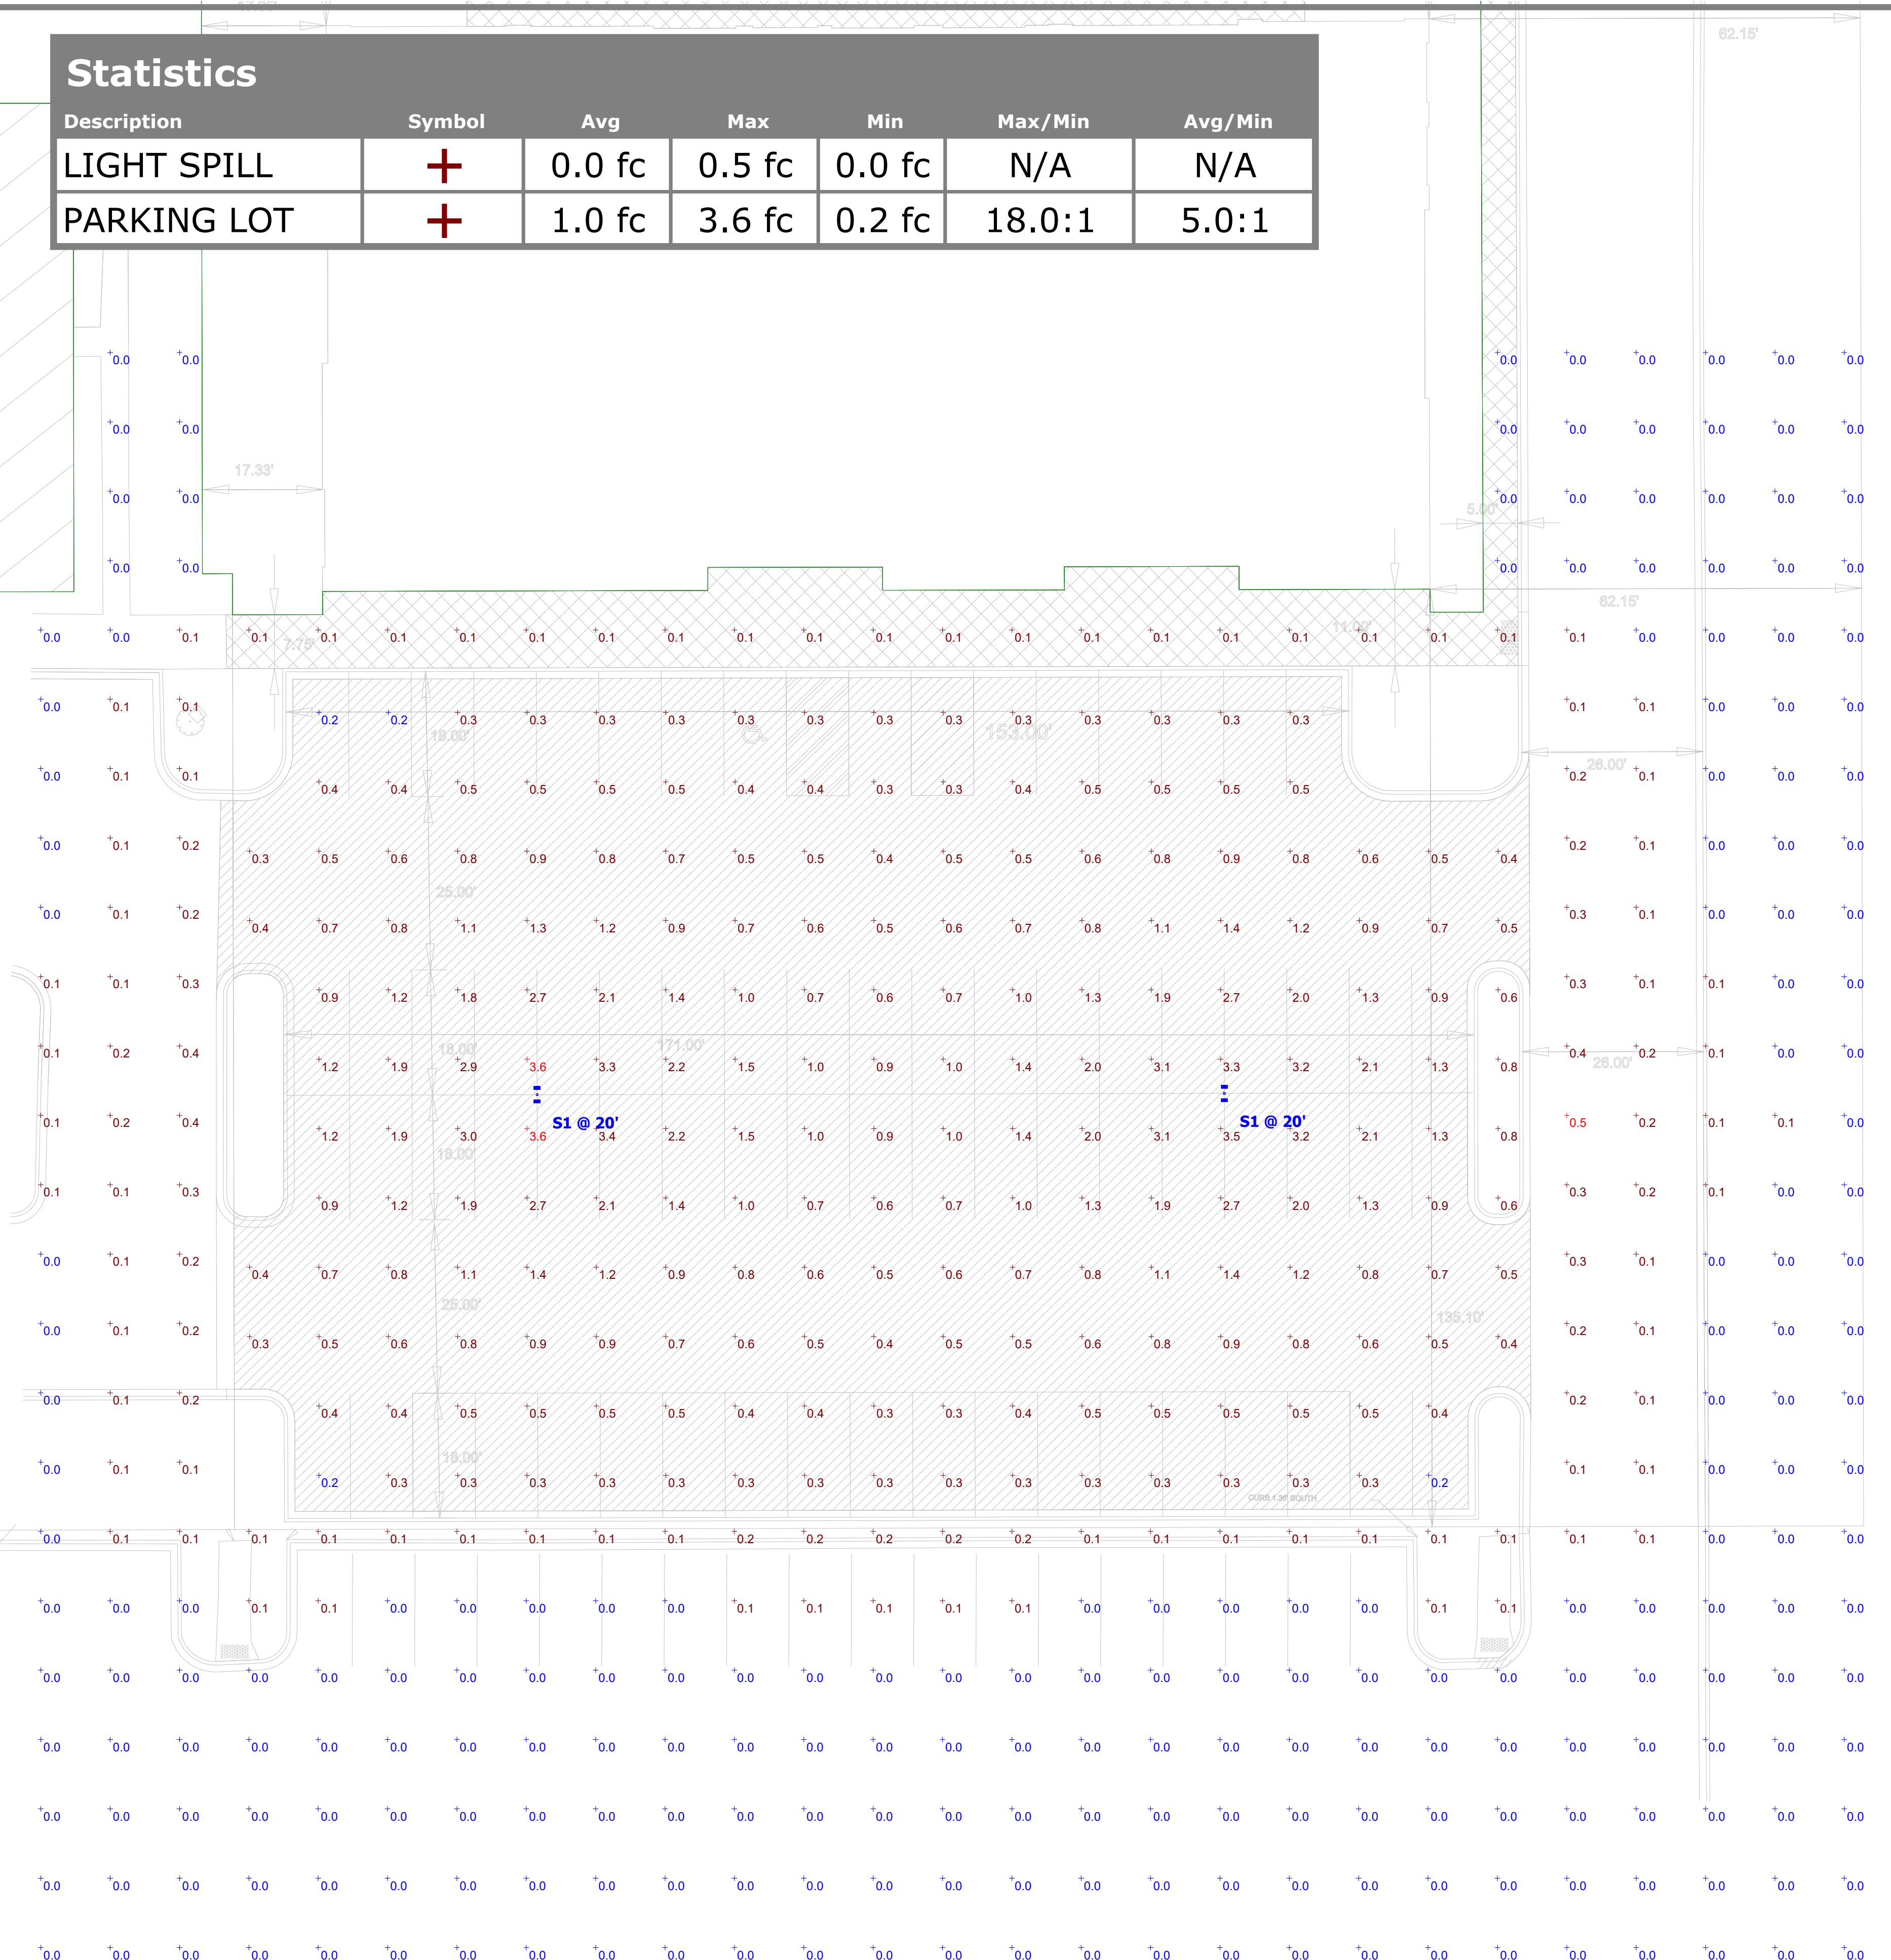

DESIGNER'S NOTE:

THE ENGINEER AND/OR ARCHITECT MUST DETERMINE APPLICABILITY OF THE LAYOUT TO EXISTING / FUTURE FIELD CONDITIONS. THIS LIGHTING LAYOUT REPRESENTS ILLUMINATION LEVELS CALCULATED FROM LABORATORY DATA TAKEN UNDER CONTROLLED CONDITIONS IN ACCORDANCE WITH ILLUMINATING ENGINEERING SOCIETY (IESNA) APPROVED METHODS.
ADDITIONALLY, THE PREPARER USED INFORMATION PROVIDED BY THE CUSTOMER. IF/WHEN SUFFICIENT INFORMATION WAS NOT PROVIDED, PREPARER USED EDUCATED ASSUMPTIONS.
ACTUAL PERFORMANCE OF ANY MANUFACTURER'S LUMINAIR(S) MAY VARY DUE TO VARIATION IN ELECTRICAL VOLTAGE, TOLERANCE IN LAMPS, AND OTHER FIELD CONDITIONS NOT ACCOUNTED FOR IN THIS PHOTOMETRIC ANALYSIS.

THESE LIGHTING CALCULATIONS ARE NOT A SUBSTITUTE FOR INDEPENDENT ENGINEERING ANALYSIS OF LIGHTING SYSTEM SUITABILITY AND SAFETY. THE ENGINEER AND/OR ARCHITECT IS RESPONSIBLE TO REVIEW FOR ENERGY CODE AND RELEVANT LIGHTING QUALITY COMPLIANCE.

Plan View

scale - 1" = 14ft

1-STORY BRICK BUILDING

Designer
FLUENTA
CONSULTING
Date
01/15/2024
Scale
SEE DRAWINGS
Drawing No.
REV-2
Summary
NORMAL OPERATION