


| Symbol | Qty | Label | Arrangement | LLF   | Lumens | Watts  | Description           |
|--------|-----|-------|-------------|-------|--------|--------|-----------------------|
|        | 12  | P1_R3 | Single      | 1.000 | 7096   | 51.34  | RSX1 LED P1 40K R3    |
|        | 3   | P3-2  | 2 @ 180°    | 1.000 | 14022  | 109.44 | RSX1 LED P3 40K R3    |
|        | 1   | P3-BS | Single      | 1.000 | 11481  | 133.14 | RSX1 LED P4 40K R3 HS |

| Label         | CalcType    | Units | Avg  | Max  | Min | Avg/Min | Max/Min |
|---------------|-------------|-------|------|------|-----|---------|---------|
| CalcPts_1     | Illuminance | Fc    | 1.13 | 11.7 | 0.0 | N.A.    | N.A.    |
| Property Line | Illuminance | Fc    | 0.03 | 0.1  | 0.0 | N.A.    | N.A.    |
| Parking Lot 1 | Illuminance | Fc    | 4.00 | 11.7 | 0.3 | 13.33   | 39.00   |

\*\*This document contains confidential and proprietary information of KSA Lighting & Controls. This document may only be used by or for the benefit of KSA Lighting & Controls representatives and customers. This lighting layout is not a professional engineering drawing and is provided for informational purposes only, without warranty as to accuracy, completeness, reliability or otherwise. KSA Lighting & Controls is not responsible for specifying the light fixtures or illumination requirements for any specific project, nor is it responsible for meeting municipal or building code requirements. It is the obligation of the end-user to consult with a professional engineering advisor to determine whether this lighting layout meets the applicable project requirements for lighting system performance, safety, suitability and effectiveness for use in a particular application. Field verification is recommended when calculations are based on end-user or customer-provided information. End-user environment and application (including, but not limited to, voltage variation and dirt accumulation) can cause actual field performance to differ from the calculated photometric performance represented in this lighting layout. In no event will KSA Lighting & Controls be responsible for any loss resulting from any use of this drawing.

- Notes :
1. Calculation Work Plane : Grade
  2. Fixture Mounting Height : AS NOTED
  3. Calculation Point Spacing : 10'x10'

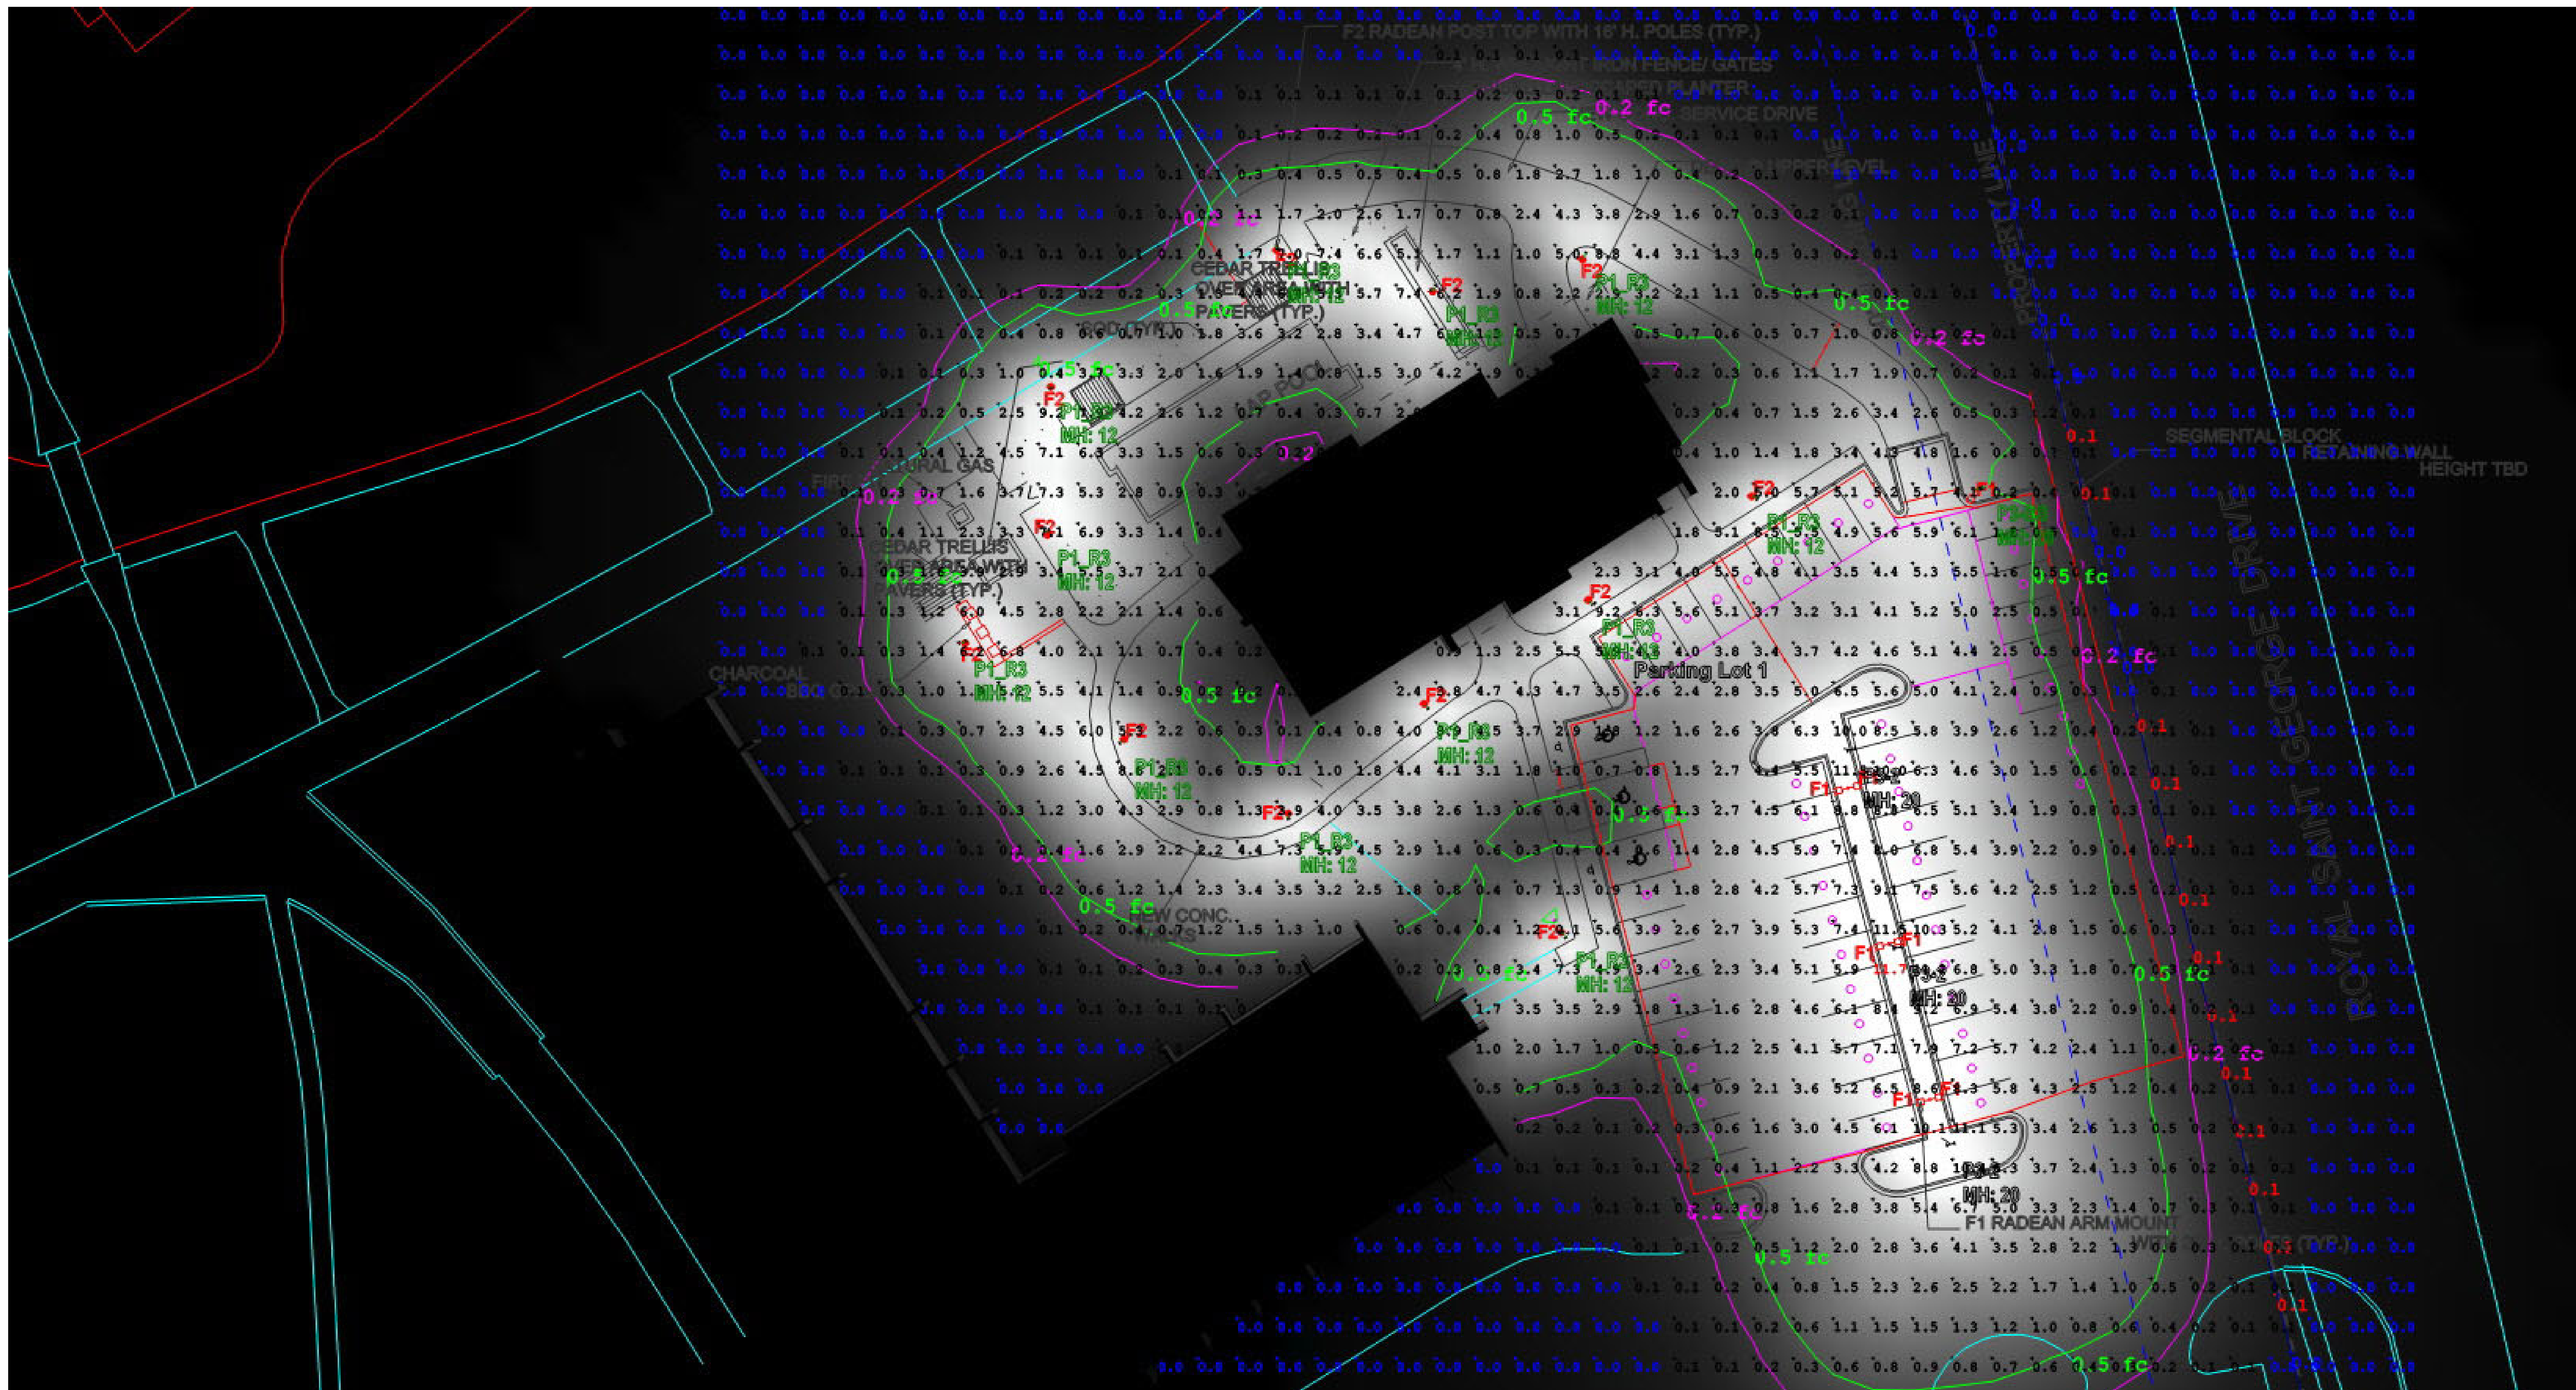

| Luminaire Schedule |     |       |             |       |        |        |                       |
|--------------------|-----|-------|-------------|-------|--------|--------|-----------------------|
| Symbol             | Qty | Label | Arrangement | LLF   | Lumens | Watts  | Description           |
|                    | 12  | P1_R3 | Single      | 1.000 | 7096   | 51.34  | RSX1 LED P1 40K R3    |
|                    | 3   | P3-2  | 2 @ 180°    | 1.000 | 14022  | 109.44 | RSX1 LED P3 40K R3    |
|                    | 1   | P3-BS | Single      | 1.000 | 11481  | 133.14 | RSX1 LED P4 40K R3 HS |

| Calculation Summary |             |       |      |      |     |         |         |
|---------------------|-------------|-------|------|------|-----|---------|---------|
| Label               | CalcType    | Units | Avg  | Max  | Min | Avg/Min | Max/Min |
| CalcPts_1           | Illuminance | Fc    | 1.13 | 11.7 | 0.0 | N.A.    | N.A.    |
| Property Line       | Illuminance | Fc    | 0.03 | 0.1  | 0.0 | N.A.    | N.A.    |
| Parking Lot 1       | Illuminance | Fc    | 4.00 | 11.7 | 0.3 | 13.33   | 39.00   |

Notes :

1. Calculation Work Plane : Grade
2. Fixture Mounting Height : AS NOTED
3. Calculation Point Spacing : 10'x10'

\*\*This document contains confidential and proprietary information of KSA Lighting & Controls. This document may only be used by or for the benefit of KSA Lighting & Controls representatives and customers. This lighting layout is not a professional engineering drawing and is provided for informational purposes only, without warranty as to accuracy, completeness, reliability or otherwise. KSA Lighting & Controls is not responsible for specifying the light fixtures or illumination requirements for any specific project, nor is it responsible for meeting municipal or building code requirements. It is the obligation of the end-user to consult with a professional engineering advisor to determine whether this lighting layout meets the applicable project requirements for lighting system performance, safety, suitability and effectiveness for use in a particular application. Field verification is recommended when calculations are based on end-user or customer-provided information. End-user environment and application (including, but not limited to, voltage variation and dirt accumulation) can cause actual field performance to differ from the calculated photometric performance represented in this lighting layout. In no event will KSA Lighting & Controls be responsible for any loss resulting from any use of this drawing.