Convert 2-Unit to Single Family Residence. Interior Rehab & New 2-Story Frame Addition including New Partitions, New Electrical, Mechanical & Plumbing Systems, New Roof System & New Rear Deck & Balcony per Plans.

223 Center Street, Naperville Illinois 60540

Building Info: 2-Story, Residential Use, Frame Building

DRAWING SHEET INDEX

GENERAL		ARCHITEC	CTURAL
CS	COVER SHEET & SITE PLAN & DRAWING LIST	A-01	PROPOSED FLOOR PLANS & SCHEDULES
CM	CODE MATRIX	A-02	PROPOSED FLOOR PLANS & WALL TYPES
G-01	GENERAL PROJECT INFORMATION	A-03	PROPOSED ELEVATIONS
G-02	GENERAL PROJECT SPECIFICATIONS	A-04	PROPOSED ELEVATIONS
		A-05	BUILDING ADDITION FOUNDATION & GARAGE EXTENSION
DEMOLITION	ON	A-06	PROPOSED FRAMING PLANS
AD-01	EXISTING-DEMOLITION PLANS	A-07	PROPOSED FRAMING PLANS
AD-02	EXISTING-DEMOLITION ELEVATIONS	A-08	BUILDING SECTION
AD-03	EXISTING WALLS BRACING DETAILS) 1 R.T. 10.17.2023	A-09	BUILDING SECTIONS
		A-10	REAR DECK & BALCONY PLANS & DETAILS
		(A-11)	DECK CONNECTION DETAILS 1 R.T. 10.17.2023
ELECTRIC	AL		
E-01	POWER & LIGHTING PLANS	MECHANIC	CAL
E-02	POWER & LIGHTING PLANS	M-01	PROPOSED MECHANICAL PLANS
E-02	RISER DIAGRAM, LOAD CALCULATIONS,	M-02	PROPOSED MECHANICAL PLANS
	SCHEDULES & PANELBOARDS	M-03	SPLIT SYSTEM DIAGRAM & MECHANICAL NOTES
		M-03	SPLIT SYSTEM DIAGRAM & MECHANICAL NOTES
		PLUMBING	3
		P-01	SUPPLY AND WASTE DIAGRAMS


CITY OF NAPERVILLE ADOPTED CODES

2018 INTERNATIONAL BUILDING CODE
2018 INTERNATIONAL RESIDENTIAL CODE
2012 INTERNATIONAL MECHANICAL CODE
2018 INTERNATIONAL FIRE CODE
2018 LIFE SAFETY CODE
ILLINOIS PLUMBING CODE

2018 INTERNATIONAL FUEL GAS CODE
2018 INTERNATIONAL PROPERTY MAINTENANCE CODE
2017 NATIONAL ELECTRICAL CODE
2021 INTERNATIONAL ENERGY CONSERVATION CODE
2018 INTERNATIONAL EXISTING BUILDING CODE


STATEMENT OF COMPLIANCE

THIS IS TO CERTIFY THAT THESE PLANS WERE PREPARED UNDER MY DIRECT SUPERVISION, AND TO THE BEST OF MY KNOWLEDGE AND BELIEF CONFORM TO THE REQUIREMENTS OF THE CITY OF NAPERVILLE ADOPTED BUILDING CODES.

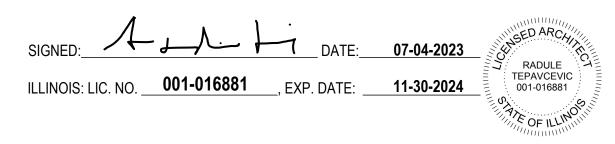

ENERGY CONSERVATION CODE COMPLIANCE STATEMENT

I CERTIFY THAT I AM A THE REGISTERED DESIGN PROFESSIONAL FOR THIS PROJECT. I ALSO CERTIFY THAT TO THE BEST OF MY PROFESSIONAL KNOWLEDGE AND BELIEF THE ATTACHED PLANS FOR: **223 CENTER STREET, NAPERVILLE, IL 60540** FULLY COMPLY WITH THE REQUIREMENTS OF THE 2021 INTERNATIONAL ENERGY CONSERVATION CODE, ADOPTED INTO THE CITY OF NAPERVILLE ORDINANCE

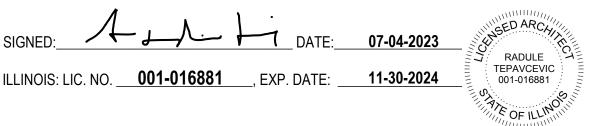

LIABILITY INSURANCE

PROVIDE LIABILITY INSURANCE (HOLD HARMLESS AGREEMENT): THE CONTRACTOR SHALL MAINTAIN CONTRACTUAL LIABILITY INSURANCE TO COVER LIABILITY ASSUMED UNDER THE FOLLOWING AGREEMENT: THE CONTRACTOR AND ANY SUBCONTRACTOR SHALL INDEMNIFY AND SAVE HARMLESS OWNER AND ARCHITECT/ENGINEER (A/E), AND THEIR PARTNERS, AGENTS AND EMPLOYEES AGAINST ANY LOSS, DAMAGE OR EXPENSE FOR WHICH THE OWNER AND A/E MAY BECOME LIABLE ON AN ACCOUNT OF BODILY INJURY INCLUDING DEATH, OR PROPERTY DAMAGE SUSTAINED BY ANYONE WHICH MAY ARISE OUT OF OR RESULT FROM THE OPERATIONS OF THE CONTRACTOR OR OF THOSE EMPLOYED BY HIS AGENTS OR SERVANTS INCLUDING HIS SUBCONTRACTORS, IN THE EXECUTION OF ANY WORK INCLUDED UNDER THIS CONTRACT, WHETHER OR NOT IT SHALL BE CLAIMED THAT THE INJURY OR DAMAGE WAS CAUSED THROUGH A NEGLIGENT ACT OR OMISSION OF THE OWNER AND A/E, THEIR AGENTS, SERVANTS OR EMPLOYEES, OR BY ANY OTHER PERSONS WHOMSOEVER: AND THE CONTRACTOR SHALL, AT HIS OWN EXPENSE, APPEAR, DEFEND, PAY ALL COSTS AND EXPENSES, INCLUDING ATTORNEY'S FEES AND ALL JUDGEMENTS IN CONNECTION WITH LIABILITY ASSUMED HERE UNDER. THE FOLLOWING INDEMNIFICATION SHALL ALSO INCLUDE ALL LIABILITY OF THE OWNER, A/E AND OTHER MENTIONED PERSONS ARISING UNDER THE SO CALLED "STRUCTURAL WORK ACT" (CH. 48 SEC. 60-90 ILLINOIS REVISED STATS.) EACH AND EVERY CONTRACTOR AND SUBCONTRACTOR WHEN ACCEPTING CONTRACTUAL OBLIGATIONS FOR THIS PROJECT SHALL UNDERSTAND THAT A PREREQUISITE TO ANY OPERATION AT PROJECT WHETHER FILED WITH OWNER OR NOT, THAT THEY HAVE IMPLIED AGREEMENT TO THE ABOVE ITEM, (HOLD HARMLESS AGREEMENT AND ITS SPECIFIC WORDING).

LIMIT OF WARRANTY OF ARCHITECT'S WORK PRODUCT:

THE A/E AND HIS CONSULTANTS DO NOT WARRANTY OR GUARANTEE THE ACCURACY AND COMPLETENESS OF THE WORK BEYOND A REASONABLE DILIGENCE. IF ANY ERRORS, DISCREPANCIES OR OMISSIONS ARE FOUND TO EXIST IN THE WORK PRODUCT, THE A/E SHALL BE PROMPTLY NOTIFIED SO THAT HE MAY HAVE THE OPPORTUNITY TO TAKE WHATEVER STEPS NECESSARY TO RESOLVE THEM. FAILURE TO PROMPTLY NOTIFY THE A/E OF SUCH CONDITIONS SHALL ABSOLVE THE A/E FROM ANY RESPONSIBILITY OF SUCH FAILURE. ACTION TAKEN WITHOUT KNOWLEDGE AND CONSENT OF THE A/E OR IN CONTRADICTION TO THE WORK PRODUCT OR THE RECOMENDATIONS OF THE A/E SHALL BECOME THE RESPONSIBILITY OF THE PARTIES RESPONSIBLE FOR TAKING SLICH ACTION

NOTES:

1. THE INFORMATION SHOWN ON THESE DRAWINGS IS BASED ON THE BEST INFORMATION AVAILABLE AT THE TIME TO THE A/E. THIS INFORMATION CANNOT BE GUARANTEED TO SHOW EVERY EXISTING CONDITIONS. THE CONTRACTORS SHALL READ AND STUDY THE TOTAL SET OF PLANS FOR ALL WORK. CONTRACTOR MUST VISIT THE SITE AND DETERMINE ALL FIELD CONDITIONS. ALL DIMENSIONS SHALL BE FIELD VERIFIED AND ALL DISCREPANCIES SHALL BE REPORTED TO A/E PRIOR TO BID SUBMISSIONS.

2. THE INFORMATION SHOWN IN THESE DRAWINGS ARE FOR BIDDING PURPOSES ONLY. THE GENERAL CONTRACTOR AND SUBCONTRACTORS SHALL PROVIDE SHOP DRAWINGS COORDINATED WITH ARCHITECTURAL, MECHANICAL, PLUMBING, ELECTRICAL AND STRUCTURAL DESIGN FOR REVIEW AND APPROVAL BY THE A/E OF RECORD.

ADDITIONAL GENERAL NOTES

- THE WORK SHALL NOT CAUSE THE STRUCTURE TO BECOME UNSAFE OR ADVERSELY AFFECT THE PERFORMANCE OF THE BUILDING.
 STRUCTURAL ELEMENTS THAT ARE UNCOVERED DURING THE COURSE OF THE ALTERATION AND THAT ARE FOUND TO BE UNSOUND OR DANGEROUS SHALL BE MADE TO
- COMPLY WITH THE APPLICABLE REQUIREMENTS OF THE 2018 IRC.

 3. IN THE EXISTING HOUSE, A SMOKE DETECTOR MUST BE INSTALLED IN EACH SLEEPING ROOM, OUTSIDE EACH SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE
- BEDROOMS, AND ON EVERY FLOOR.

 4. SMOKE ALARMS IN THE PORTION OF THE RESIDENCE THAT IS NOT IMPACTED BY THE SCOPE OF WORK SHALL BE PERMITTED TO BE BATTERY POWERED AND INTERCONNECTED. SMOKE ALARMS WITHIN THE AREA OF THE SCOPE OF WORK SHALL BE INTERCONNECTED, 110V, HARD WIRED, WITH BATTERY BACKUP. 2018 IRC
- NAPERVILLE R314.

 5. IN THE EXISTING HOUSE, A MINIMUM OF ONE CARBON MONOXIDE DETECTOR SHALL BE INSTALLED WITHIN 15 FEET OF ANY SLEEPING AREA WITHIN ANY DWELLING UNIT.
 CARBON MONOXIDE DETECTORS IN THE PORTION OF THE RESIDENCE THAT IS NOT IMPACTED BY THE SCOPE OF WORK SHALL BE PERMITTED TO BE BATTERY POWERED.
 6. ALL ILLINOIS HOMES ARE REQUIRED TO HAVE SMOKE ALARMS WITH A SELF-CONTAINED, NON-REMOVABLE, LONG TERM (10-YEAR LITHIUM) BATTERY, EFFECTIVE JAN.
- 7. ANY EXISTING NON-HARDWIRED, BATTERY-POWERED SMOKE ALARMS MUST BE REPLACED WITH A 10-YEAR SEALED BATTERY SMOKE ALARM IF ANY OF THE FOLLOWING IS TRUE.
- IS TRUE:

 THE UNIT IS 10 YEARS OLDER THAN THE DATE OF MANUFACTURE (OR IF THERE IS NO MANUFACTURED DATE ON THE DEVICE).
- THE UNIT IS TO TEARS OLDER THAN THE DATE OF MANOFACTORE (OR IF THERE IS NO MAIN)
 THE UNIT IS NO LONGER IN OPERATION OR FAILS TO RESPOND TO OPERABILITY TESTING.
 A NEW DEVICE IS BEING INSTALLED.


 REVISIONS:

 NO:
 BY:
 DATE:
 DESCRIPTION:

 RT
 07/04/2023
 Review

 1
 RT
 10/17/2023
 Plan Review Corrections

Convert 2-Unit to Single Family Residence. Interior Rehab & New 2-Story Frame Addition including New Partitions, New Electrical, Mechanical & Plumbing Systems, New Roof System & New Rear Deck & Balcony per Plans.



PROJECT ARCHITECT:
RT

DRAFTPERSON:
CS


APPROVED:
RT


PREPARED FOR:
OWNER


LOCATION:
223 Center Street
Naperville, IL 60540

JOB NUMBER:
223CS-07042023

SHEET Name:
Title Sheet

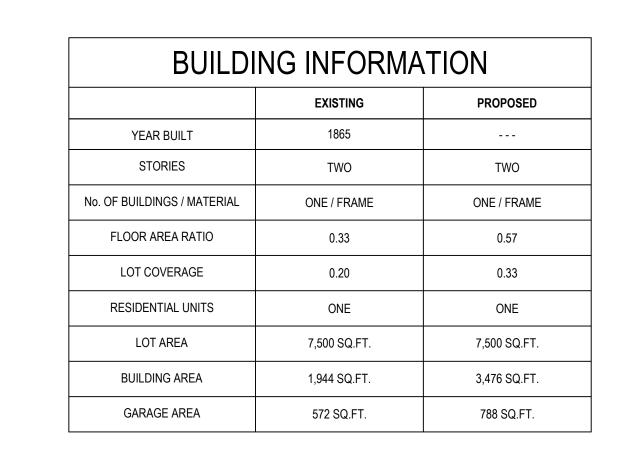

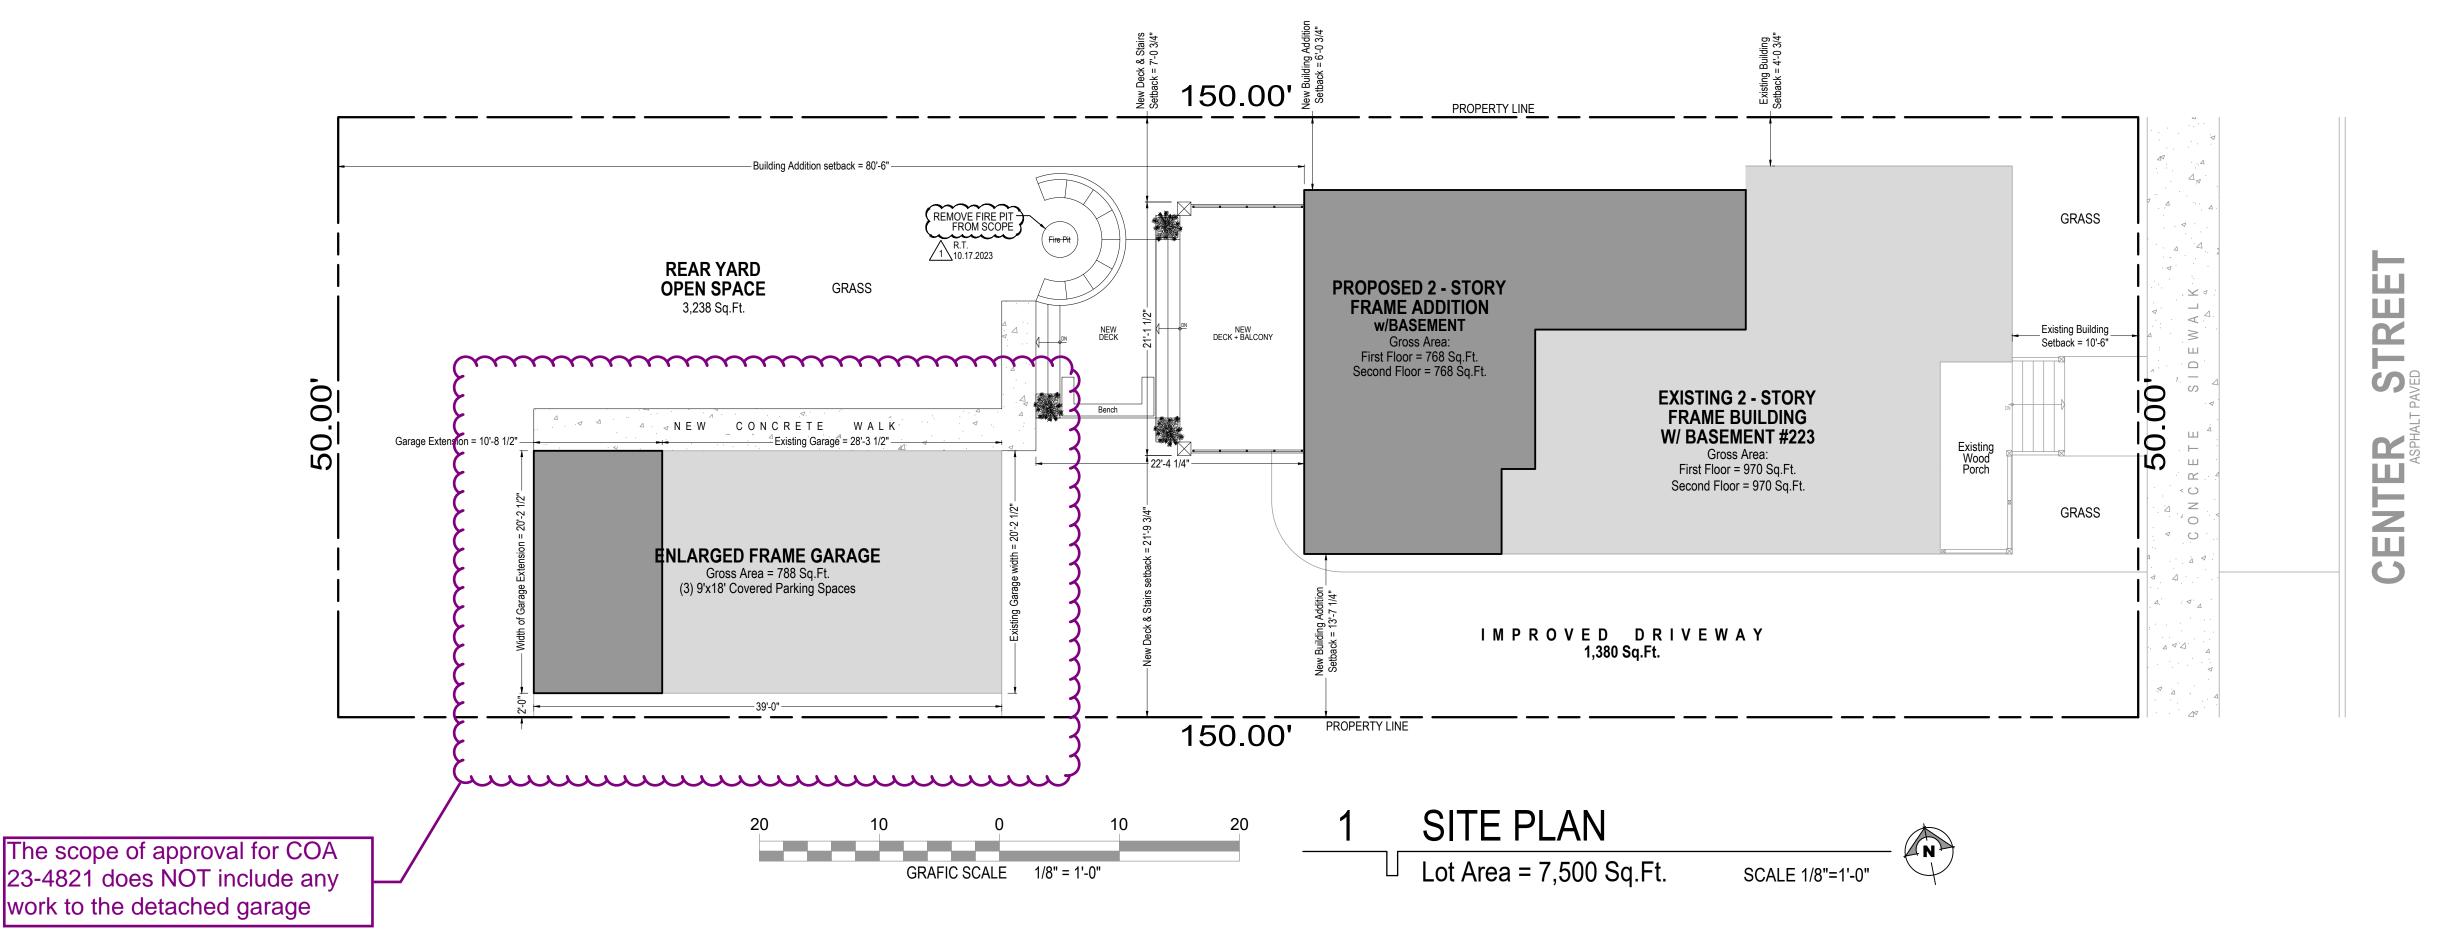


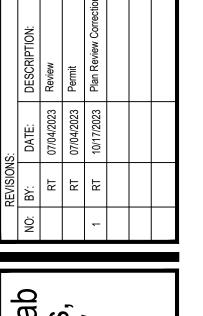

Sonvert 2-Unit to Single Family Residence. Interior Rehab & New 2-Story Frame Addition including New Partitions, New Electrical, Mechanical & Plumbing Systems, New Roof System & New Rear Deck & Balcony per Plans.

223 Center Street, Naperville Illinois 60540



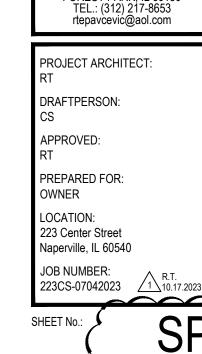

SHEET Name:



ABBREVIATIONS

4		G			Q		
AC	Acoustical ceiling		GA	Gauge		QTY	Quantity
A/C	Air conditioning		GALV	Galvanized			
ADJ	Adjacent		GC	General Contractor	R		
AFF	Above finished floor		GL	Glass		R	Radius
ALT	Alternate		GRD	Ground		RAD	Radius
AL	Aluminum		GWB	Gypsum Wallboard		RD	Roof Drain
ALUM	Aluminum		GYP	Gypsum		REF	Reference
APPROV	Access panel	1	1			REINF	Reinforced, Reinforcing
APPROX	Approximately	Н		Hann Dit-I		REQD	Required
<u> </u>			HB	Hose Bibb		REV	Revise(d), Revision
В	Datter D. C.		HC	Handicapped Accessible		RM	Room
B/	Bottom, Bottom of		HDWE	Hardware Hallow Matal		RO	Rough Opening
BD	Board		HM	Hollow Metal			
BLDG BLK	Building Block Blocking		HORIZ HP	Horizontal	S	 S	South
BM	Block, Blocking Beam		HVAC	High Point Heating, Ventilation & A/C		SC SC	Solid Core
BSMT	Beam Basement		пvAC	meaning, veniliation & A/C		SECT	Section Section
I IVICU	Dasciligit	Ti	Τ			SECT	Square feet
c		11	<u> </u> N	Inch		SHT	Sheet
CAB	Cabinet		INSUL	Insulated, Insulation		SIM	Similar
C/C	Cabinet Center-to-center		INT	Interior		SPEC	Specification
C/C	Control joint		11.4.1	, none		SPKR	Speaker
CL	Center line	J	Τ			SPRK	Sprinkler
CLG	Ceiling		 JT	Joint		SS	Stainless Steel
CLR	Clear			2000		ST	Stainless Steel Stainless
CMU	Concrete Masonry Unit	L				STD	Standard
COL	Column		LAM	Laminate		STL	Steel
CONC	Concrete		LAV	Lavatory		STRUCT	Structural
CONST	Construction		LP	Low Point		SUSP	Suspended
CONT	Continuous		LT	Light			·
CORR	Corridor		LTG	Lighting	Т		
CPT	Carpet					T/	Top of
СТ	Ceramic tile	М				T&B	Top and bottom (of)
			MACH	Machine		T&G	Tongue & groove
D			MAS	Masonry		TEL	Telephone
DIA	Diameter		MATL	Material		THK	Thick
DIM	Dimension		MAX	Maximum		TYP	Typical
DN	Down		MECH	Mechanical			
DR	Door		MFR	Manufacturer	U		
DTL	Detail		MIN	Minimum		UL	Underwriters Laboratory
DWG	Drawing		MISC	Miscellaneous		UNO	Unless noted otherwise
			МО	Masonry Opening			
E			MTL	Metal	٧		
Ē	East		MULL	Mullion		VB	Vapor Barrier
EA	Each					VCT	Vinyl Composition Tile
ELEC	Electric, Electrical	N				VERT	Vertical
ELEV	Elevator, Elevation		N	North		VIF	Verify in field
EQ	Equal		NC	Non-combustible		VT	Vinyl tile
EX	Existing		NIC	Not in Contract		VWC	Vinyl wall covering
EXIST	Existing		NO	Number			
EXP	Exposed		NOM	Nominal	W		
EXT	Exterior		NRC	Noise Reduction Coefficient		W	Width
			NTS	Not to scale		W/	With
F						W/O	Without
FD	Floor Drain	0				WC	Water closet
FDN	Foundation		ОС	On center		WD	Wood
FF	Finished Floor		occ	Occupancy, Occupant(s)		WDV	Wood veneer
FIN	Finish, Finished		ОН	Opposite Hand		WH	Water heater
FL	Floor		OPNG	Opening		WP	Waterproofing, Work point
FLR	Floor		OPP	Opposite		WWF	Welded Wire Fabric
FTG	Footing						
FUT	Future	P					
		•	PLAM	Plastic Laminate			
			PLBG	Plumbing			
			PLWD	Plywood			
			PROP	Property			
			PTD	Painted			
			PVC	Polyvinyl Chloride			

PVC Polyvinyl Chloride

WORKING DRAWING NOTES

- 1. CONTRACTOR SHALL VERIFY AND COORDINATE ALL NEW AND EXISTING CONDITIONS AND DIMENSIONS AT JOB SITE FOR COMPARISON WITH DRAWINGS AND SPECIFICATIONS PRIOR TO BIDDING AND START OF AND DURING CONSTRUCTION. IF ANY DISCREPANCIES OR OMISSIONS ARE FOUND, THE ARCHITECT SHALL BE NOTIFIED, IN WRITING FOR CLARIFICATION PRIOR TO PROCEEDING WITH WORK.
- 2. DO NOT SCALE DRAWINGS. CONTRACTOR SHALL RELY ON WRITTEN DIMENSIONS GIVEN. THE CONTRACTOR SHALL NOTIFY THE ARCHITECT FOR CLARIFICATIONS. ALL DIMENSIONS SHALL BE FIELD VERIFIED BY CONTRACTOR AND COORDINATED WITH ALL OF THE WORK OF ALL TRADES. IF DISCREPANCIES ARE FOUND, THE CONTRACTOR SHALL NOTIFY THE ARCHITECT IN WRITING FOR CLARIFICATION BEFORE THE COMMENCEMENT OR RETURN TO WORK.
- 3. ABBREVIATIONS THROUGHOUT THE PLANS ARE THOSE IN COMMON USE . NOTIFY THE ARCHITECT OF ANY ABBREVIATIONS IN QUESTION
- ARCHITECT OF ANY ABBREVIATIONS IN QUESTION.
 4. DIMENSIONS SHOWN ON FLOOR PLANS, SECTIONS, ELEVATIONS, AND DETAILS ARE TO
- FINISH FACE OF WALL, MASONRY, OR CONCRETE, UNLESS OTHERWISE NOTED.

 5. IN THE CASE OF A CONFLICT BETWEEN THE DRAWINGS AND SPECIFICATIONS, SPECIFICATIONS SHALL TAKE PRECEDENCE, CONTRACTOR SHALL NOTIFY THE CONSTRUCTION MANAGER OF ANY CONFLICT BEFORE PROCEEDING WITH THE WORK.
- 6. THE SPECIFICATIONS AND ALL CONSULTANT DRAWINGS ARE SUPPLEMENTAL TO THE ARCHITECTURAL DRAWINGS. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO COORDINATE WITH ARCHITECTURAL DRAWINGS BEFORE THE INSTALLATION OF ANY OF THE CONSULTANT'S WORK AND TO BRING ANY DISCREPANCIES OR CONFLICTS TO THE ATTENTION OF THE ARCHITECT, IN WRITING FOR CLARIFICATION. IMPROPERLY INSTALLED WORK SHALL BE CORRECTED BY THE GENERAL CONTRACTOR AT HIS EXPENSE AND AT NO EXPENSE TO THE ARCHITECT, HIS/HER CONSULTANTS, OR THE OWNER
- 7. THE ARCHITECT SHALL BE CONSULTED IN ALL CASES WHERE CUTTING INTO AN EXITING STRUCTURAL PORTION OF ANY BUILDING IS EITHER EXPIDIENTOR NECESSARY. PRIOR TO PROCEEDING WITH WORK, REINFORCEMENT AND/OR SUPPORT SATISFACTORY TO ARCHITECT AND STRUCTURAL ENGINEER SHALL BE PROVIDED BY CONTRACTOR PRIOR TO CUTTING INTO STRUCTURAL PORTIONS OF ANY BUILDING.
- 8. LEGAL EXITS SHALL NOT BE BLOCKED AT ANY TIME.
- 9. FINAL CLEAN UP AND DISPOSAL: REMOVE DEBRIS, RUBBISH, AND WASTE MATERIALS FROM THE OWNERS PROPERTY TO A LAWFUL DISPOSAL AREA AND PAY ALL HAULING AND DUMPING COSTS. CONFORM TO PERTAINING FEDERAL, STATE AND LOCAL LAWS, REGULATIONS AND ORDERS UPON COMPLETION OF WORK, ALL CONSTRUCTION AREAS SHALL BE LEFT VACUUM-CLEAN AND FREE FROM DEBRIS, CLEAN ALL DUST, DIRT, STAINS, HANDMARKS, PAINT SPOTS, DROPPINGS AND OTHER BLEMISHES.
- 10. PRIOR TO INSPECTION OF EXISTING FACILITY, THE CONTRACTOR MUST RECEIVE PERMISSION FOR SITE ACCESS FROM THE OWNER OR THE DESIGNATED REPRESENTATIVE.
- 11. WHEN IT IS NECESSARY TO INTERRUPT ANY EXISTING UTILITY SERVICE TO MAKE CORRECTIONS AND/OR CONNECTION, A MINIMUM OF 48 HOURS ADVANCE NOTICE SHALL BE GIVEN TO THE OWNER. INTERRUPTIONS IN UTILITY SERVICES SHALL BE OF THE SHORTEST POSSIBLE DURATION FOR THE WORK AT HAND AND SHALL BE APPROVED IN ADVANCE BY THE OWNER.
- 12. IN THE EVENT THE UTILITY SERVICE IS INTERRUPTED WITHOUT THE REQUIRED 48 HOUR NOTICE, THEN THE CONTRACTOR SHALL BE FINANCIALLY LIABLE FOR ALL DAMAGES SUFFERED BY THE OWNER DUE TO THE UNAUTHORIZED INTERRUPTION. RECONNECTION SHALL BE MADE IMMEDIATELY.
- 13. IF THE CONTRACTOR ASCERTAINS AT ANY TIME THAT THE REQUIREMENTS OF THIS CONTRACT CONFLICT WITH, OR ARE IN VIOLATION OF, APPLICABLE LAWS, CODES, REGULATIONS, AND ORDINANCES, HE SHALL NOT PROCEED THE WORK IN QUESTION, EXCEPT AT HIS OWN RISK, UNTIL ARCHITECT HAS BEEN NOTIFIED IN WRITING AND WRITTEN DETERMINATION IS MADE BY THE ARCHITECT. WHERE COMPLETED OR PARTIALLY COMPLETED WORK IS DISCOVERED TO BE IN VIOLATION WITH APPLICABLE LAWS, CODES, REGULATIONS AND ORDINANCES, CONTRACTOR SHALL BE REQUIRED TO REMOVE THAT WORK WITH ALL NEW COMPLYING WORK AT NO ADDITIONAL EXPENSE TO THE OWNER, ARCHITECT OR CONSULTANTS.
- 14. ANY WORK INSTALLED IN CONFLICT WITH THE CONTRACT DOCUMENTS SHALL BE CORRECTED BY THE CONTRACTOR AT HIS/HER EXPENSE AND AT NO ADDITIONAL EXPENSE TO THE OWNER, ARCHITECT OR CONSULTANTS.
- 15. THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING FLOOR-TO FLOOR ELEVATIONS; THE NEW BUILDING EXPANSION'S GROUND FLOOR SHALL ALIGN IN ELEVATION WITH RESPECTIVE FLOORS IN EXISTING BUILDING.
- 16. THE CONTRACTOR SHALL FURNISH ALL MATERIALS, LABOR, EQUIPMENT, TRANSPORTATION AND SERVICES NECESSARY FOR THE SATISFACTORY COMPLETION OF WORK UNLESS DESIGNATED (N.I.C) OR (O.F.O.I.). ALL EQUIPMENT, WORK AND MATERIALS SHALL COMPLY WITH ALL CURRENT AND LOCAL APPLICABLE CODES AND GOVERNING REGULATIONS, AND CONTRACT DOCUMENTS.
- 17. THE CONTRACTOR SHALL PROTECT ALL FINISH WORK AND SURFACES FROM DAMAGE DURING THE COURSE OF CONSTRUCTION AND SHALL REPLACE AND/OR REPAIR ALL DAMAGED SURFACES CAUSED BY THE CONTRACTOR OR SUBCONTRACTOR PERSONNEL TO THE SATISFACTION OF THE OWNER AND ARCHITECT.
- 18. THE CONTRACTOR SHALL PROVIDE ALL NECESSARY PERMITS AND INSPECTIONS.
- 19. SPECIAL NOTICE TO CONTRACTOR: ALL CONTRACTORS PERFORMING WORK ON THE PREMISES SHALL BE RESPONSIBLE FOR INITIATING, MAINTAINING AND SUPERVISING A REASONABLE AND PRUDENT SAFETY PROGRAM INCLUDING BUT NOT LIMITED TO THE ISOLATION OF WORK AREAS AND PROMPT REMOVAL OF ANY DEBRIS OR TOOLS WHICH MAY ENDANGER VISITORS AND STAFF OF THE OWNER OR ARCHITECT.
- 20. THE CONTRACTOR SHALL VERIFY THE LOCATION OF ALL EXISTING UTILITIES BELOW GRADE AND RELATED SERVICE CONNECTIONS WITH THE RESPECTIVE UTILITY COMPANIES.
- 21. THE CONTRACTOR SHALL PROVIDE SANITARY FACILITIES FOR WORKER'S USE. EXISTING FACILITIES SHALL AND MAY NOT BE USED.
- 22. THE CONTRACTOR SHALL OBTAIN OSHA PERMITS FOR ANY VERTICAL EXCAVATION OVER 5'-0" DEEP INTO WHICH PERSONS MUST DESCENT.
- 23. CONTRACTOR AND SUBCONTRACTORS SHALL BE RESPONSIBLE FOR OBTAINING AND PAYING ALL PERMITS AND FEES REQUIRED, NOT NORMALLY COVERED BY THE BUILDING PERMITS
- 24. DRAWINGS OF EXISTING CONDITIONS HAVE BEEN COMPILED FROM EXISTING DATA SUPPLIED BY THE OWNER TO THE ARCHITECT. THE ARCHITECT MAKES NO WARRANTY EITHER EXPRESSED OR IMPLIED, FOR THE ACCURACY OR COMPLETENESS OF THE EXISTING INFORMATION RECORDED. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS. NOTIFY ARCHITECT IN WRITING OF ANY DISCREPANCIES FOR CLARIFICATION PRIOR TO PROCEEDING WITH WORK.
- 25. THE EXIT DOOR MUST OPEN OVER A LANDING NOT MORE THAN 1'-0" BELOW THE THRESHOLD.
- 26. OVERHEAD DOORS ARE NOT PERMITTED AS EXIT DOORS.
- 27. THE CONSTRUCTION OR DEMOLITION OF ANY BUILDING STRUCTURE, SCAFFOLDING OR FALSEWORK MORE THAN THREE STORIES OR 36'-0" IN HEIGHT REQUIRES A PERMIT FROM THE STATE OF ILLINOIS DIVISION OF INDUSTRIAL SAFETY (OR EQUAL) PRIOR TO THE ISSUANCE OF A BUILDING PERMIT.
- 28. APPROVED NUMBERS AND ADDRESSES SHALL BE PROVIDED IN SUCH A POSITION AS TO BE PLAINLY VISIBLE AND LEGIBLE FROM THE STREET.

MATERIAL NOTES

WOOD 1. SOUTHERN YELLOW PINE, PRESSURE TREATED USING ACQ-C, ACQ-D, CBA-A OR CA-B PRESERVATIVE, GRADE No.1 OR BETTER SHALL BE USED FOR COLUMNS AND GRADE No2 OR BETTER SHALL BE USED FOR ALL OTHER MEMBERS 2. ALL WOOD CONSTRUCTION SHALL CONFORM TO THE ALTC (AMERICAN INSTITUTE OF TIMBER CONSTRUCTION).

- 2. ALL WOOD CONSTRUCTION SHALL CONFORM TO THE AITC (AMERICAN INSTITUTE OF TIMBER CONSTRUCTION)
 AND THE APA (AMERICAN PLYWOOD ASSOCIATION) NATIONAL DESIGN SPECIFICATIONS.

 3. ALL WOOD CONSTRUCTION EXPOSED TO WEATHER TO BE PRESSURE TREATED.
- FASTENERS
- FASTENERS SHALL BE AS FOLLOWS

PEDESTALS - 3500 PSI

- . NAILS: STAINLESS STEEL OR HOT-DIPPED GALVANIZED, SIZED AS SPECIFIED IN DETAILS. DECK SCREWS: 2-1/2" TO 3-1/2" LONG, #8 MINIMUM SIZE, STAINLESS STEEL OR HOT-DIPPED GALVANIZED.
- 3. LAG BOLTS: STAINLESS STEEL OR HOT-DIPPED GALVANIZED, SIZED AS SPECIFIED IN DETAILS. MATERIAL SHALL BE SAE GRADE #2.
- 4. HEX BOLTS: STAINLESS STEEL OR HOT-DIPPED GALVANIZED, SIZED AS SPECIFIED IN DETAILS. MATERIAL SHALL BE ASTM A307

CONCRETE

- ALL CONCRETE WORK SHALL BE IN ACCORDANCE WITH THE "AMERICAN CONCRETE INSTITUTE BUILDING CODE" (ACI 318) AND WITH "SPECIFICATIONS FOR STRUCTURAL CONCRETE FOR BUILDINGS" (ACI 301), LATEST EDITION.
- ALL NORMAL WEIGHT CONCRETE (145 P.C.F.) SHALL HAVE MINIMUM 28 DAY COMPRESSIVE STRENGTH AS
 FOLLOWS:
 FOOTINGS 3500 PSI
- PROVISIONS MUST BE TAKEN TO PROTECT ALL CONCRETE WORK FROM FROST DAMAGE WITH SPECIAL ATTENTION PAID TO FOOTING AND OTHER ON-GRADE CONSTRUCTION PRIOR TO BACKFILLING AND ENCLOSING THE BUILDING.
- 4. CALCIUM CHLORIDE AND/OR ADMIXTURES CONTAINING CALCIUM CHLORIDE SHALL NOT BE USED IN CONCRETE.
- 5. ALL CONCRETE SUBJECT TO EXTERIOR EXPOSURE WITH SPECIFIED STRENGTH LESS THAN 6000 PSI SHALL BE AIR ENTRAINED 4% TO 6%.
- 6. COLD WEATHER CONCRETING SHALL BE DONE IN ACCORDANCE WITH ACI-306, HOT WEATHER CONCRETING SHALL BE DONE IN ACCORDANCE WITH ACI-305.
- SHALL BE DONE IN ACCORDANCE WITH ACI-305.

 7. EXCAVATION WORK TO BE PERFORMED BY A LICENSED, INSURED & BONDED, EXCAVATION CONTRACTOR,

WITH THE CITY OF NAPERVILLE. REINFORCEMENT BARS

1. REINFORCEMENT BARS SHALL BE ASTM A615, GRADE 60 STEEL.

MASONRY

MASONRY UNITS SHALL COMPLY WITH APPLICABLE ASTM STANDARDS, AND MORTAR SHALL BE TYPE M OR S, WITH fm = 1.150 PSI

METAL CONSTRUCTION CONNECTORS

1. SHALL BE STAINLESS STEEL, HOT-DIPPED GALVANIZED OR TRIPLE ZINC GALVANIZED (G-185), SIMPSON STRONG TIE, UNITED STEEL PRODUCTS OR EQUAL, TO BE USED FOR JOIST HANGER, COLUMN BASE, METAL STRAP AND METAL ANGLE CONNECTIONS. NOTE THAT IF HOT-DIPPED GALVANIZED OR TRIPLE ZINC GALVANIZED CONNECTORS ARE USED, ALL THE FASTENERS FOR THAT CONNECTION MUST BE HOT-DIPPED GALVANIZED AS WELL, SINCE THE STAINLESS STEEL COULD DAMAGE THE GALVANIZING.

FLASHING AND SEALANTS

. FLASHING SHALL BE 28 GA. STAINLESS STEEL (0.015 in MINIMUM THICKNESS ASTM A167, TYPE 304) OR 16oz ROLLED COPPER (0.021 in MINIMUM THICKNESS ASTM B370). CARLISLE COATINGS' CCW-705 SELF-ADHERING VAPOR/AIR BARRIER SYSTEM OR EQUAL SHALL BE USED FOR THE VAPOR BARRIER AT THE LEDGER BEAM CONNECTIONS. SEALANT SHALL BE 100% SILICONE RUBBER SEALANT WITH A 50 YEAR DURABILITY GUARANTEE.

STRUCTURAL STEEL

ALL STRUCTURAL STEEL SHALL BE ASTM A-36, COATED WITH A RUST PROHIBITED PRIMER WITH A MINIMUM DRY THICKNESS OF 3 MILS.

TABLE A - METAL CONNECTORS

ITEM	SST MODEL#	USP MODEL#	GAGE	INSTALLATION HARDWARE
SINGLE JOIST HANGER 1	LUS210 Z OR SS	JUS210 TZ, SS	18	4-10d (Joist), 8-10d (Header)
DOUBLE JOIST HANGER 2	LUS210-2Z OR SS	JUS210-2TZ, SS	18	6-16d (Joist), 8-16d (Header)
SINGLE JOIST HANGER 3	LUS28 Z	JUS28 TZ, SS	18	4-10d (Joist), 6-10d (Header)
DOUBLE JOIST HANGER 4	LUS28-2Z	JUS28-2TZ	18	4-16d (Joist), 6-16d (Header)
METAL ANGLE 1	L90 Z	AC9 TZ	16	10-10d, 5 each Leg
METAL ANGLE 2	A23 Z	A3 TZ	18	*8-10d x 1-1/2", 4 each Leg
METAL ANGLE 3	TA9 Z OR KT	SCA9 TZ	12	5-1/4" dia. x 1-1/2" wood Screw
COLUMN BASE, 6"x6" POST	CBSQ66-SDS2 HDG	CBSQ66-SDS2 TZ	12	14-1/4" dia. x 2" wood Screws
COLUMN BASE, 6"x6" POST	ABU66Z		12	12-16d, (2) 1/2" Ø Bolts, 5/8" Anchor
POST BASE, RAILING POST	PBS44A HDG	WAS 44 TZ	12	14-16d, (2) 1/2" dia. Bolts
METAL STRAP	MSTA12 Z OR SS	MSTA12 TZ, SS	18	10-10d
POST BASE PLATE	CPS4	CPB44	_	4-10d

NOTES:

1. USE SMALLER LENGTH NAILS WITH SPECIFIED PENNY WEIGHT.


2. SST = SIMPSON STRONG TIE, USP = UNITED STEEL PRODUCTS, HDG = HOT DIPPED GALVANIZED SS = STAINLESS STEEL, Z = Z-MAX GALVANIZED (G-185), TZ = TRIPLE ZINC GALVANIZED (G-185)

FLAME SPREAD RATING

STAIRWAYS, PUBLIC L	OBBIES & PUBLIC CORRIDORS	CLASS 1	
BUSINESS UNITS		CLASS 2	
RESIDENTIAL UNITS		CLASS 1	
AME SPREAD RATING			
CLASSIFICATION	FLAME SPREAD RATING	SMOKE DEVELOPED	
CLASS 1	0 TO 12	200	
CLASS 2	26 TO 76	450	
CLASS 3	76 TO 200	450	

BUILDING DESIGN LOADS

ROOF LOADS			
LIVE LOAD	15 PSF		
DEAD LOAD	15 PSF		
SNOW LOAD	25 PSF		
DRIFT SNOW LOAD	15 PSF		
FIRST FLOOR LOADS			
LIVE LOADS			
RESIDENTIAL	40 PSF		
DEAD LOADS	20 PSF		
LATERAL LOADS			
WIND LOADS	20 PSF		

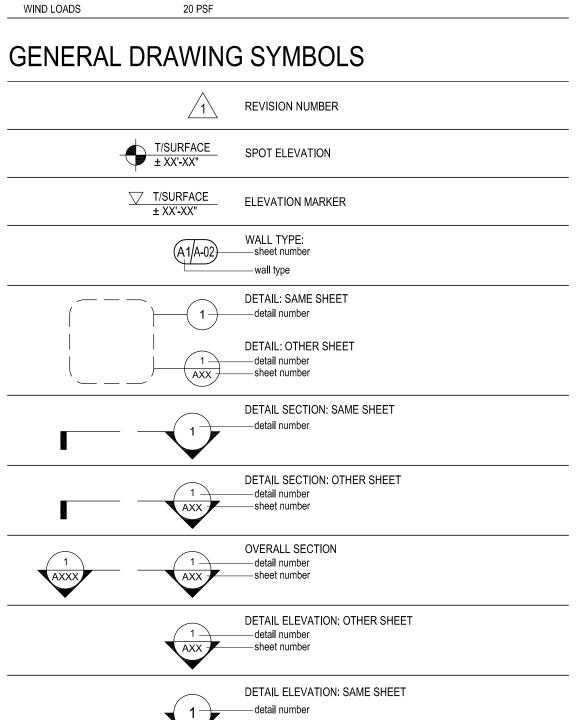


INTERIOR ELEVATION: OTHER SHEET

INTERIOR ELEVATION: SAME SHEET

-sheet number


-detail number

AXXX-



Convert 2-Unit to Single Family Residence. Interior Rehab & New 2-Story Frame Addition including New Partitions, New Electrical, Mechanical & Plumbing Systems, New Roof System & New Rear Deck & Balcony per Plans.

223 Center Street, Naperville Illinois 60540



rtepavcevic@aol.com

PROJECT ARCHITECT:
RT

DRAFTPERSON:
CS

APPROVED:
RT

PREPARED FOR:
OWNER

LOCATION:
223 Center Street
Naperville, IL 60540

JOB NUMBER:
223CS-07042023

SHEET No.:

General Project Information

DIVISION 1 GENERAL REQUIREMENTS

- 1. ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH ALL APPLICABLE LOCAL, STATE AND NATIONAL CODES AND ORDINANCES AND ALL AUTHORITIES HAVING JURISDICTION.
- 2. THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND CONDITIONS BEFORE PROCEEDING WITH WORK AND NOTIFY SUPERINTENDENT AT ONCE OF ANY DISCREPANCIES PRIOR TO COMMENCING WORK.
- 3. PLUMBING SCHEMATIC DRAWING, HVAC DRAWING, SEWER MAIN, ELECTRICAL OUTLETS, SWITCHES, LIGHT LOCATIONS FOR ROUTING ALL PLUMBING, MECHANICAL AND ELECTRICAL WORK IS TO BE COORDINATED BETWEEN THE TRADES AFFECTED BY THE WORK AS PART OF THEIR INSTALLATION LAYOUT. NO PLUMBING, MECHANICAL OR ELECTRICAL INFORMATION IS TO BE SCALED FROM THE DRAWING.
- 4. ON-SITE VERIFICATION OF ALL DIMENSIONS AND CONDITIONS SHALL BE THE RESPONSIBILITY OF EACH
- 5. EXTRAS SHALL BE AUTHORIZED IN WRITTEN CHANGE ORDERS ONLY BY THE A/E OF RECORD. OWNER TO AUTHORIZE CHANGE ORDERS IF CONTRACT BETWEEN OWNER & CONTRACTOR ALOWS THEM.
- 6. ALL WORK SHALL BE PERFORMED IN A WORKMANLIKE MANNER. 7. EACH CONTRACTOR SHALL INCLUDE LABOR, MATERIALS, TOOLS, EQUIPMENT, ETC., FOR THE COMPLETE
- CONSTRUCTION OF WORK INDICATED AND SPECIFIED BY THE DRAWINGS AND SPECIFICATIONS. 8. MATERIALS AS SPECIFIED ON DRAWINGS SHALL BE USED OR EQUAL APPROVED.
- 9. SUBSTITUTION OF MATERIALS SHALL NOT BE ALLOWED WITHOUT THE WRITTEN CONSENT OF THE GENERAL
- 10. EACH SUBCONTRACTOR SHALL AMEND AND MAKE GOOD AT HIS/HER OWN COST, ANY DEFECT OR OTHER FAULTS IN THEIR WORK OR MATERIAL.
- 11. EACH CONTRACTOR IS TO CLEAN UP DEBRIS INSIDE AND OUTSIDE THE BUILDING SITE WHICH HAS BEEN CAUSED BY THEIR WORK OR BE BACKCHARGED AT A RATE OF \$45.00 PER HOUR.
- 12. THE ARCHITECT SHALL NOT HAVE CONTROL OVER OR CHARGE OF AND SHALL NOT BE RESPONSIBLE FOR THE CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES, OR PROCEDURES, OR FOR SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE WORK, SINCE THESE ARE SOLELY THE CONTRACTOR'S RESPONSIBILITY UNDER
- THE CONTRACT FOR CONSTRUCTION. 13. ALL WORK AND USE OF MATERIALS SHALL BE IN ACCORDANCE WITH THE APPLICABLE MANUFACTURER'S TRADE ASSOCIATION AND/OR INSTITUTE STANDARDS AND SPECIFICATIONS.
- 14. OWNER WILL REQUIRE THE SUBCONTRACTORS TO OBTAIN AND MAINTAIN COMMERCIAL GENERAL LIABILITY INSURANCE WITH BROAD FROM PROPERTY DAMAGE COVERAGE AND CONTRACTUAL LIABILITY ENDORSEMENT INSURING THE INDEMNITY REQUIRED OF THE CONTRACTOR. THE INDEMNITIES ENDORSEMENT INCLUDED ON THE CONTRACTOR'S COMMERCIAL GENERAL LIABILITY POLICY WILL PROVIDE THE FOLLOWING:
- A. THAT THE COVERAGE AFFORDED THE ADDITIONAL INSURED WILL BE THE PRIMARY INSURANCE FOR THE ADDITIONAL INSURED WITH RESPECT TO CLAIMS ARISING OUT OF OPERATIONS PERFORMED ON OR ON BEHALF OF THE CONTRACTOR.
- B. THAT IF THE ADDITIONAL INSURED HAVE OTHER INSURANCE WHICH IS APPLICABLE TO THE LOSS SUCH OTHER INSURANCE WILL BE ON AN EXCESS OR CONTINGENT BASIS.
- C. THAT THE AMOUNT OF THE COMPANY'S LIABILITY UNDER THE INSURANCE POLICY WILL NOT BE REDUCED BY THE EXISTENCE OF SUCH OTHER INSURANCE.
- D. THAT ADDITIONAL INSURED WILL BE GIVEN NOT LESS THAN 30 DAYS PRIOR WRITTEN NOTICE OF ANY CANCELLATION THEREOF.
- E. SUBCONTRACTORS SHALL CARRY THE FOLLOWING MINIMUM INSURANCE COVERAGE:

LIABILITY: \$ 1,000,000.00 \$ 1,000,000.00 BODILY INJURY:

PROPERTY DAMAGE: \$ 1,000,000.00

DIVISION 2 SITE WORK

- 1. REMOVE EXISTING CONSTRUCTION AND PERFORM DEMOLITION WORK AS NECESSARY TO PREPARE THE SITE FOR THE NEW WORK AS FURTHER DESCRIBED IN THE CONTRACT DOCUMENTS.
- 2. REMOVE ALL DEMOLISHED MATERIALS FROM SITE IMMEDIATELY.
- 3. MAINTAIN EXIT AND ACCESS WAYS IN A CLEAN, UNOBSTRUCTED, AND PROPERLY ILLUMINATED MANNER AT ALL TIMES.
- 4. PROTECT UNAFFECTED SPACES FROM DUST, NOISE AND DAMAGE. MAINTAIN SITE IN A CLOSED AND
- 5. SECURE MANNER TO PREVENT THEFT, VANDALISM, AND UNAUTHORIZED ENTRY.

DIVISION 3 CONCRETE

- 1. ALL CONCRETE WORK SHALL BE IN ACCORDANCE WITH THE "AMERICAN CONCRETE INSTITUTE BUILDING CODE" (ACI 318) AND WITH "SPECIFICATIONS FOR STRUCTURAL CONCRETE FOR BUILDINGS" (ACI 301), LATEST EDITION.
- 2. ALL NORMAL WEIGHT CONCRETE (145 P.C.F.) SHALL OBTAINA MINIMUM 28 DAY COMPRESSIVE STRENGTH AS FOLLOWS: A. FOOTINGS 3500 PSI B. FOUNDATION WALLS 3500 PSI
- 3. CALCIUM CHLORIDE AND/OR ADMIXTURES CONTAINING CALCIUM CHLORIDE SHALL NOT BE USED IN CONCRETE. 4. ALL CONCRETE SUBJECT TO EXTERIOR EXPOSURE WITH SPECIFIED STRENGTH LESS THAN 6000 PSI SHALL BE AIR
- 5. COLD WEATHER CONCRETING SHALL BE DONE IN ACCORDANCE WITH ACI-306, HOT WEATHER CONCRETING SHALL BE DONE IN ACCORDANCE WITH ACI-305.
- 6. BEARING CAPACITY OF SOIL SHALL BE 3000 LB/SF.
- 7. IN CASE OF OVEREXCAVATING FOR FOOTING, ALL EVEREXCAVATION UNDER FOOTING SHALL BE FILLED WITH

DIVISION 4 MASONRY

- 1. CLAY, BRICK, AND CONCRETE MASONRY CONSTRUCTION SHALL CONFORM TO THE "BUILDING CODE REQUIREMENTS FOR ENGINEERED BRICK MASONRY" ISSUED BY THE BRICK INSTITUTE OF AMERICA AND "SPECIFICATION FOR THE DESIGN AND CONSTRUCTION OF LOAD BEARING CONCRETE MASNRY" ISSUED BY THE NATIONAL CONCRETE MASONRY ASSOCIATION, LATEST EDITION.
- 2. GIVEN DESIGN DATA ASSUMES THE EXISTENCE OF ADEQUATE FIELD SUPERVISION OF CONSTRUCTION, FULFILLING THE "WITH INSPECTION" CRITERIA OF THE CODES.
- 3. MASONRY MATERIALS SHALL CONFORM TO THE LATEST EDITIONS OF HE FOLLOWING SPECIFICATIONS:
- A. HOLLOW-LOAD BEARING UNITS, ASTM C90, COMPRESSIVE STRENGTH SHALL BE OVER 1,600 PSI ON AVERAGE NET B. SOLID-LOAD BEARING UNITS, ASTM C145, COMPRESSIVE STRENGTH SHALL BE OVER 1,551 PSI ON AVERAGE GROSS
- C. MORTAR, ASTM C270, TYPE "M" OR "S", ONLY. FOR REINFORCED MASONRY MORTAR SHALL BE ASTM C476, TYPE "S". D. METAL WIRES USED AS TIES AND ANCHORS SHALL CONFORM TO ASTM A82, ONLY CORROSION-RESISTANT METALS
- OR METALS WITH SUCH COATING SHALL BE USED. E. REINFORCEMENT, WHEN INDICATED SHALL BE ASTM A615, GRADE 60.
- 4. CONCRETE MASONRY STRENGTH, f'm AT 28 DAYS SHALL BE 1,350 PSI MINIMUM.
- 5. CALCIUM CHLORIDE AND/OR ADMIXTURES CONTAINING CALCIUM CHLORIDE, SHALL NOT BE INCLUDED IN MORTAR OR
- 6. NO EXTERIOR MASONRY SHALL BE LAID WHEN THE OUTSIDE TEMPERATURE IS LESS THAN 40 DEGREES FARENHEIT UNLESS ADEQUATE PROTECTION, APPROVED BY THE ARCHITECT IS USED.

- 7. MASONRY WALLS SHALL BE ADEQUATELY BRACED DURING ERECTION.
- 8. TYPICAL JOINT REINFORCEMENT SHALL BE #9 GA., CONTINUOUS SIDE WIRES WITH #9 GA. CROSS TIES. SPACING 16" O.C. (VERTICALLY).

DIVISION 5 METALS

- 1. STRUCTURAL STEEL SHALL BE DETAILED, FABRICATED AND ERECTED IN ACCORDANCE WITH THE AISC "SPECIFICATION FOR DESIGN, FABRICATION AND ERECTION OF STRUCTURAL STEEL FOR BUILDINGS" AND THE AISC "CODE OF STANDARD PRACTICE".
- 2. STEEL SHALL CONFORM TO THE FOLLOWING ASTM SPECIFICATIONS (UNLESS OTHERWISE NOTED): STRUCTURAL SHAPES AND PLATES: A36
- A-500 GRADE B STRUCTURAL TUBING:
- 3. TYPICAL CONNECTIONS FOR STEEL BEAMS SHALL BE STANDARD AISC FRAMED BEAM CONNECTIONS, EXCEPT WHERE SHOWN WELDED. SHALL BE BOLTED WITH 3/4" DIA. HIGH STRENGTH BOLTS CONFORMING TO ASTM A-325-N, OR GREATER, UNLESS OTHERWISE NOTED. CONNECTIONS SHALL BE DESIGNED FOR 60% OF THE TOTAL ALLOWABLE UNIFORM LOAD DERIVED FROM THE AISC MANUAL'S TABLE OF "UNIFORM LOAD CONSTANTS" FOR NON-COMPOSITE
- 4. ALL COPED BEAMS TO BE DESIGNED IN ACCORDANCE WITH APPENDIX "B" OF THE AISC MANUAL "ENGINEERING FOR STEEL CONSTRUCTION". PROVIDE REINFORCING AS REQUIRED. ALL RE-ENTRANT CORNERS TO BE SHAPED, NOTCH-FREE, TO A RADIUS OF AT LEAST 1/2".
- 5. ALL WELDING ELECTRODES SHALL BE E-70XX. ALL SHOP AND FIELD WELDING SHALL BE MADE IN ACCORDANCE WITH A.W.S. D1.1-88 "CODE FOR WELDING IN BUILDING CONSTRUCTION", AND SHALL BE MADE BY QUALIFIED "CERTIFIED"
- 6. ALL STRUCTURAL STEEL EXPOSED TO THE ELEMENTS SHALL RECEIVE ONE COAT OF APPROVED SHOP PAINT, IN ADDITION TO FIELD PAINT AS SPECIFIED IN THE ARCHITECTURAL SPECIFICATIONS.
- 7. PROVIDE MINIMUM WELD SIZE PER AISC 1.17.2.

DIVISION 6 CARPENTRY

- 1. FLEXURAL FRAMING MEMBERS SHALL BE AS FOLLOWS:
- A. RAFTERS: SPRUCE-PINE-FIR #2
- B. FLOOR JOISTS: SPRUCE-PINE-FIR #2 C. CEILING JOISTS: SPRUCE-PINE-FIR #2
- 2. LAMINATED VENEER LUMBER ("MICROLLAMS") SHALL BE BY TRUSS JOISTS MACMILLIAN OR ARCHITECT APPROVED EQUAL. MINUMUM STRUCTURAL REQUIREMENTS; Fb=2,600 psi, MODULUS OF ELASTICITY=1,900,000.
- 3. PROVIDE 1" x 4" OR METAL CROSS BRIDGING NOT OVER 6' ON CENTER FOR ALL WOOD JOISTS.
- 4. PROVIDE SOLID BLOCKING OF THE SAME DIMENSION AS THE JOISTS BETWEEN THE JOISTS AT ALL SUPPORTS.
- 5. ALL PLYWOOD SHOWN FOR FLOOR/ROOF DECKS AND AS WALL SHEATING SHALL BE OF THE TICKNESS SHOWN ON THE DRAWINGS AND SHALL MEET ALL THE REQUIREMENTS OF U.S. PRODUCT STANDARD PS 1, LATEST EDITION, FOR STRUCTURAL 1 GRADE MATERIAL.
- 6. FOR HEADERS WITH SPANS IN EXCESS OF 6 FEET, MIN. END BEARING AT HEADERS SHALL BE 2-2x4 (JACKS) AND 1-2x4 FULL HEIGHT (KING) STUD.
- 7. PROVIDE DOUBLE JOISTS UNDER ALL BEARING PARTITIONS.
- 8. NOTCHING IS PERMITTED TO 1/6 JOISTS DEPTH, EXCEPT NOTCHING IS NOT PERMITTED @ MIDDLE 1/3 OF SPAN. 9. HOLES MAY BE BORED THROUGH FRAMING NOT TO EXCEED 2" IN DIAMETER, OR BE CLOSER THAN 2" TO TOP OR
- 10. WOOD SILL PLATES ON TOP OF FOUNDATION WALLS SHALL BE PRESSURE TREATED, ON A 1/2" FOAM SILL SEALER WITH
- CEDAR SHIMS @ 16" O.C. (MAXIMUM) AND ANCHORED WITH BOLTS AS SHOWN IN DRAWINGS. 11. ALL BOTTOM PLATES OF BASEMENT PARTITIONS TO BE PRESSURE TREATED.
- 12. ALL WALL PARTITIONS TO HAVE STUDS @ 16" O.C. MAXIMUM SPACING. DOUBLE TOP PLATES @ ALL EXTERIOR BEARING WALL WITH MINIMUM LAP OF 48". 13. BALLOON FRAME WALLS @ VOLUME CEILINGS.
- 14. ALL SUBFLOORS TO BE 3/4" TONGUE AND GROOVE PLYWOOD GLUED AND SCREWED @ 6" O.C. @ EDGES AND 12" O.C. @
- 15. ALL EXTERIOR DECK FRAMING SHALL BE PRESSURE TREATED.
- 16. ADHERE TO TJI-MACMILLIAN REQUIREMENTS FOR MINIMUM END BEARING @ LVL's.

DIVISION 7 INSULATION

- 1. PROVIDE INSULATION IN ACCORDANCE WITH PLANS AND SPECIFICATIONS AND AS NEEDED TO ACHIEVE THE FOLLOWING VALUES FOR COMPLETED ASSEMBLIES ACCORDING TO 2018 IECC: A. FENESTRATION: U-FACTOR = 0.30
- B. SKYLIGHT: U-FACTOR = 0.55
- C. CEILING: R-VALUE = 49
- D. EXTERIOR FRAME WALL: R-VALUE = 20 or 13+5 (Cavity + Continuous) E. MASS WALL: R-VALUE = 13/17
- F FLOOR: R-VALUE = 30
- G. CRAWL SPACE WALL: R-VALUE = 15/19
- 2. INSTALL INSULATION MATERIALS IN ACCORDANCE TO MANUFACTURER'S RECOMMENDATIONS. FILL CAVITIES COMPLETELY AND TAPE JOINTS BETWEEN BOARDS.
- 3. FILL GAPS BETWEEN JAMBS AND FRAMING WITH NON-FORMALDEHYDE FOAM FILLER.
- 4. INSULATE DUCTS AND PLUMBING PIPES SUBJECT TO SWEATING

DIVISION 8 WINDOWS & DOORS

- PROVIDE BLOCKING @ HINGES AND JAMB REINFORCING AS RECOMMENDED BY DOOR FRAME MANUFACTURER.
- 2. BI-FOLD DOORS SHALL BE IN ALIGNMENT WITH ONE ANOTHER AND PARALLEL TO THE TRACK WHEN CLOSED. PROVIDE SPACERS AS REQUIRED. BI-FOLD DOORS SHALL BE 1 3/8", 2 PANEL FOR PAINT WITH HEAVY-DUTY TRACK. TRACK TO BE CONCEALED BY 1/4 ROUND WOOD TRIM. BI-FOLD DOOR JAMBS TO BE TRIMMED OUT WITH 1x POPLAR JAMBS AND DOOR CASING AS NOTED ABOVE.
- 3. ALL INTERIOR SWING DOORS SHALL BE 1-3/4" SOLID CORE, 2-PANEL DOORS FOR PAINT FINISH.
- 4. INTERIOR DOORS SHALL BE TRIMMED WITH 1x POPLAR JAMBS AND DOOR CASING AND PLINTH BLOCKS AS SPECIFIED
- 5. PROVIDE THRESHOLDS FOR EXTERIOR DOOR, NEOPRENE WEATHER STRIPPING, TYPICAL AT HEADS, JAMBS AND SILLS.

DOOR HARDWARE

- PROVIDE HARDWARE COMPATIBLE WITH DOOR THICKNESS, WEIGHT AND MATERIAL.
- 2. ALL DOORS SHALL HAVE 1-1/2" PAIR HINGES FOR SIZES UP TO 3'x7'.
- 3. LATCH BOLTS SHALL HAVE 5/8" TTHROW AT ALL LATCH SETS AND LOCKSETS.
- 4. EXTERIOR DOOR HARDWARE SHALL BE LEVER TYPE, STANDARD GRADE, CYLINDER LATCH BY BALDWIN (OR OWNER
- 5. INTERIOR DOOR HARDWARE SHALL BE LEVER TYPE, RESIDENTIAL GRADE, CYLINDER LATCH BY SCHLAGE (OR EQUAL).

DIVISION 9 FINISHES

FINISHES GENERAL NOTES

- 1. ALL FINISHES SHALL BE CLASS 1, 0-25 FLAME SPREAD RATING.
- 2. CLEAN AND PREPARE PRIME SURFACES IN COMPLIANCE WITH THE FINISH MATERIAL'S MANUFACTURER'S INSTRUCTIONS.
- 3. PROVIDE A MINIMUM OF ONE PRIME COAT AND ONE FINISH COAT FOR ALL PAINTED SURFACES.
- 4. DO NOT PAINT OVER LABELS, FACTORY FINISH METAL TRIM, DOOR HARDWARE, ELECTRICAL FIXTURES, EQUIPMENT, SPRINKLER HEADS, OR MILLWORK ASSEMBLIES.
- 5. PROVIDE TOUCH-UP PAINTING TO MATCH EXISTING PAINT COLORS AND TEXTURES WHERE INFILL OR PATCH AND REPAIR WORK IS REQUIRED AT EXISTING CONSTRUCTION.
- 6. ALL DRYWALL SURFACES SHALL BE PAINTED EXCEPT WHERE CERAMIC TILE IS SPECIFIED.
- 7. PROVIDE CORNER AND J-BEADS AT ALL TERMINATIONS AND CORNERS OF GYPSUM BOARD. 8. ALL DIMENSIONS TO FACE OF DRYWALL.
- 9. GENERAL CONTRCTOR SHALL COORDINATE STAIR CONSTRUCTION WITH FINAL FLOOR FINISH SELECTIONS TO OBTAIN
- PROPER HEIGHTS. 10. PROVIDE CEMENTITIOUS BACKER BOARD AT ALL TILE LOCATIONS AND WET SURFACES.
- 11. PROVIDE THRESHOLDS AS REQUIRED OR AS NOTED AT ALL FLOOR MATERIAL TRANSITIONS. PROVIDE BLOCKING AS REQUIRED BY DRAWINGS. COORDINATE WITH OTHER TRADES FOR SIZE AND LOCATION.

GYPSUM BOARD

- 1. PROVIDE ALL LABOR AND MATERIALS NECESSARY TO COMPLETE THE WORK IN ACCORDANCE WITH ALL CODE AND
- GOVERNING ORDINANCES. 2. ALL DRYWALL SHAL BE MINIMUM 5/8" THICK UNO.
- 3. COMPLY WITH THE RECOMMENDATIONS OF THE GYPSUM CONSTRUCTION HANDBOOK PUBLISHED BY THE USG CORPORATION, LATEST EDITION, FOR METHODS AND INSTALLATION OF METAL FRAMING AND GYPSUM DRYWALL
- 4. PROVIDE METAL CORNER REINFORCEMENT TRIM AT ALL OUTSIDE CORNER CONDITIONS. TRIM SHALL BE USG-DUR-A-BED OR EQUAL.
- 5. PROVIDE CONTINUOUS BED OF SOUND SEALANT AT TOP AND BOTTOM OF ALL SOUND RATED INSULATED PARTITIONSAND AT PARTITION PENETRATIONS, INCLUDING ELECTRICAL OPENINGS.
- 6. COORDINATE WITH OTHER TRADES FOR INSTALLATION OF WOOD BLOCKING. 7. PROVIDE GYPSUM BOARD EDGE TRIM, USG-801-A AT EXPOSED EDGES OF ALL NON-FULL HEIGHT GYPSUM DRYWALL
- PARTITIONS EXCEPT WHERE TOP OF WALL HAS DRYWALL FINISH. 8. FINISH DRYWALL JOINTS AND CONCEAL ALL FASTENERS USING USG 'PERF-A-TAPE' SYSTEM OR EQUAL. APPLY
- FINISHING COMPOUND, SAND AND REPEAT AS NEEDED TO COMPLETELY CONCEAL ALL JOINTS AND FASTENERS. 9. PROVIDE ADDITIONAL SUPPORTS, BRACKETS, TIES, AND FRAMING AS RECOMMENDED OR REQUIRED FOR PROPER INSTALLATION AND RIGID ASSEMBLY.
- 10. CLEAN ALL SURFACES AND LEAVE READY FOR PAINT. REMOVE ALL EXCESS MATERIALS AND DEBRIS FROM SITE.
- 11. ALL DRYWALL USED ON WALLS IN THE TOILET ROOMS SHALL BE WATER RESISTANT RATED. 12. DRYWALL SUPPORT SYSTEMS AND FRAMING SHALL BE OF SUFFICIENT CAPACITY AND RIGIDITY TO SUPPORT THE
- ASSEMBLY WITH A MAXIMUM DEFLEXION OF L/240 WHERE 'L' REPRESENTS THE LENGTH OF THE SPAN. DEFLECTION LIMIT INCLUDES LIVE LOADS AND DEAD LOADS SIMULTANEOUSLY IMPOSED.


- PREPARE SUBSTRATES AS REQUIRED TO RECEIVE PAINT. PATCH ALL NAIL HOLES, REPAIR DEFECTS.
- 2. PRIME ALL EXPOSED GYPSUM BOARD SURFACES. SPRAYED SURFACES SHALL BE ROLLED OUT WITH A MEDIUM NAP
- 3. INTERIOR MILLWORK TO BE FOR PAINT SHAL BE PRIMED WITH OIL BASED PRIMER. FINISH PAINT SHALL BE TWO COATS
- HIGH GLOSS ALKYD ENAMEL. (SAND BETWEEN COATINGS). 4. CEILINGS (SLOPED & FLAT) SHALL BE PAINTED WITH TWO COATS CEILING FLAT LATEX PAINT-WHITE.

5. WALLS SHALL BE PAINTED WITH TWO COATS EGSHELL ENAMEL.

LAYOUT TILE SUCH THAT TILE IS NOT LESS THAN 1/2 THE WIDTH OF THE TILE.

- **CERAMIC TILE** CERAMIC TILE FOR FLOORS SHALL BE 12"x 12" x 3/8" FLOOR TILE UNLESS OTHERWISE NOTED. ORDER SELECTION SHALL PREVAIL. INSPECT SUBSTRATE PRIOR TO INSTALLATION REPAIR ANY AND ALL DEFECTS. LEVEL NEW CONCRETE SLAB WITH APPROPRIATE LEVELING MATERIAL. SET TILES WITH LATEX THINSET BEDDING COMPOUND.
- WALL TILES SHALL BE INSTALLED ONLY ON CEMENTITIOUS BACKER BOARD UNITS (durock) THAT IS LEVEL AND FREE OF DEBRIS, WITH APPROPRIATE LATEX THINSET SETTING MATERIAL. GROUT SHALL BE UNSANDED TYPE FOR GROUT JOINTS LESS THAN 1/8" AND SANDED FOR JOINTS 1/8" AND LARGER.

ce. Interior Rehak y New Partitions, y Systems, New cony per Plans. s 60540 Residence including Plumbing sck & Balccerville Illinois le Family I Addition Panical & F Rear Dec t 2-Unit to Sing / 2-Story Fram Electrical, Mec System & Nev 223 Center \$ Sonvert & New New El Roof S




7501 BROWN AVE., SUITE / FOREST PARK, IL 60130


rtepavčević@aol.com


DRAFTPERSON: APPROVED: PREPARED FOR: OWNER LOCATION: 223 Center Street Naperville, IL 60540 JOB NUMBER: 223CS-07042023

PROJECT ARCHITECT:


SHEET No.: SHEET Name: Specifications

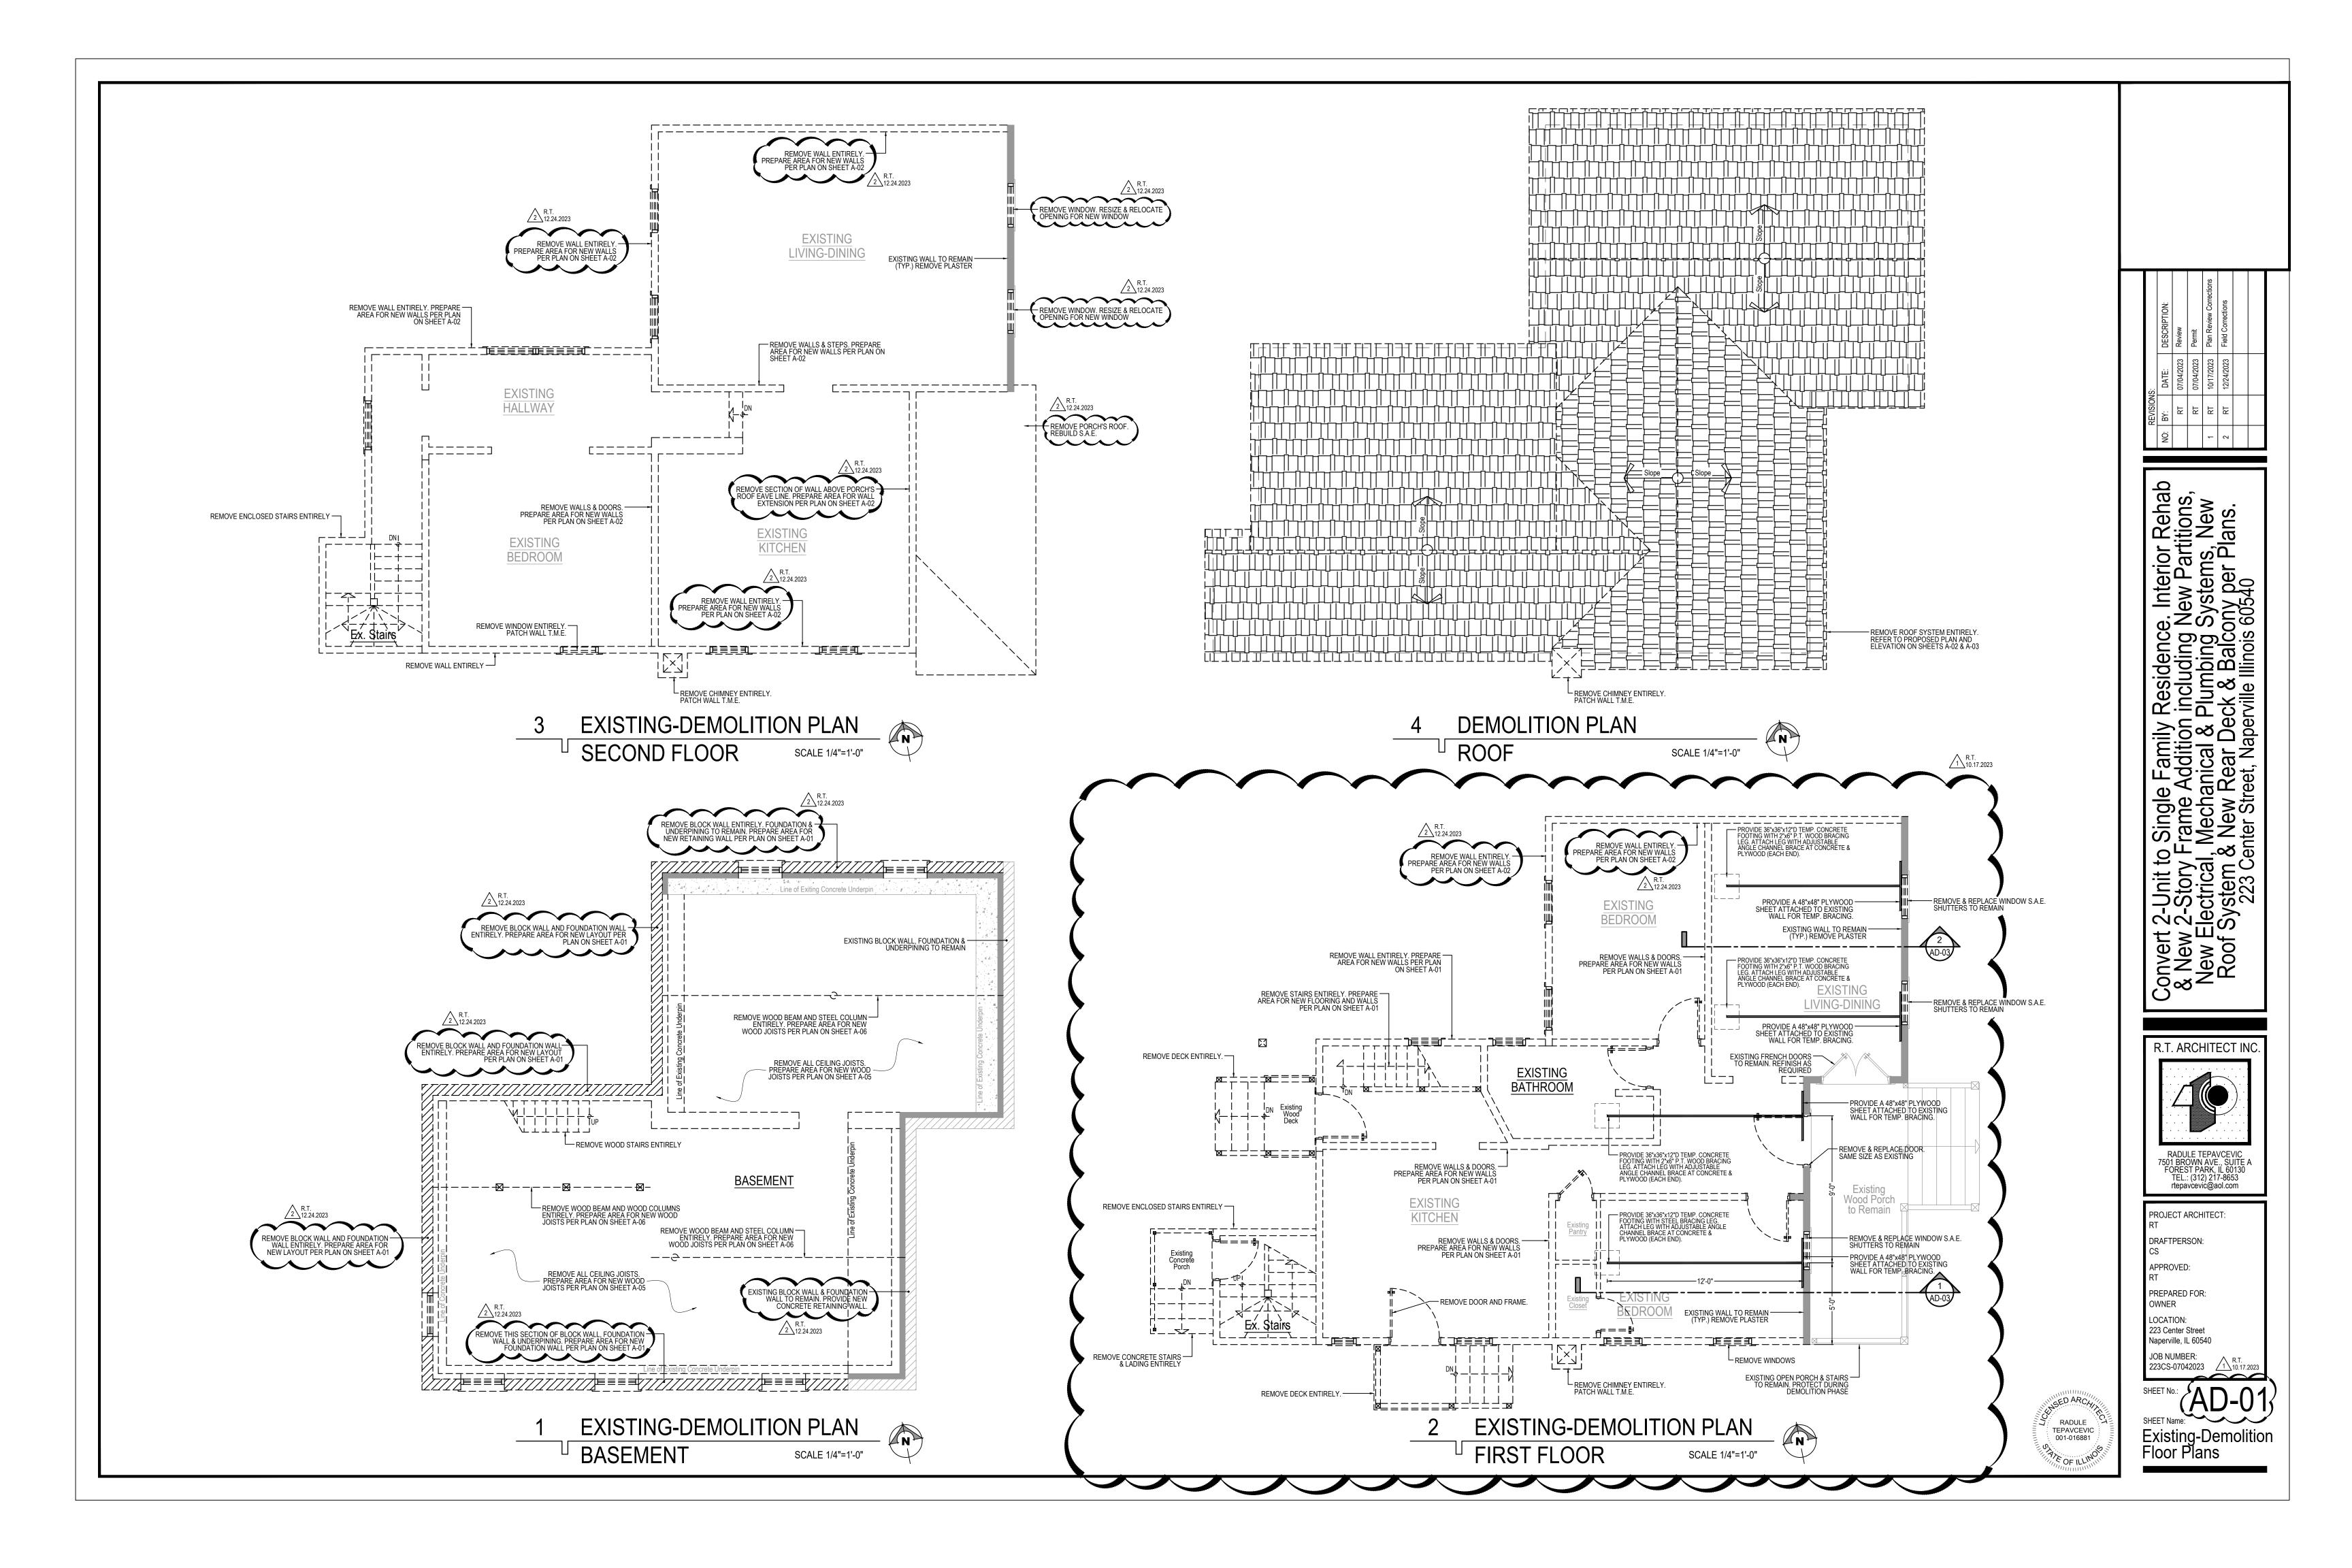

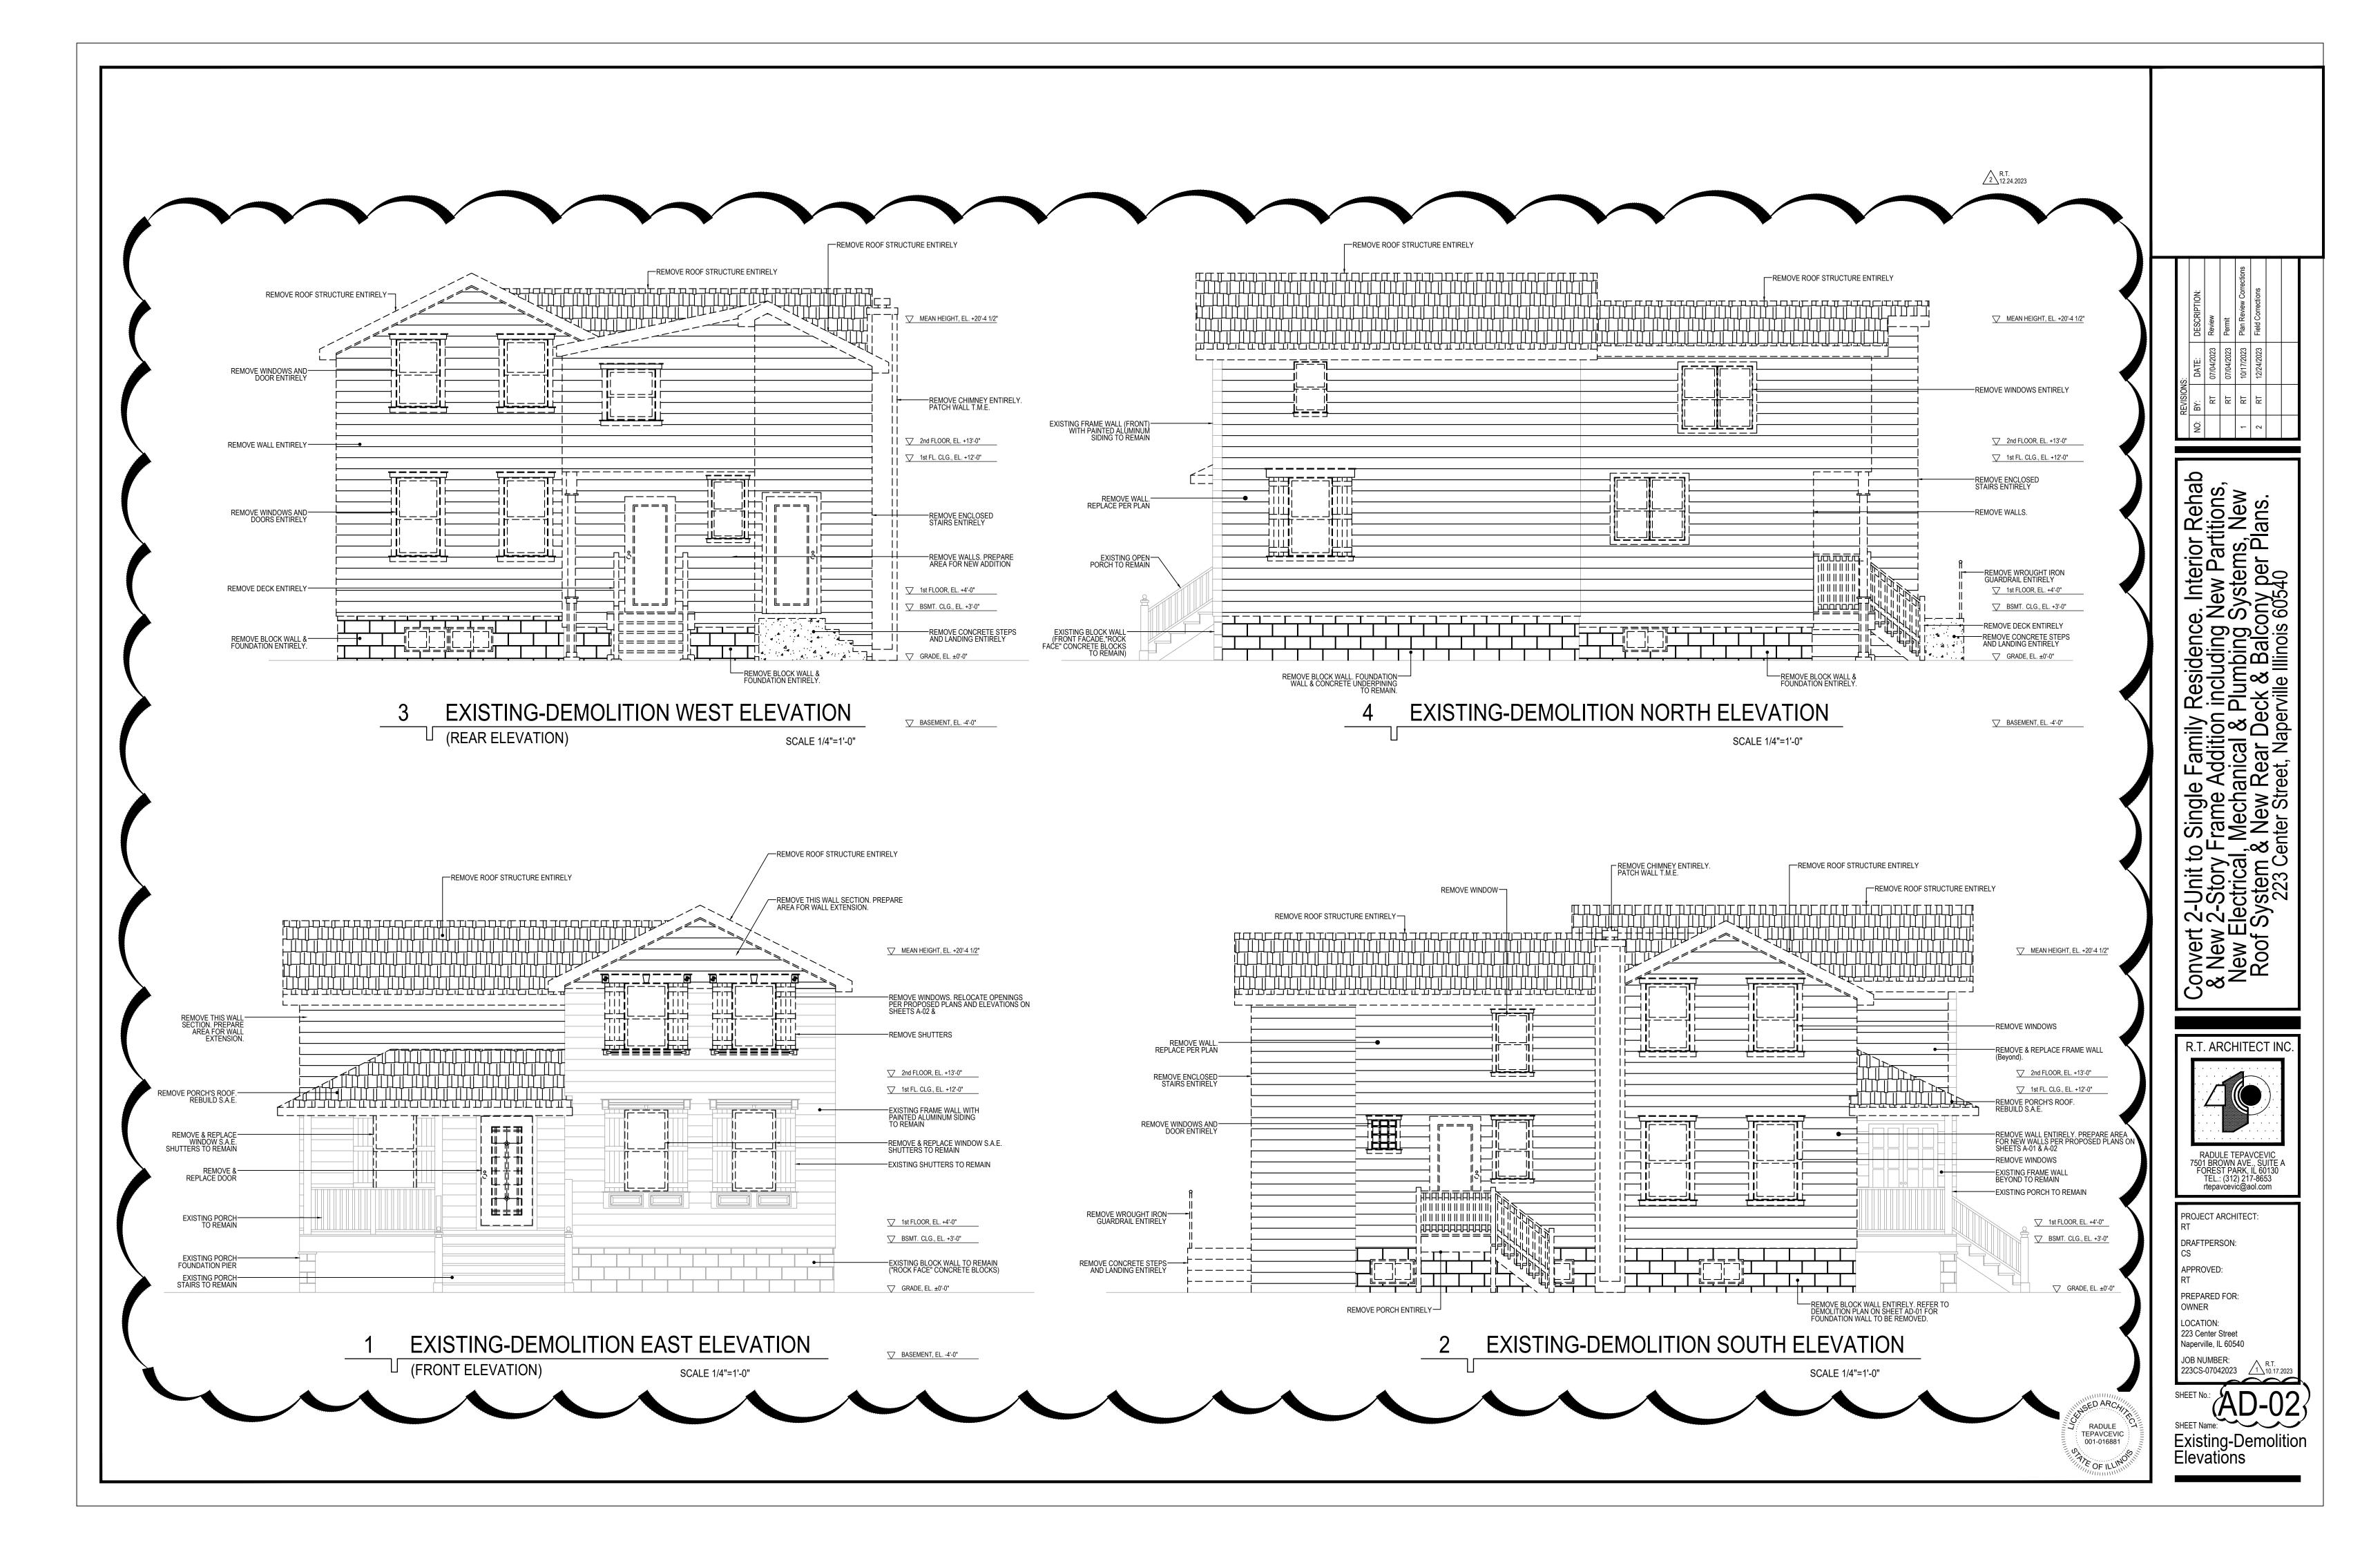

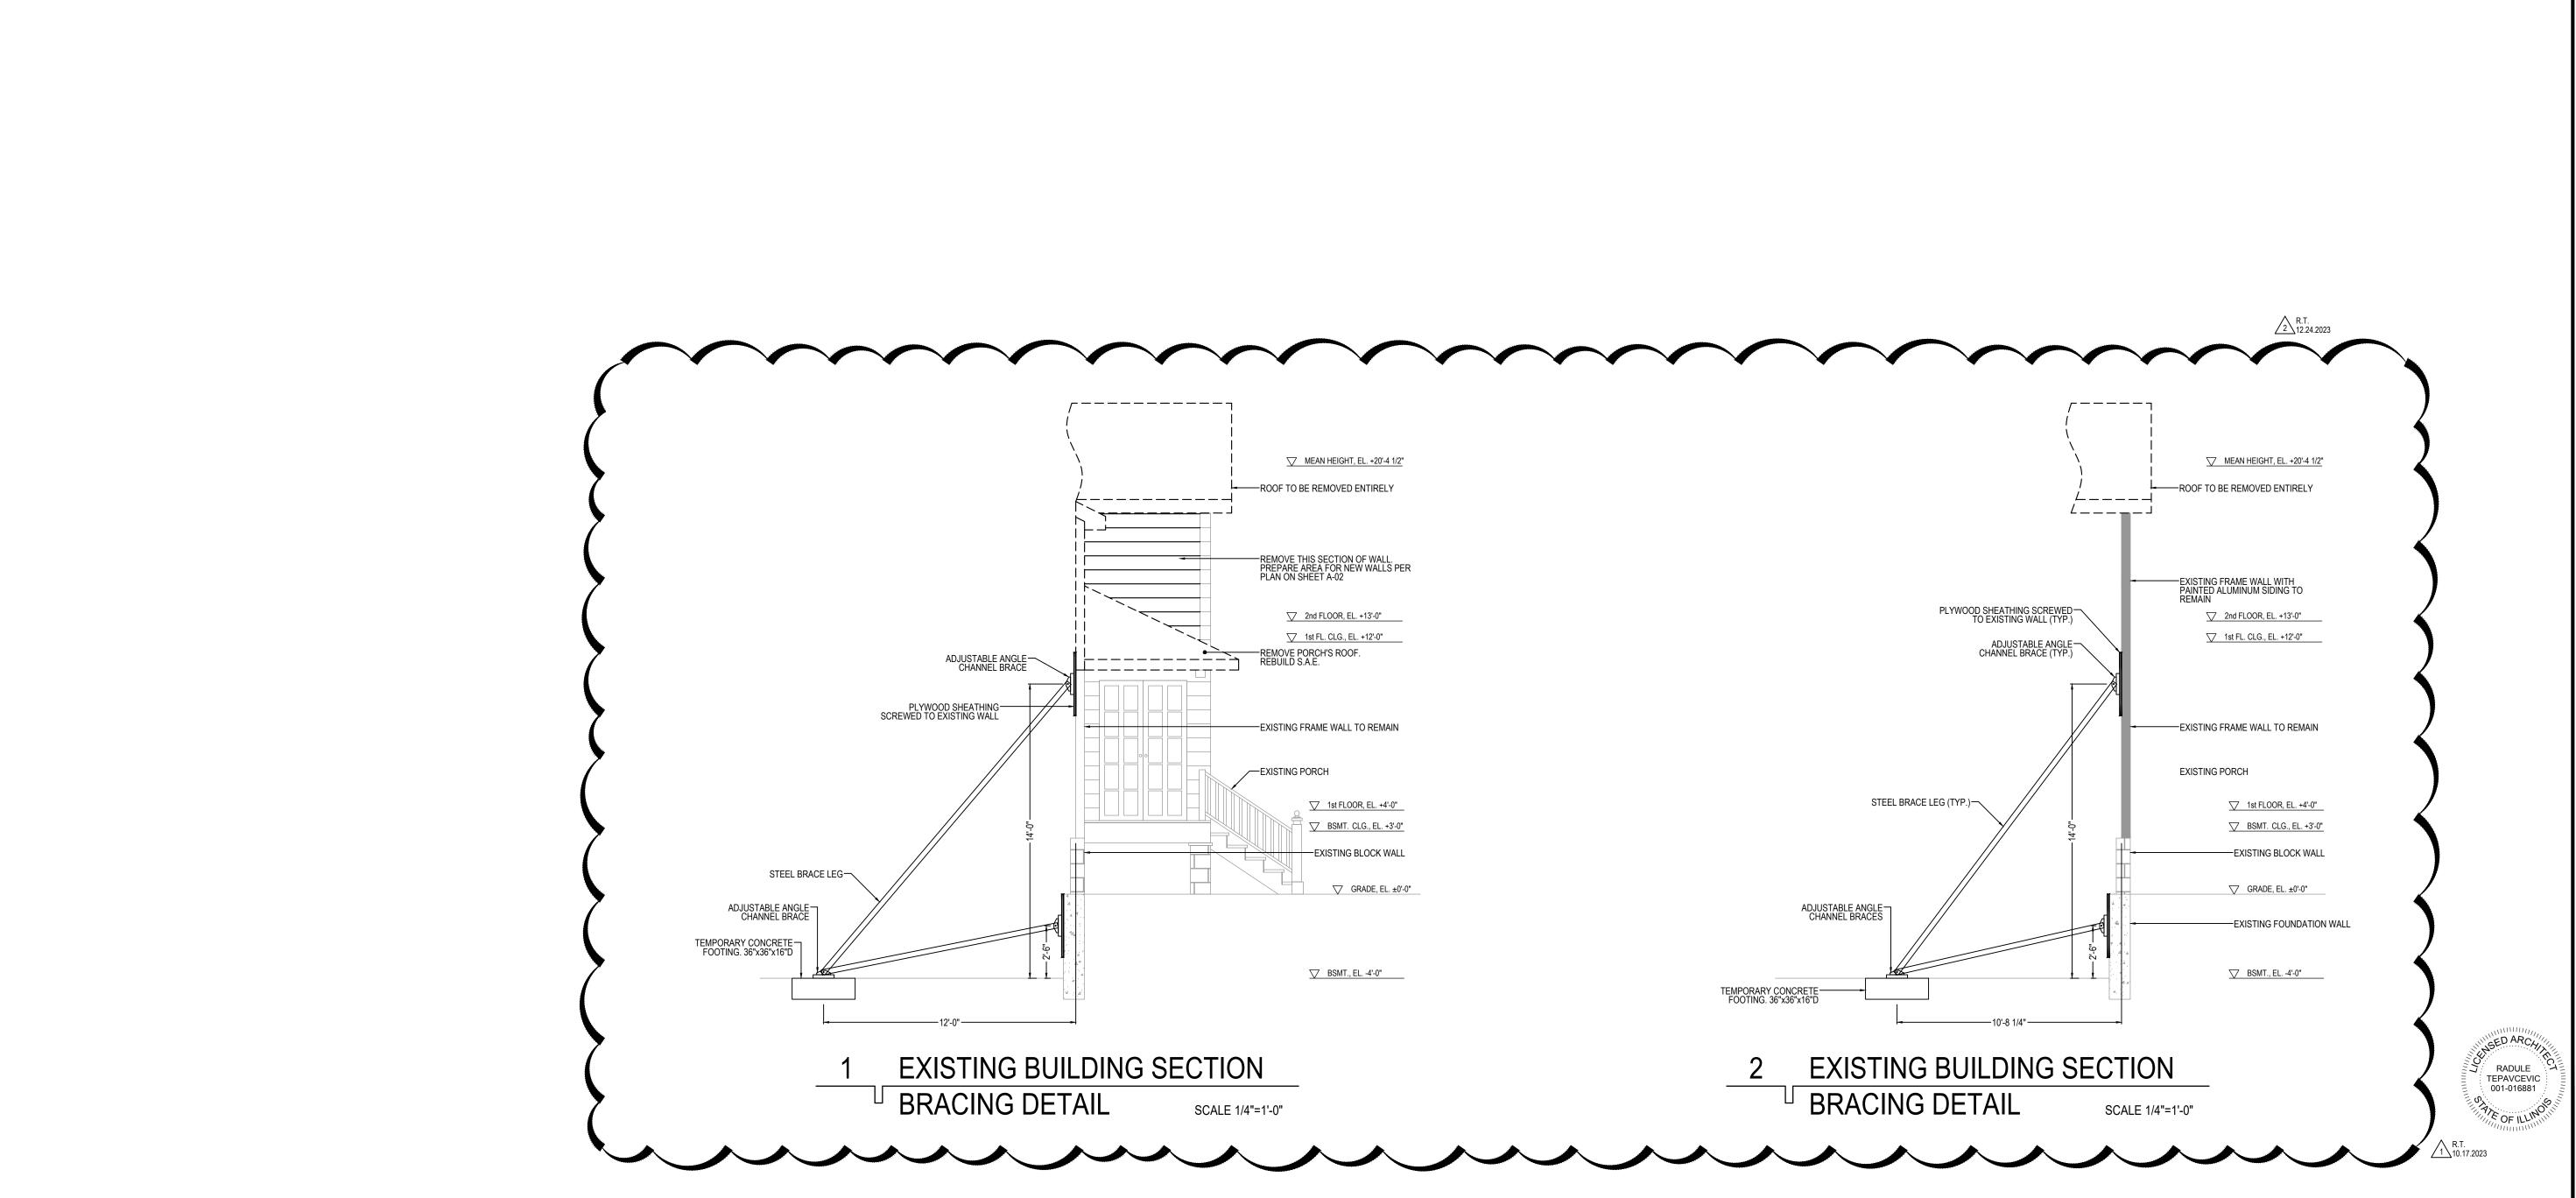





PROJECT ARCHITECT:
RT

DRAFTPERSON:
CS

APPROVED:
RT

PREPARED FOR:
OWNER


LOCATION:
223 Center Street
Naperville, IL 60540


JOB NUMBER:
223CS-07042023


SHEET No.:

AD-03
SHEET Name:

Braced Wall Detail

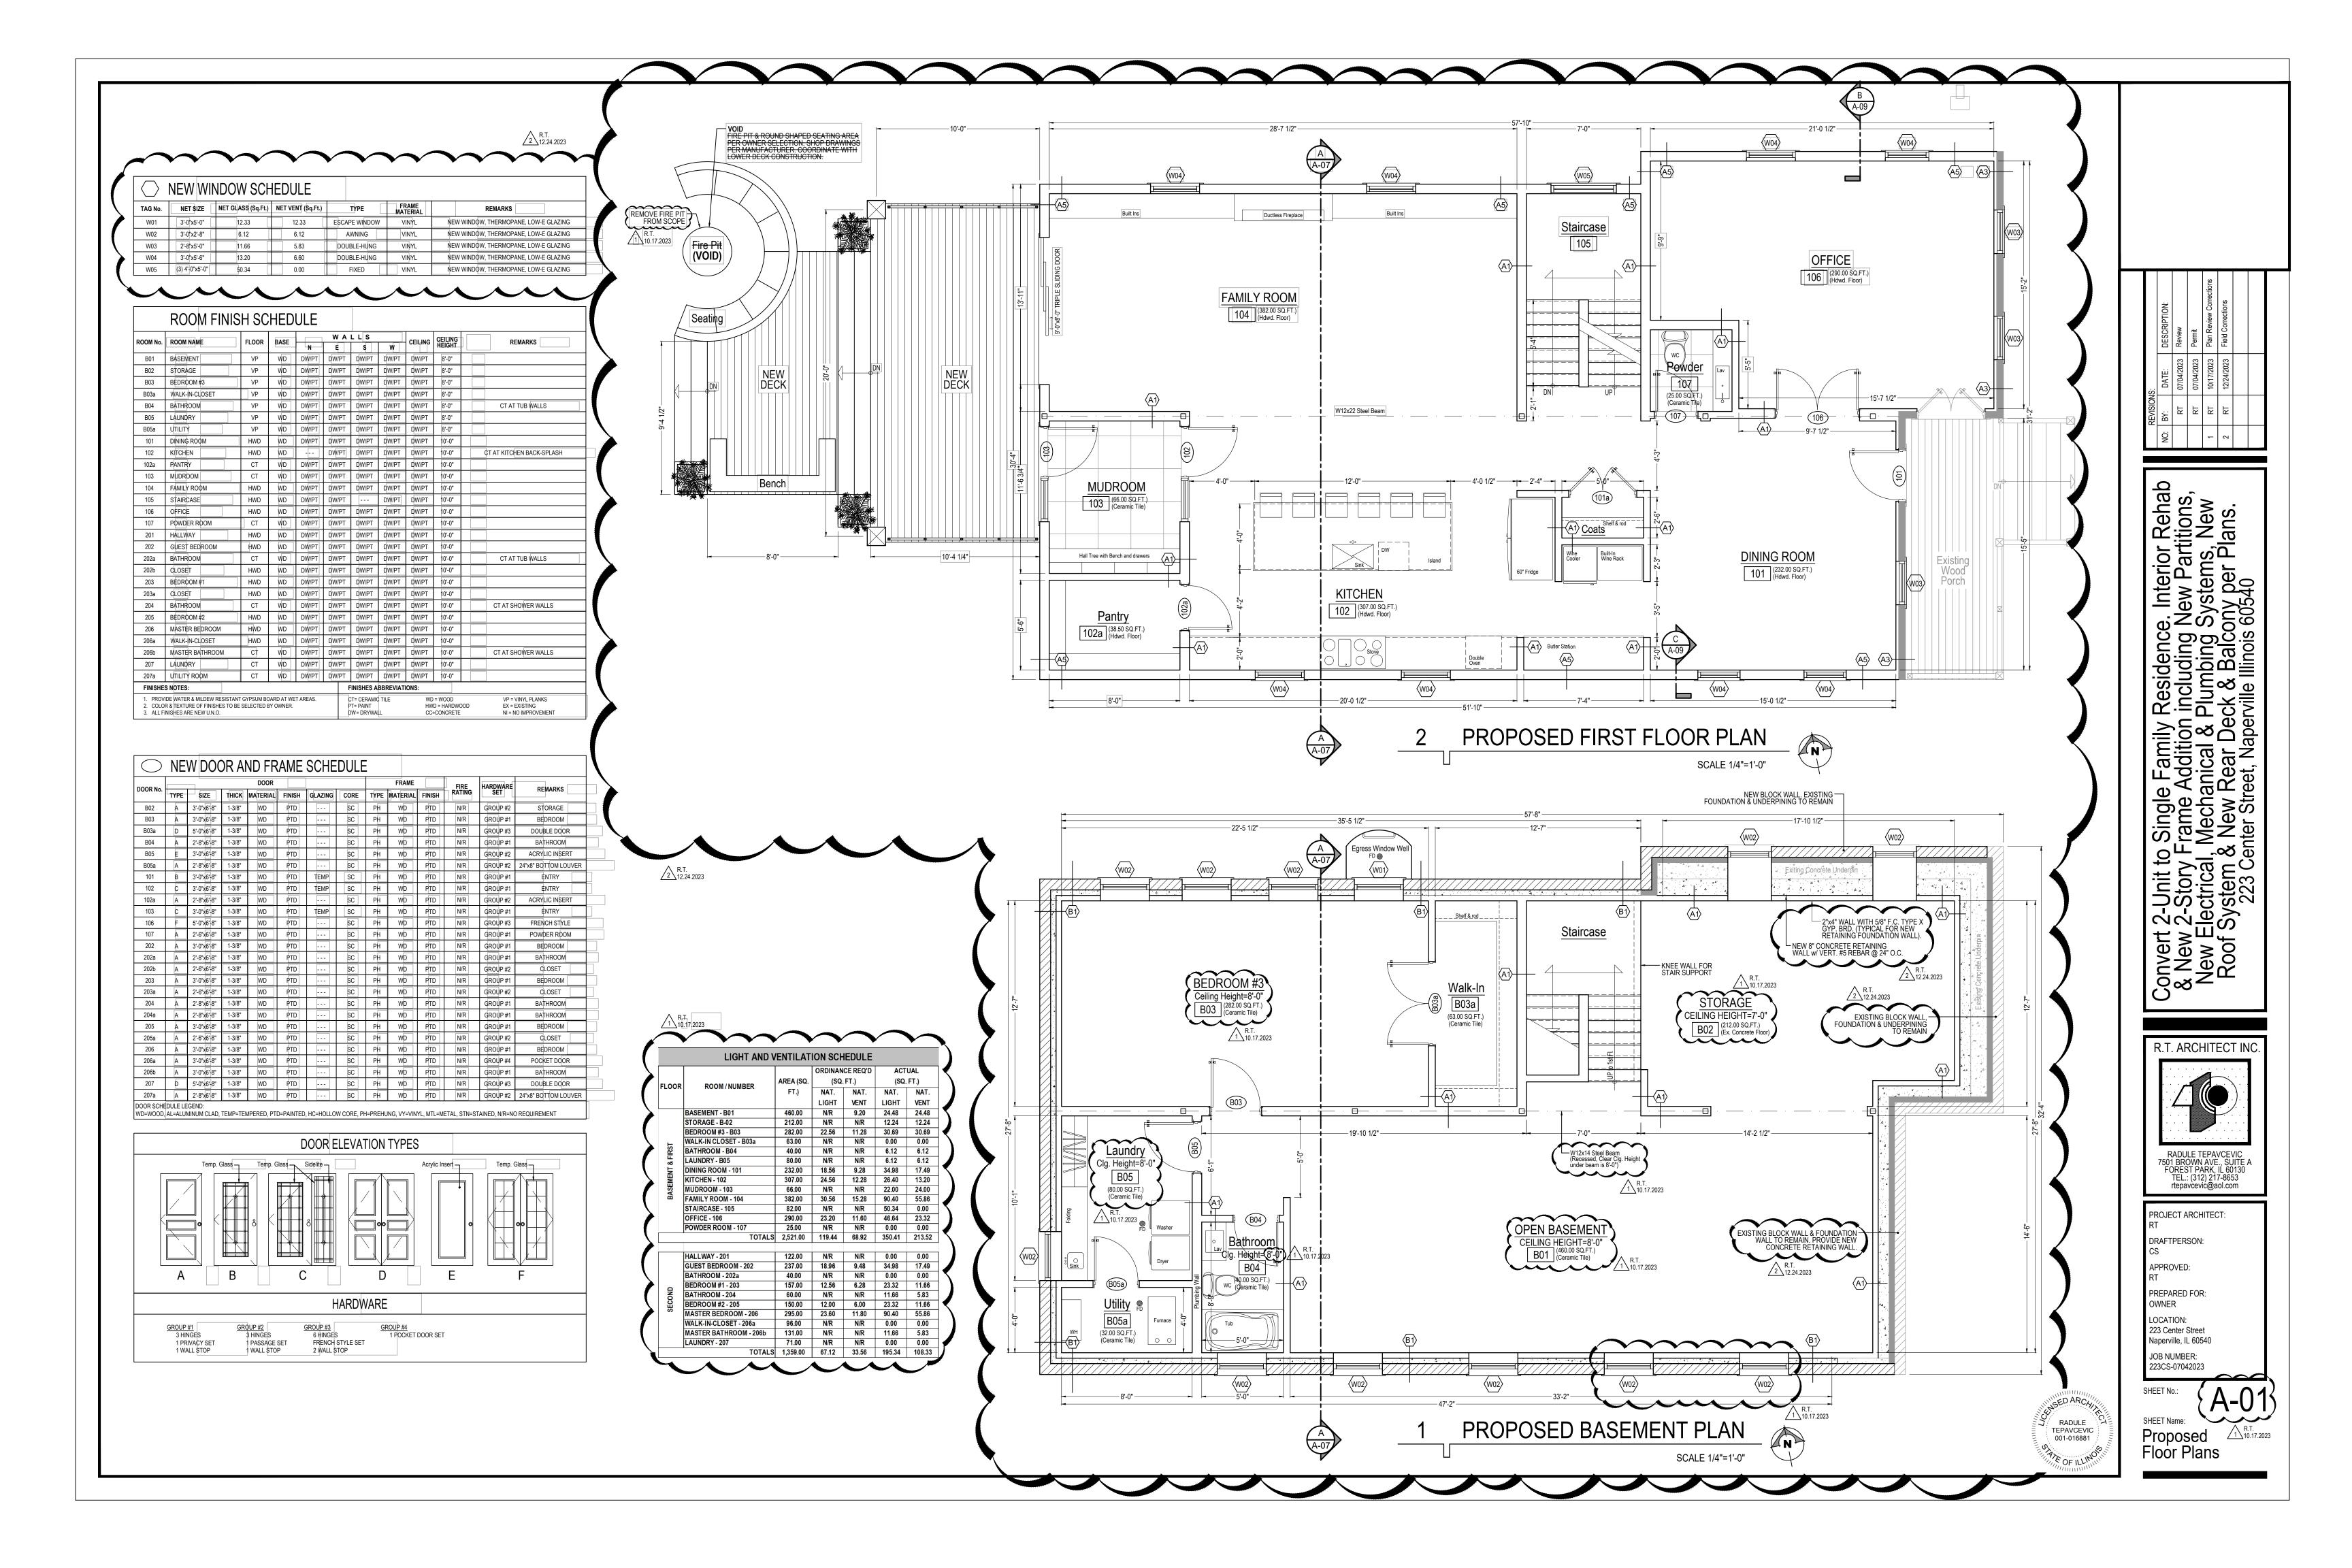

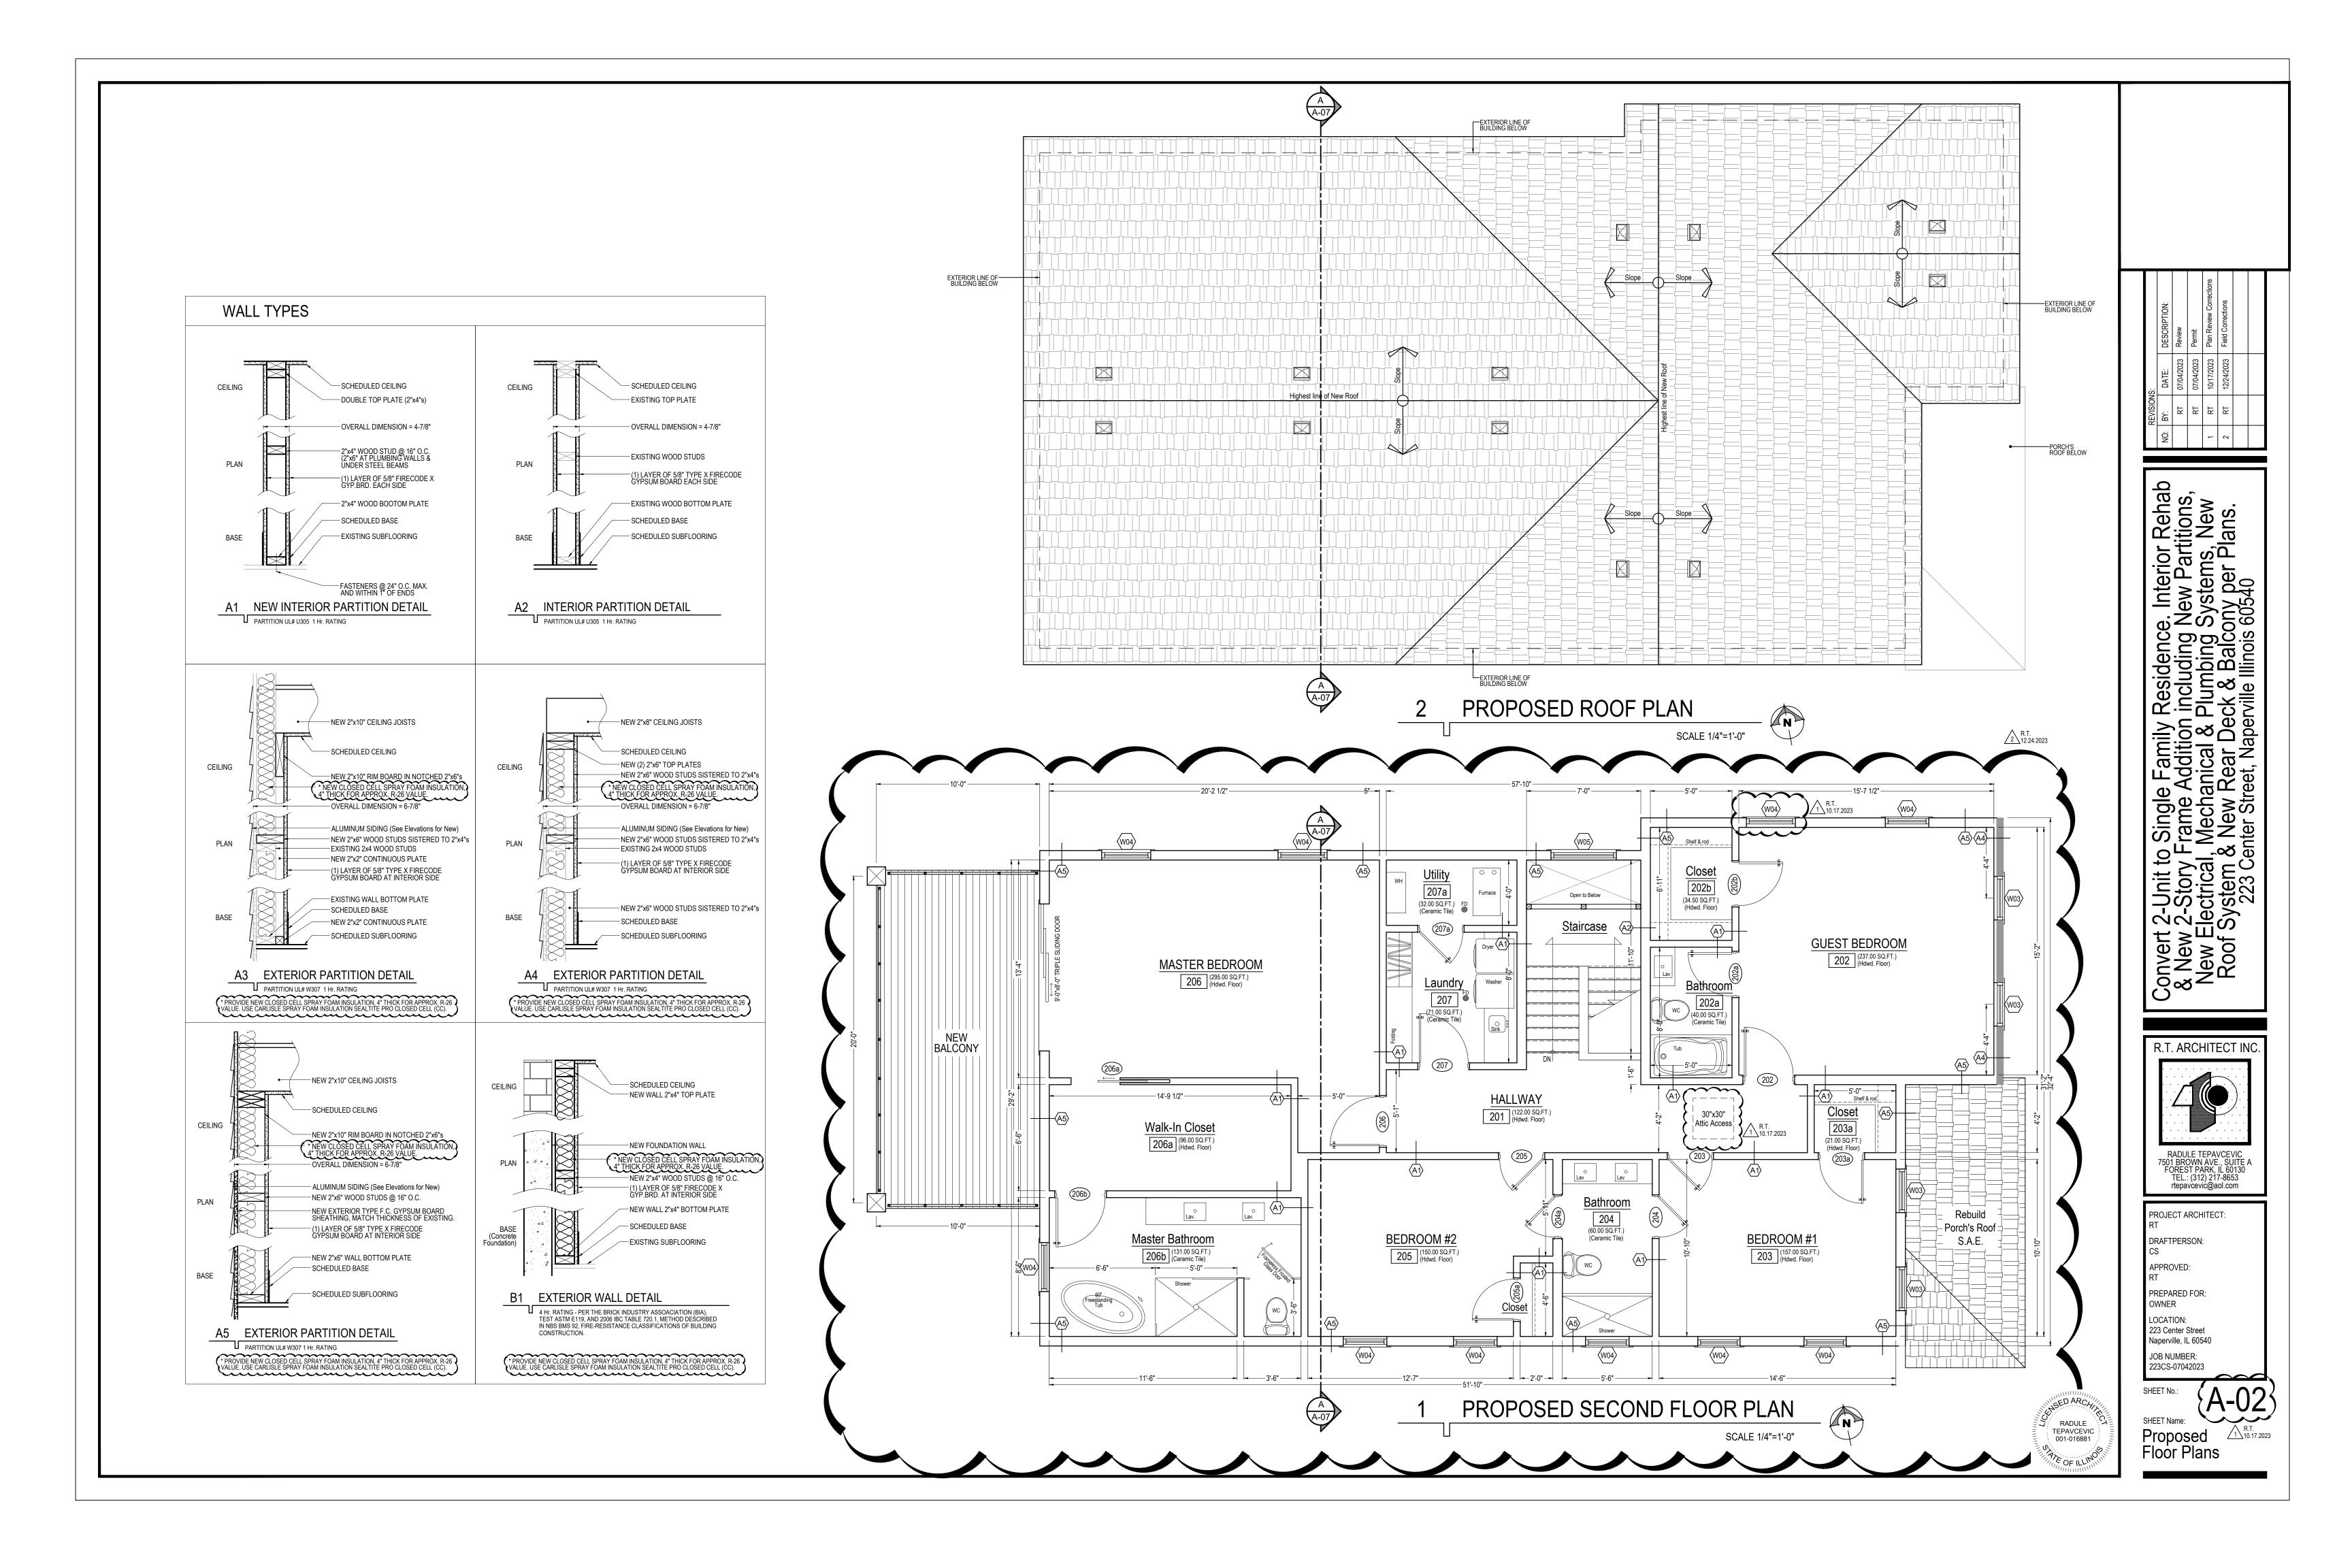

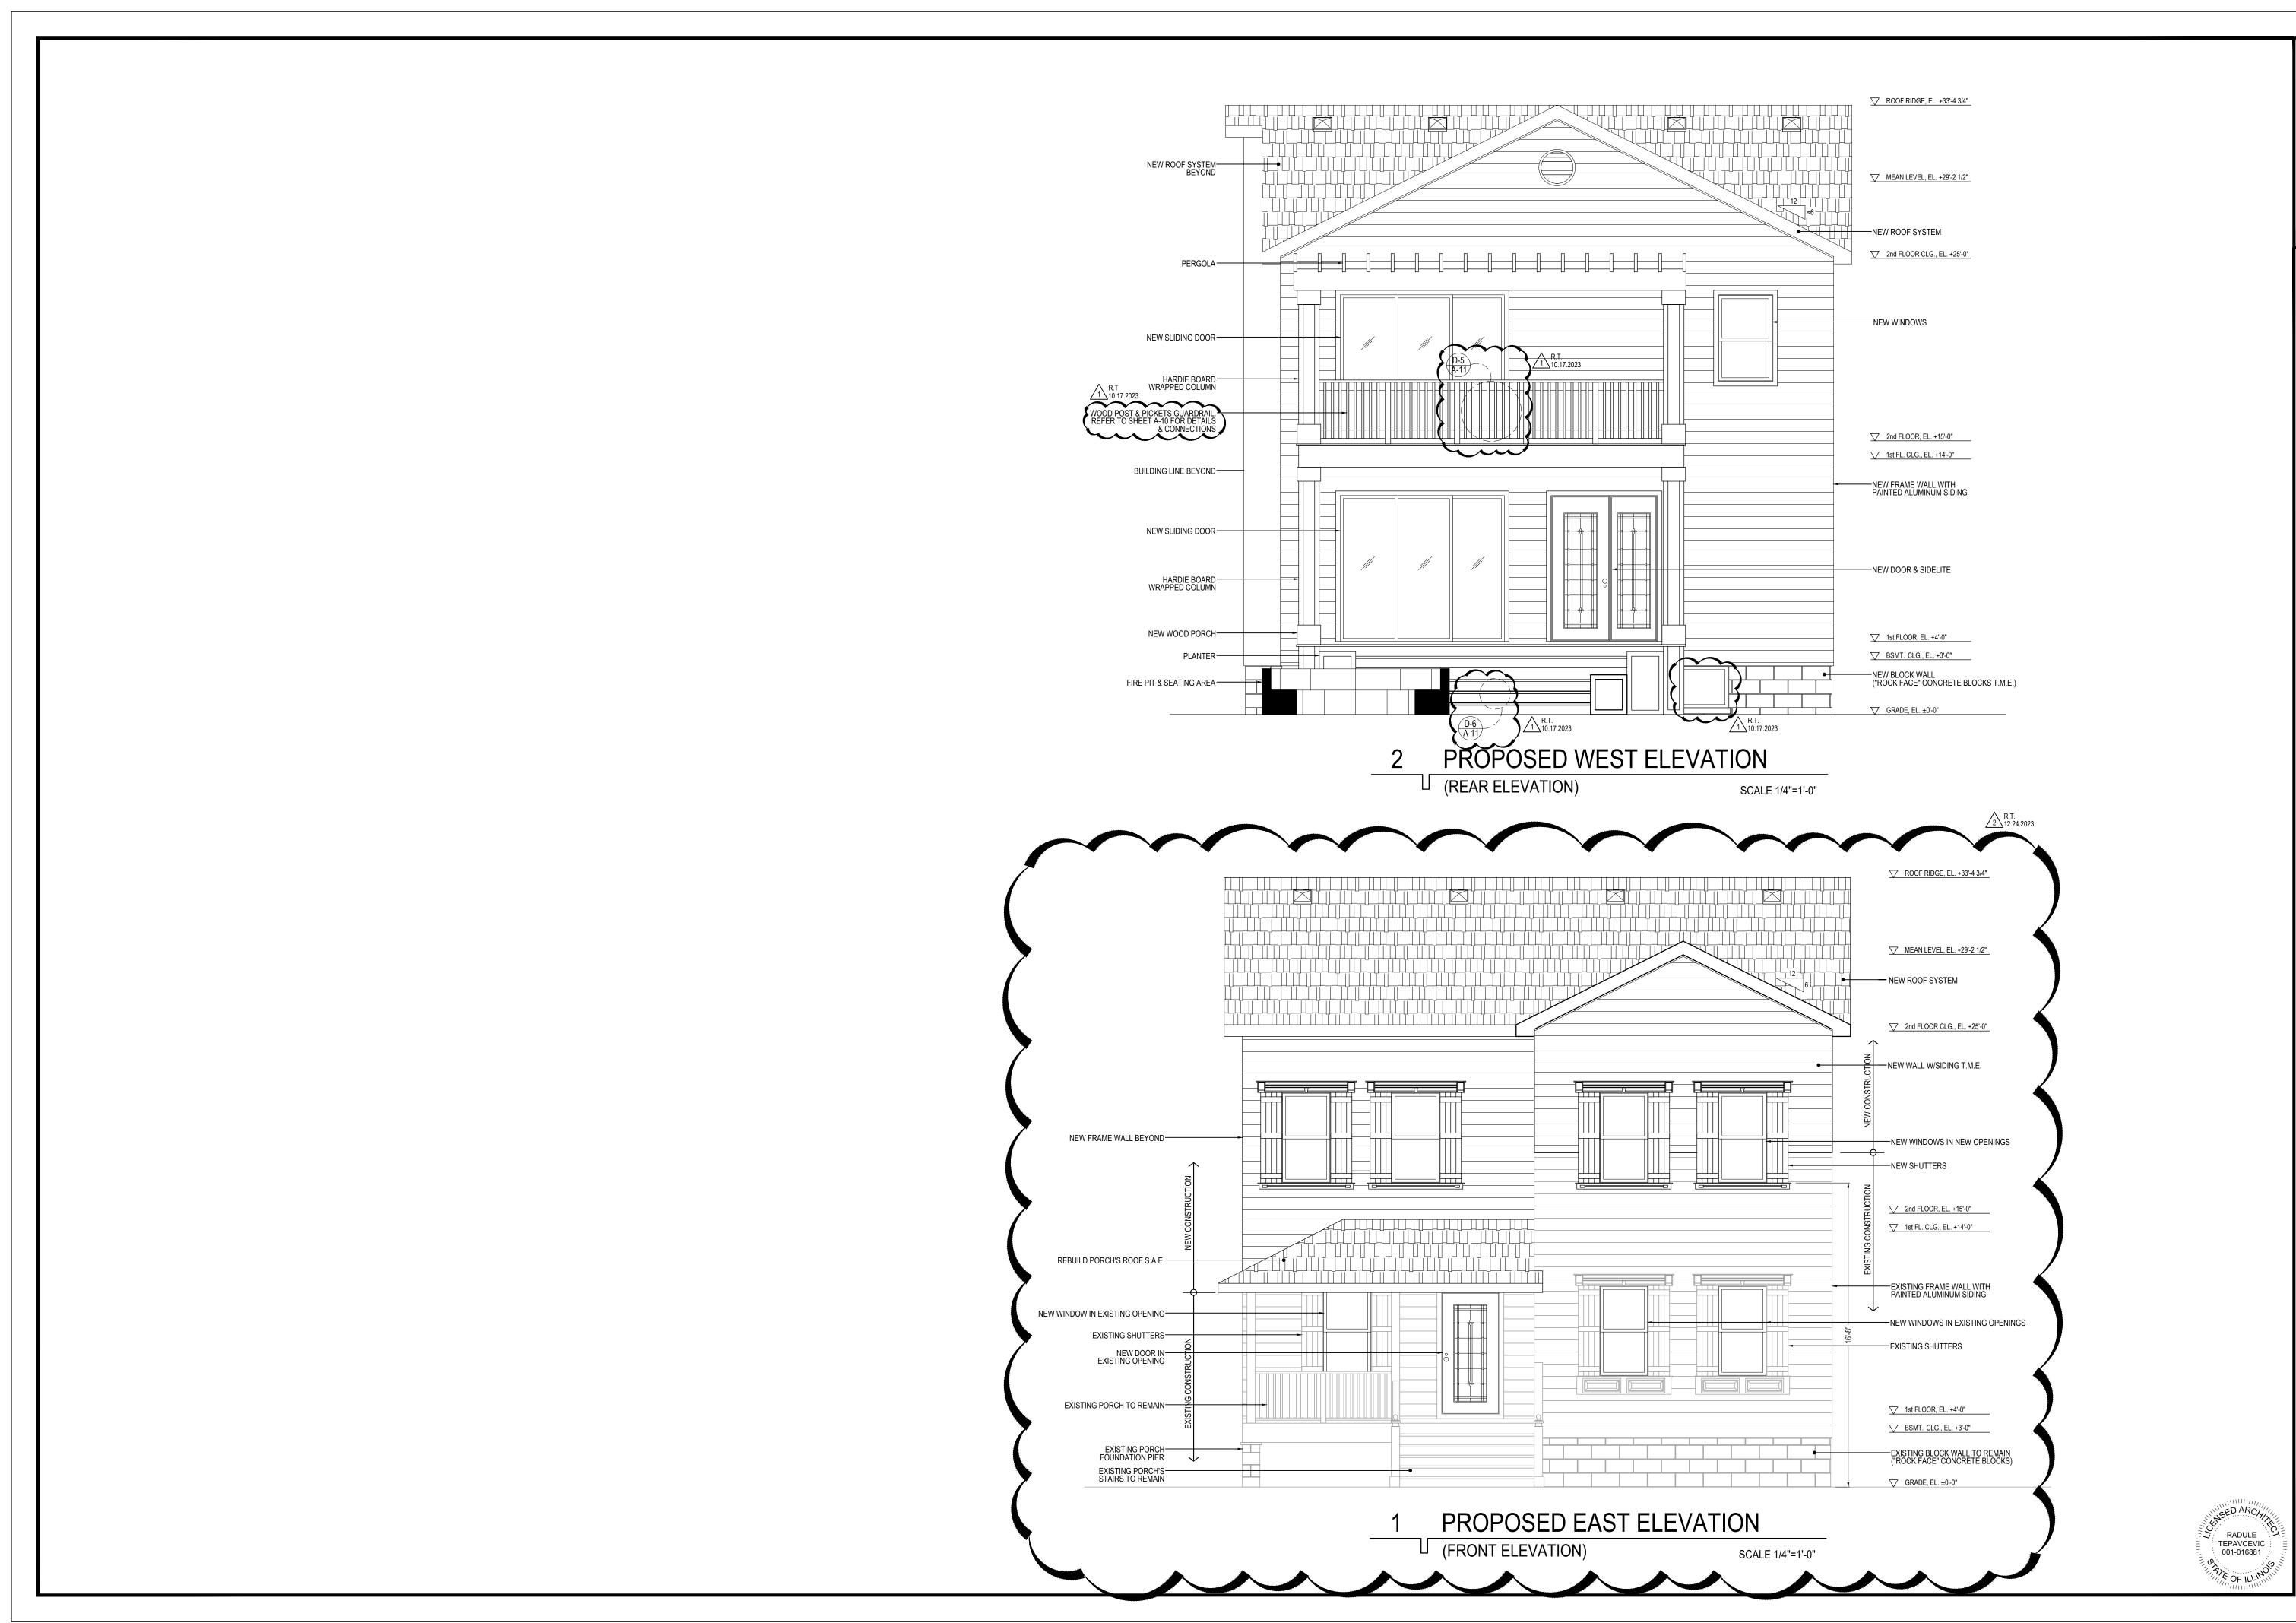





PROJECT ARCHITECT:


DRAFTPERSON:


APPROVED: PREPARED FOR:

OWNER LOCATION: 223 Center Street Naperville, IL 60540 JOB NUMBER:

223CS-07042023

Proposed Elevations

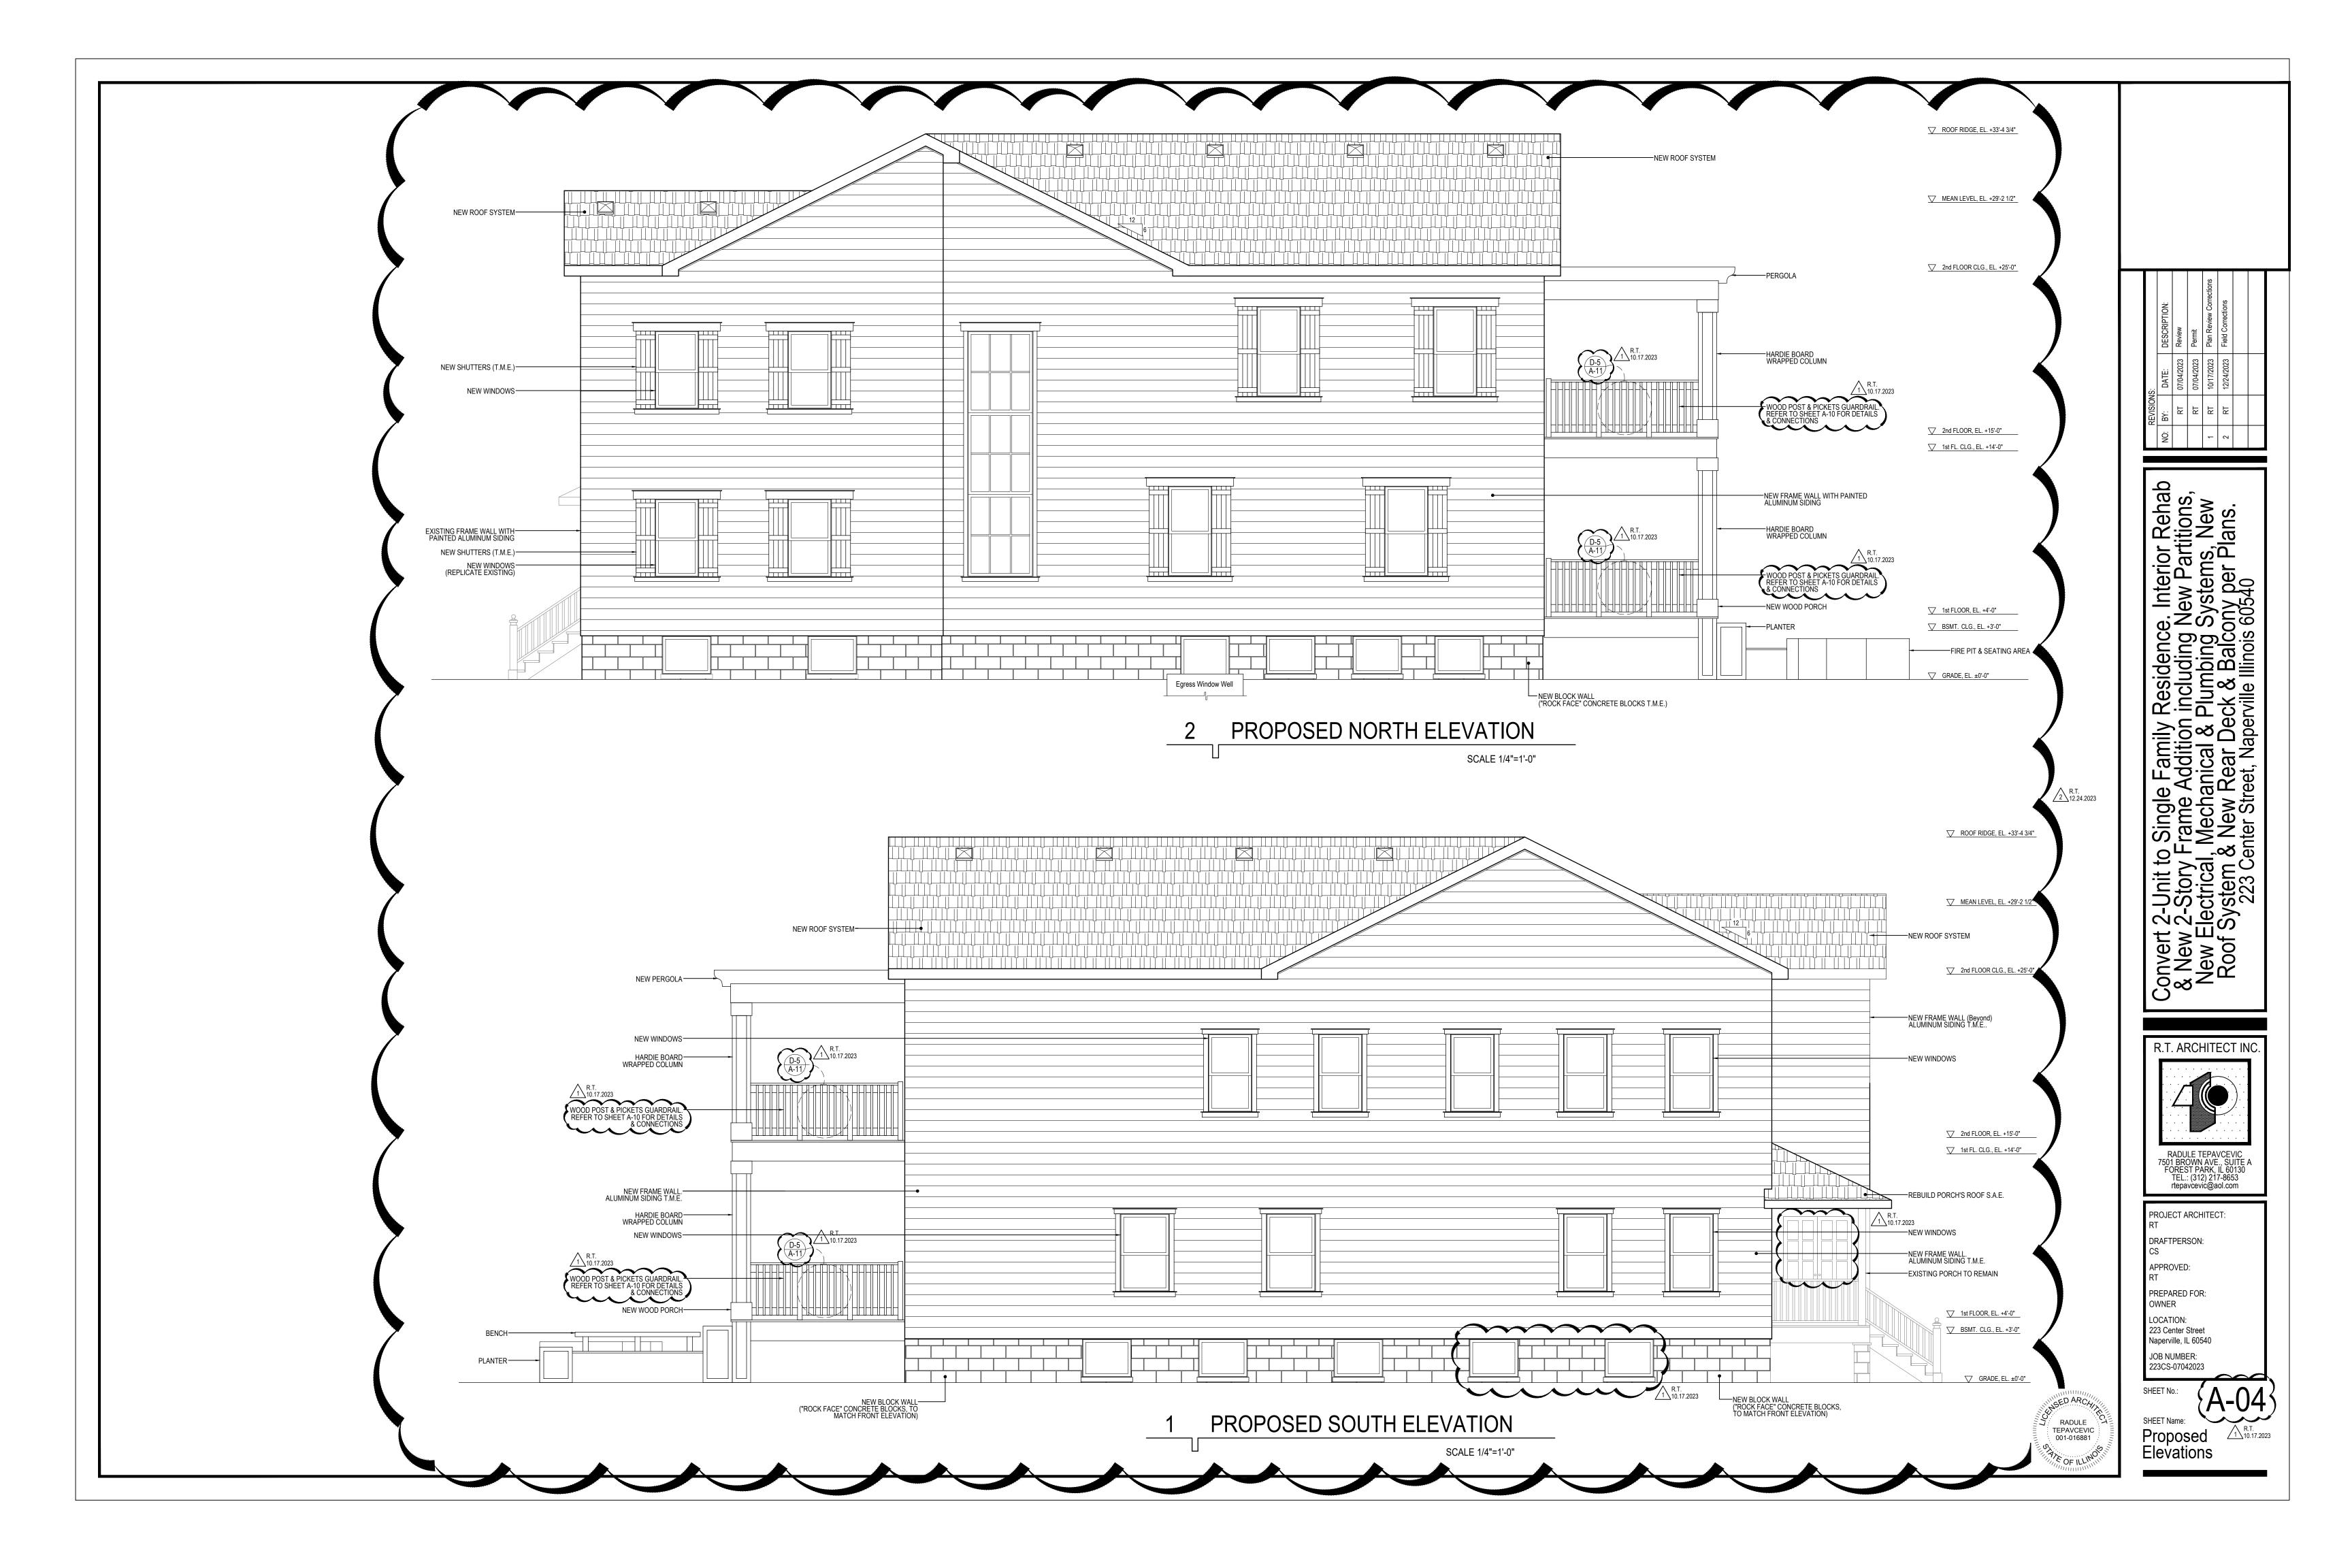

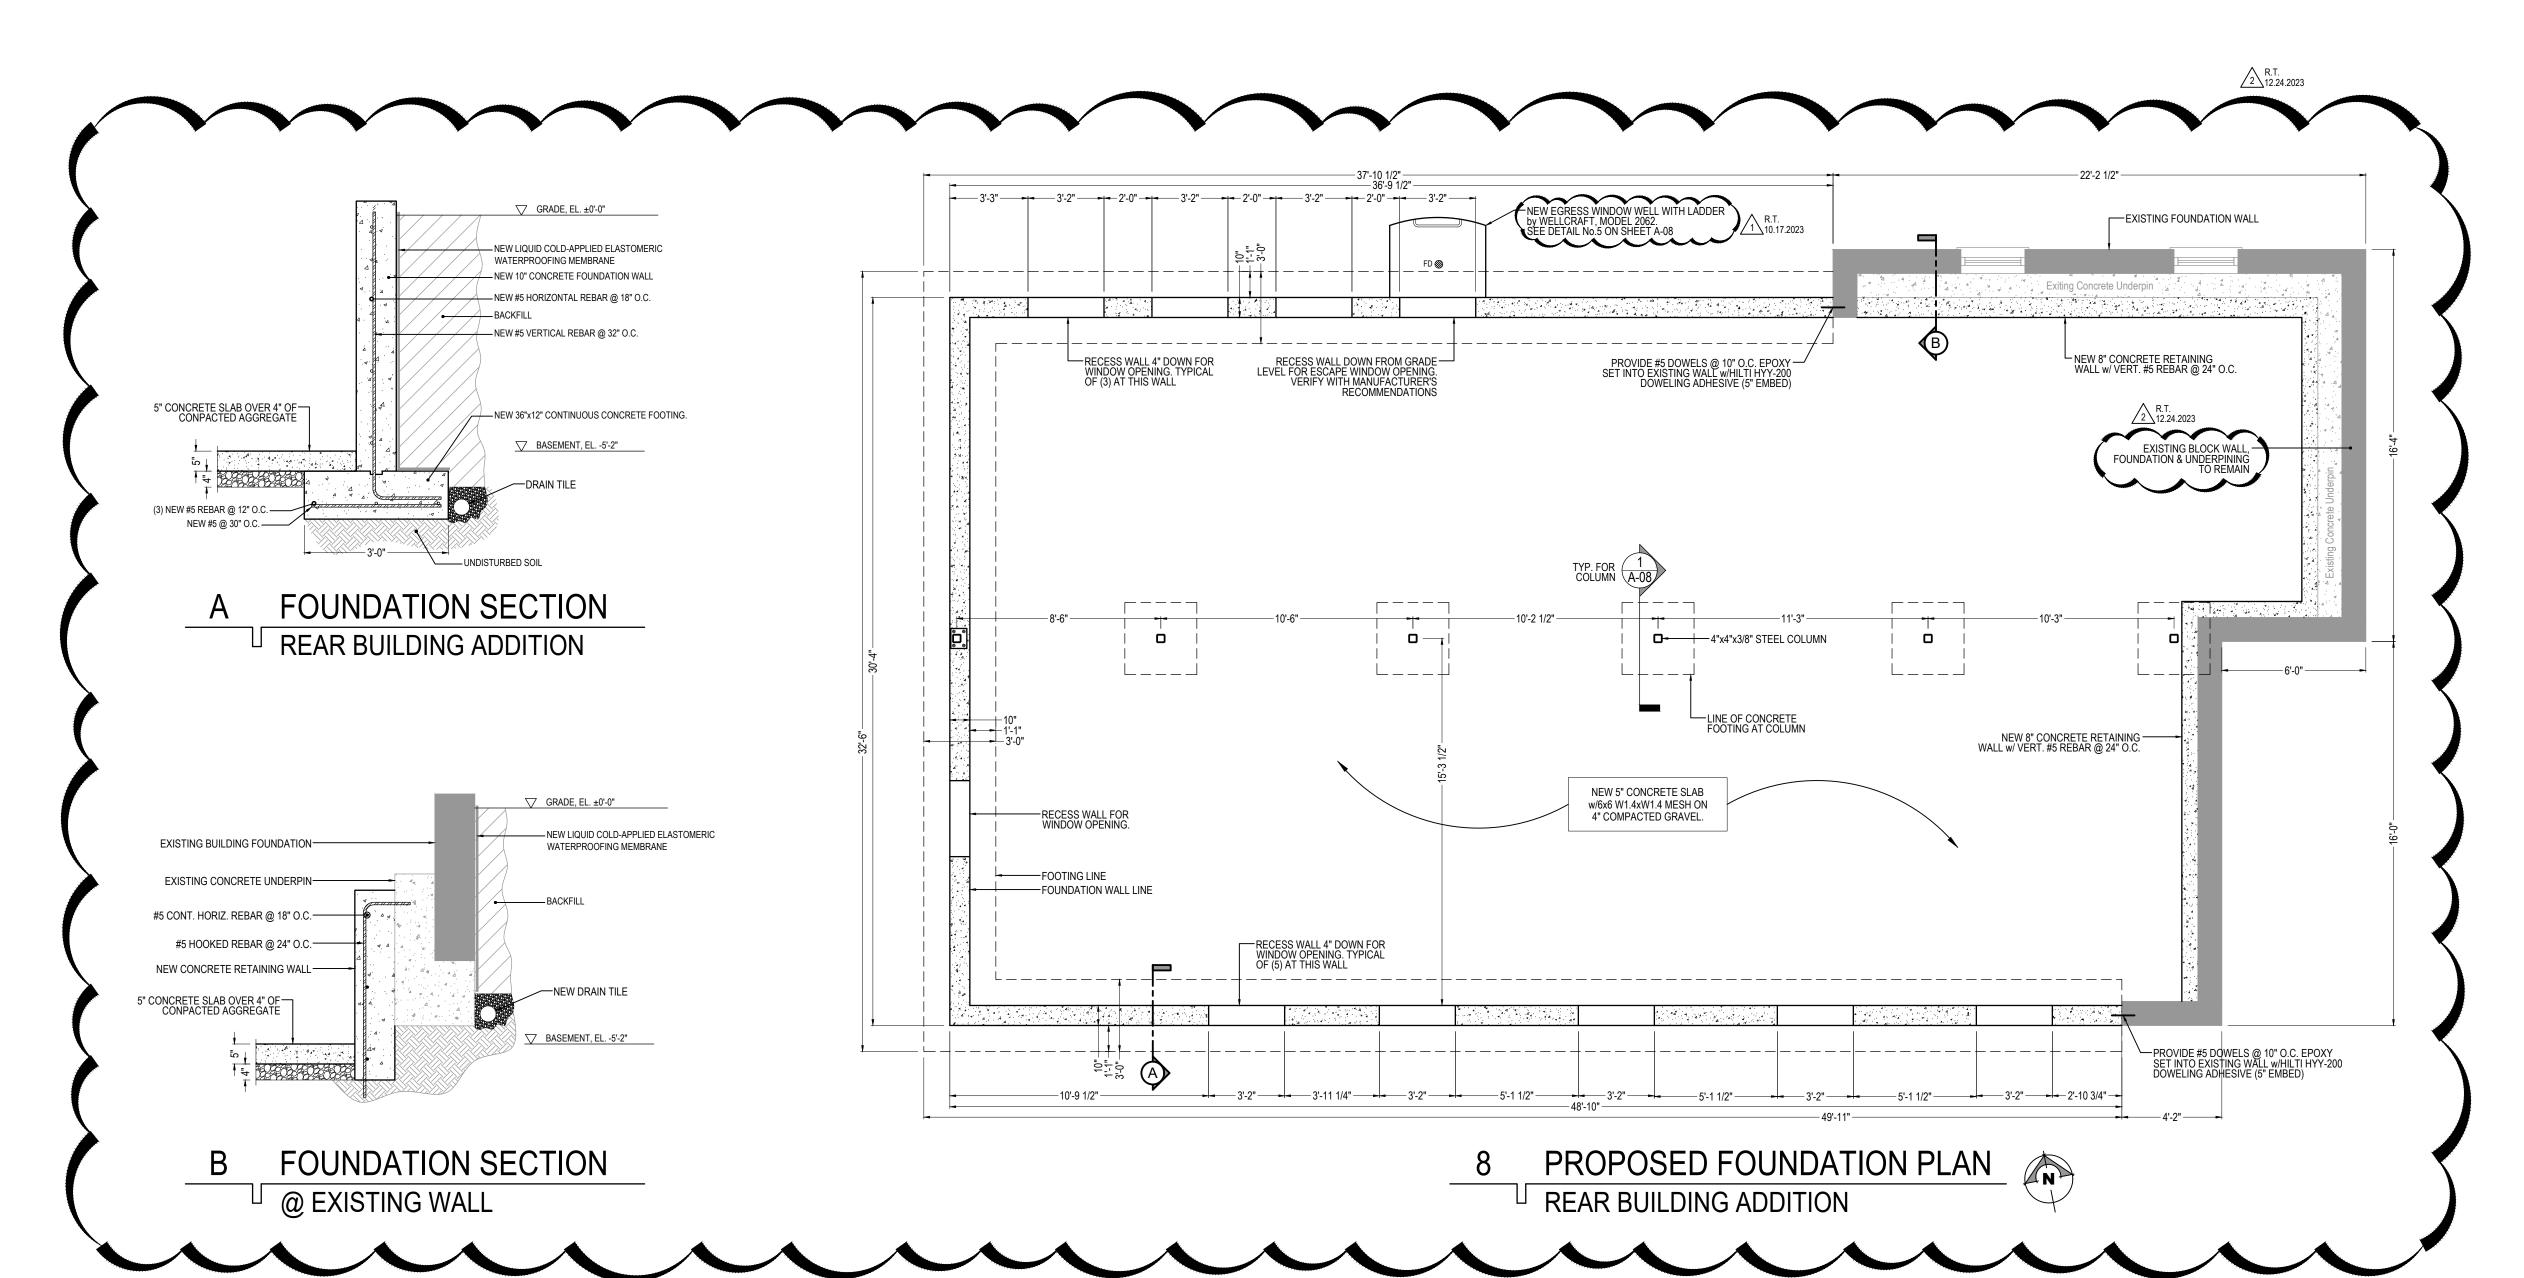



RADULE TEPAVCEVIC
7501 BROWN AVE., SUITE A
FOREST PARK, IL 60130
TEL.: (312) 217-8653
rtepavcevic@aol.com

PROJECT ARCHITECT:
RT

DRAFTPERSON:
CS

APPROVED:
RT

PREPARED FOR:
OWNER

LOCATION:
223 Center Street
Naperville, IL 60540

JOB NUMBER:
223CS-07042023

ART.

R.T.

R.T.


10.17.2


SHEET No.:

Addition's
Foundation Plan





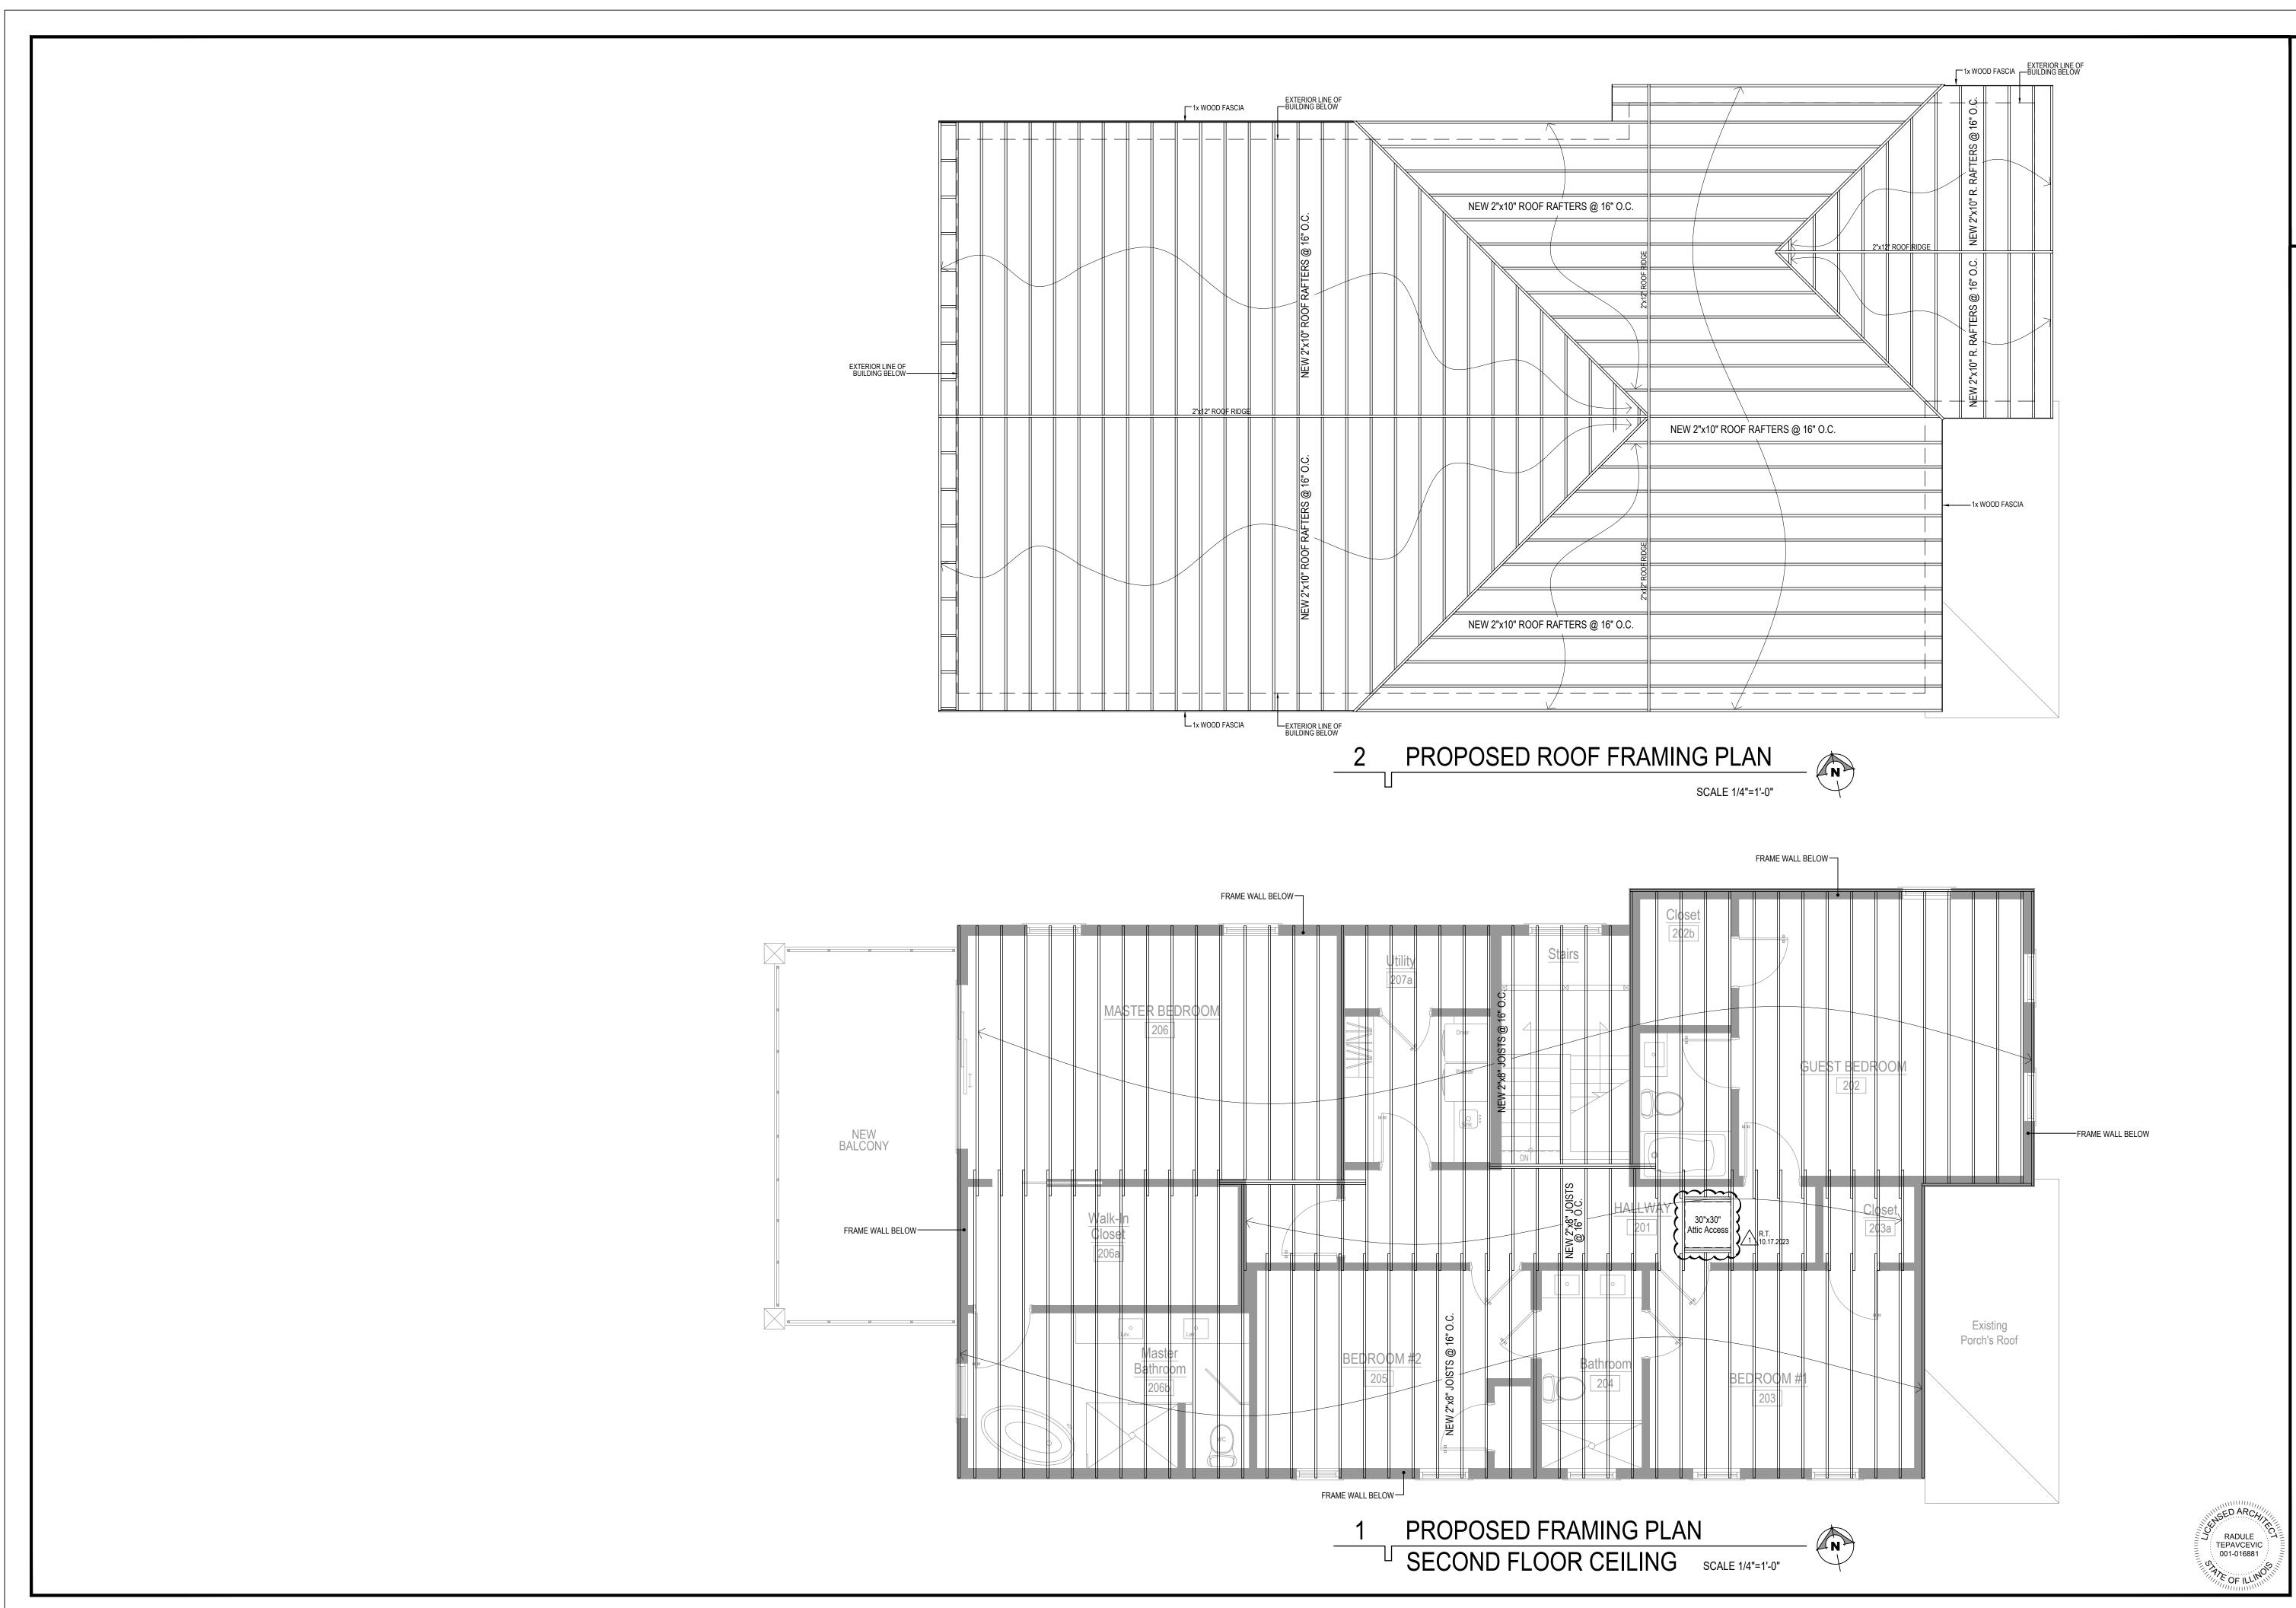

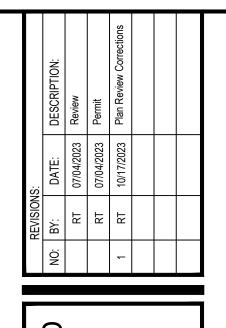


Convert 2-Unit to Single Family Residence. Interior Rehab & New 2-Story Frame Addition including New Partitions, New Electrical, Mechanical & Plumbing Systems, New Roof System & New Rear Deck & Balcony per Plans. 223 Center Street, Naperville Illinois 60540



PROJECT ARCHITECT:
RT
DRAFTPERSON:
CS
APPROVED:
RT
PREPARED FOR:
OWNER
LOCATION:
223 Center Street
Naperville, IL 60540



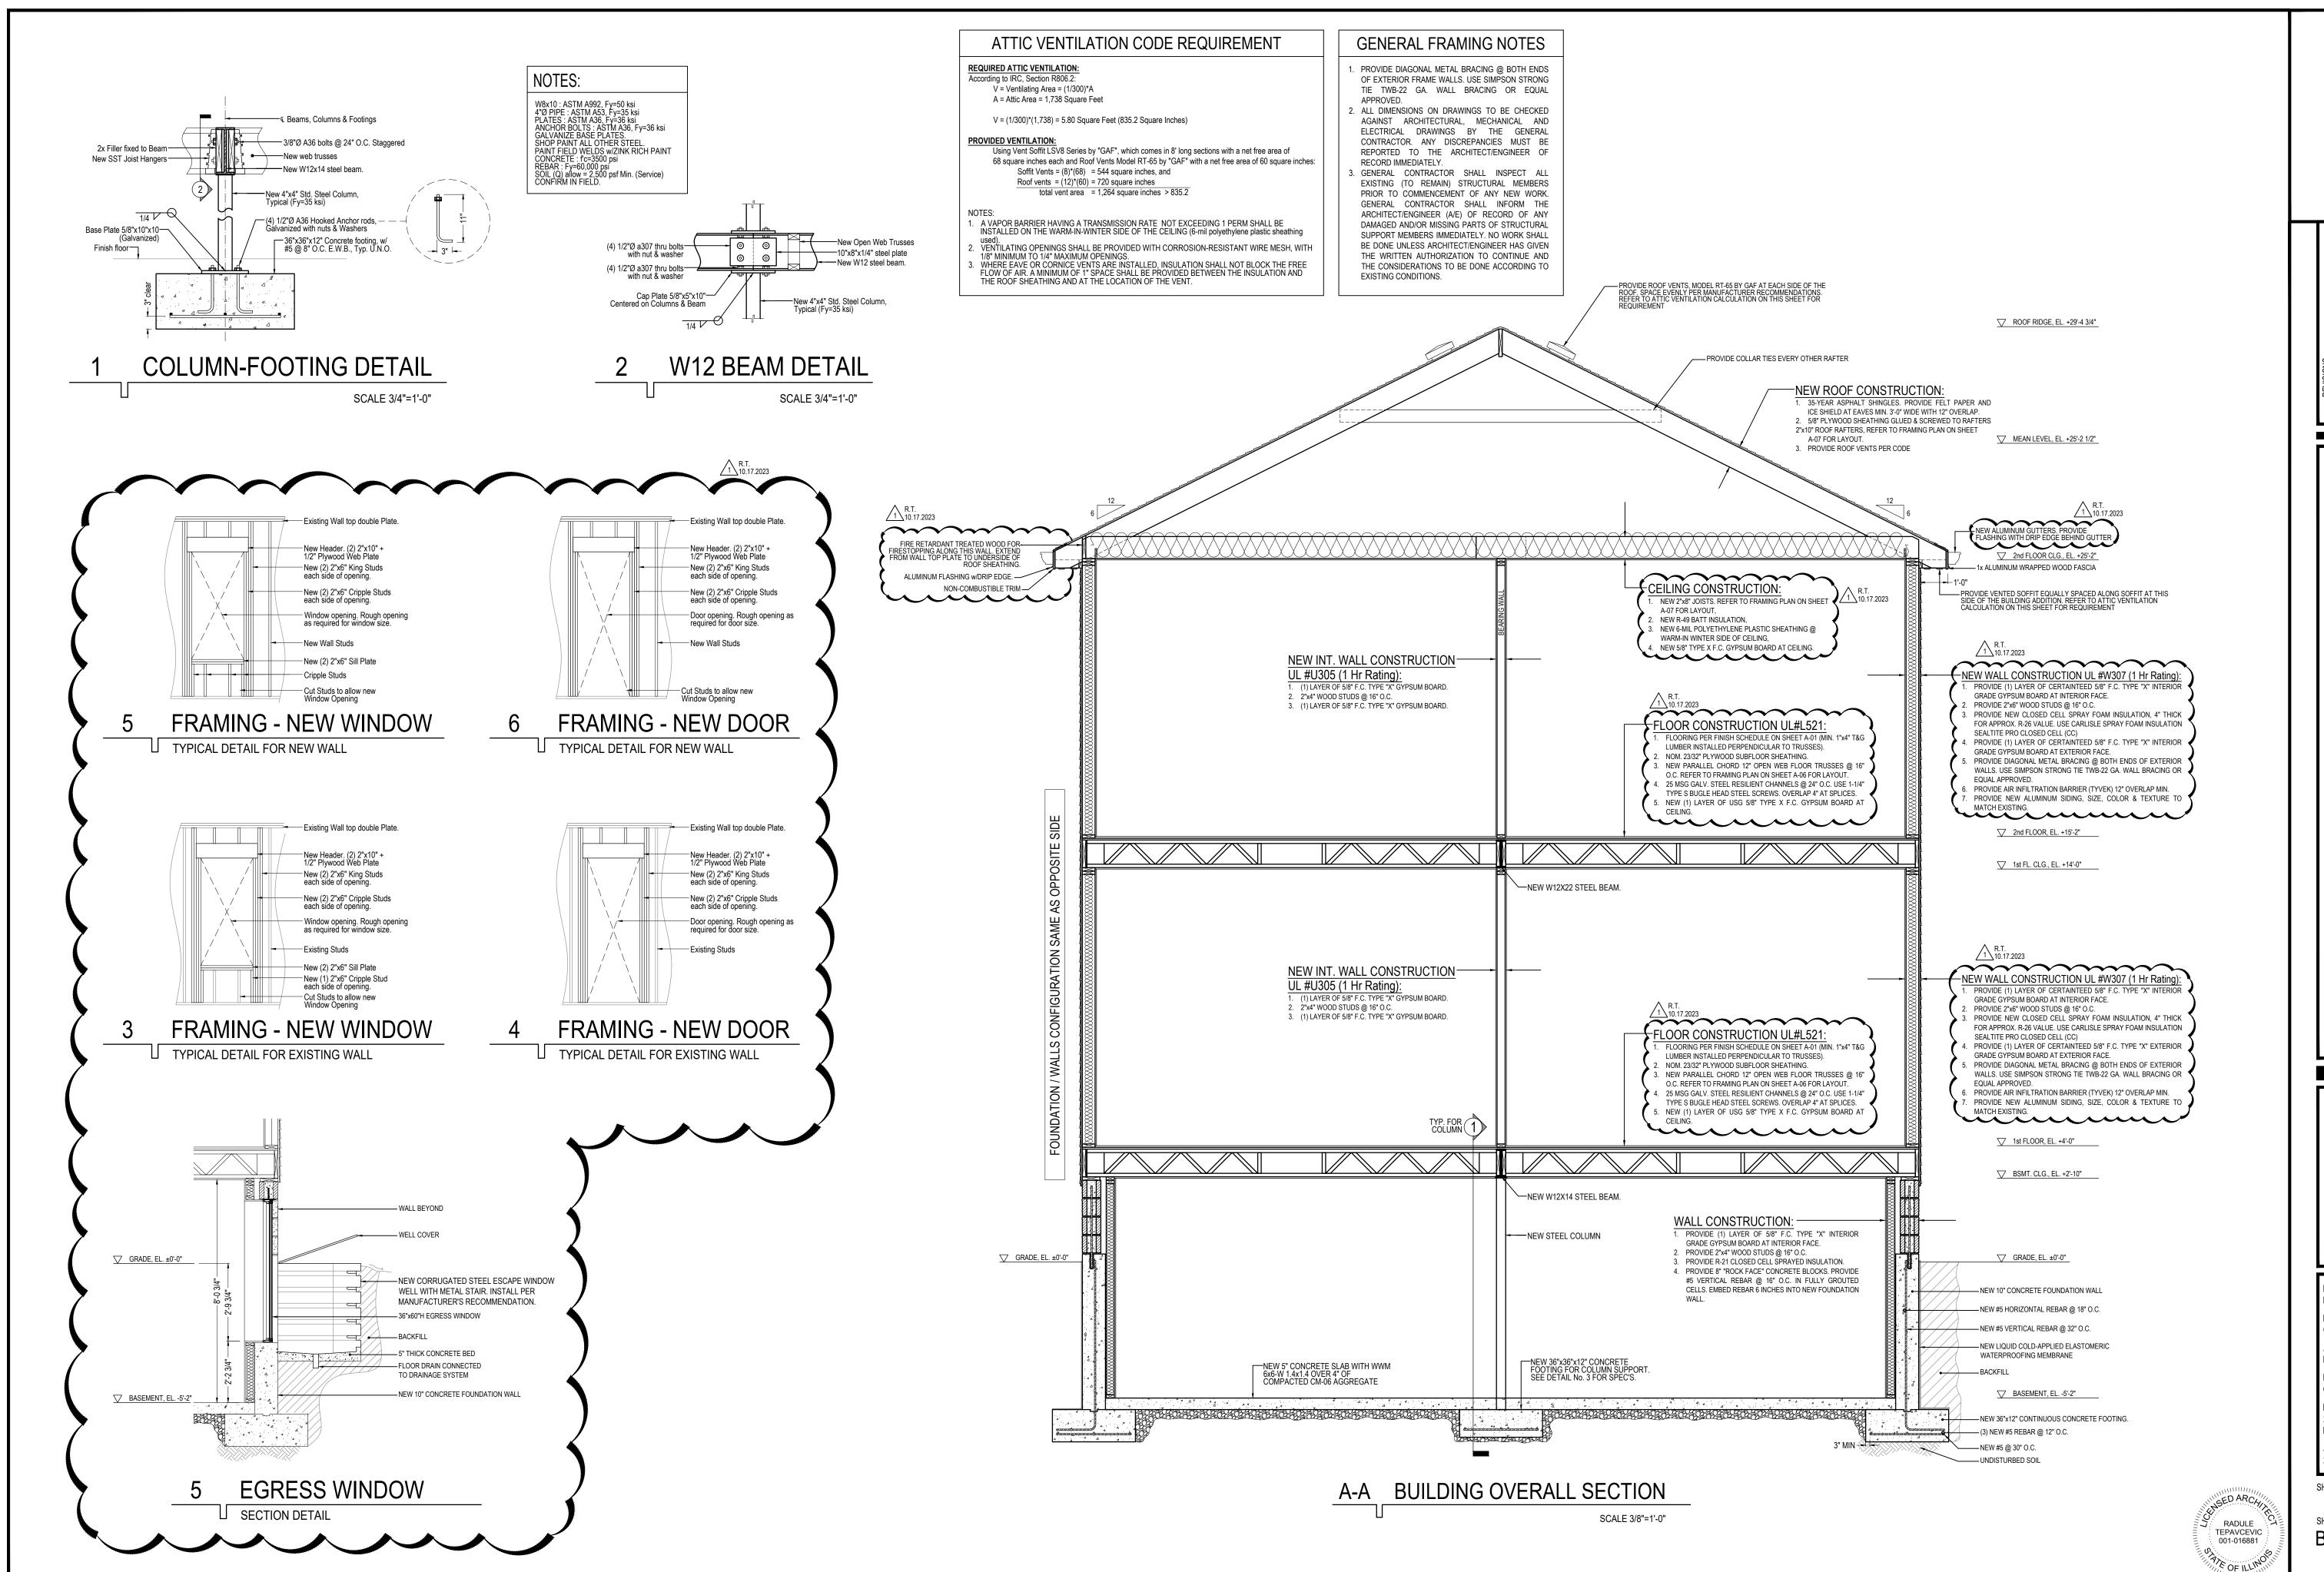

single Family Residence. Interior Rehab ame Addition including New Partitions, lechanical & Plumbing Systems, New New Rear Deck & Balcony per Plans. er Street, Naperville Illinois 60540 Convert 2-Unit to Sing & New 2-Story Fram New Electrical, Mec Roof System & Nev 223 Center S

R.T. ARCHITECT INC RADULE TEPAVCEVI

7501 BROWN AVE., SUITE FOREST PARK, IL 60130 TEL.: (312) 217-8653 rtepavcevic@aol.com


PROJECT ARCHITECT: DRAFTPERSON:


APPROVED:

REPARED FOR: OWNER LOCATION:

223 Center Street Naperville, IL 60540 JOB NUMBER: 223CS-07042023

Building Section

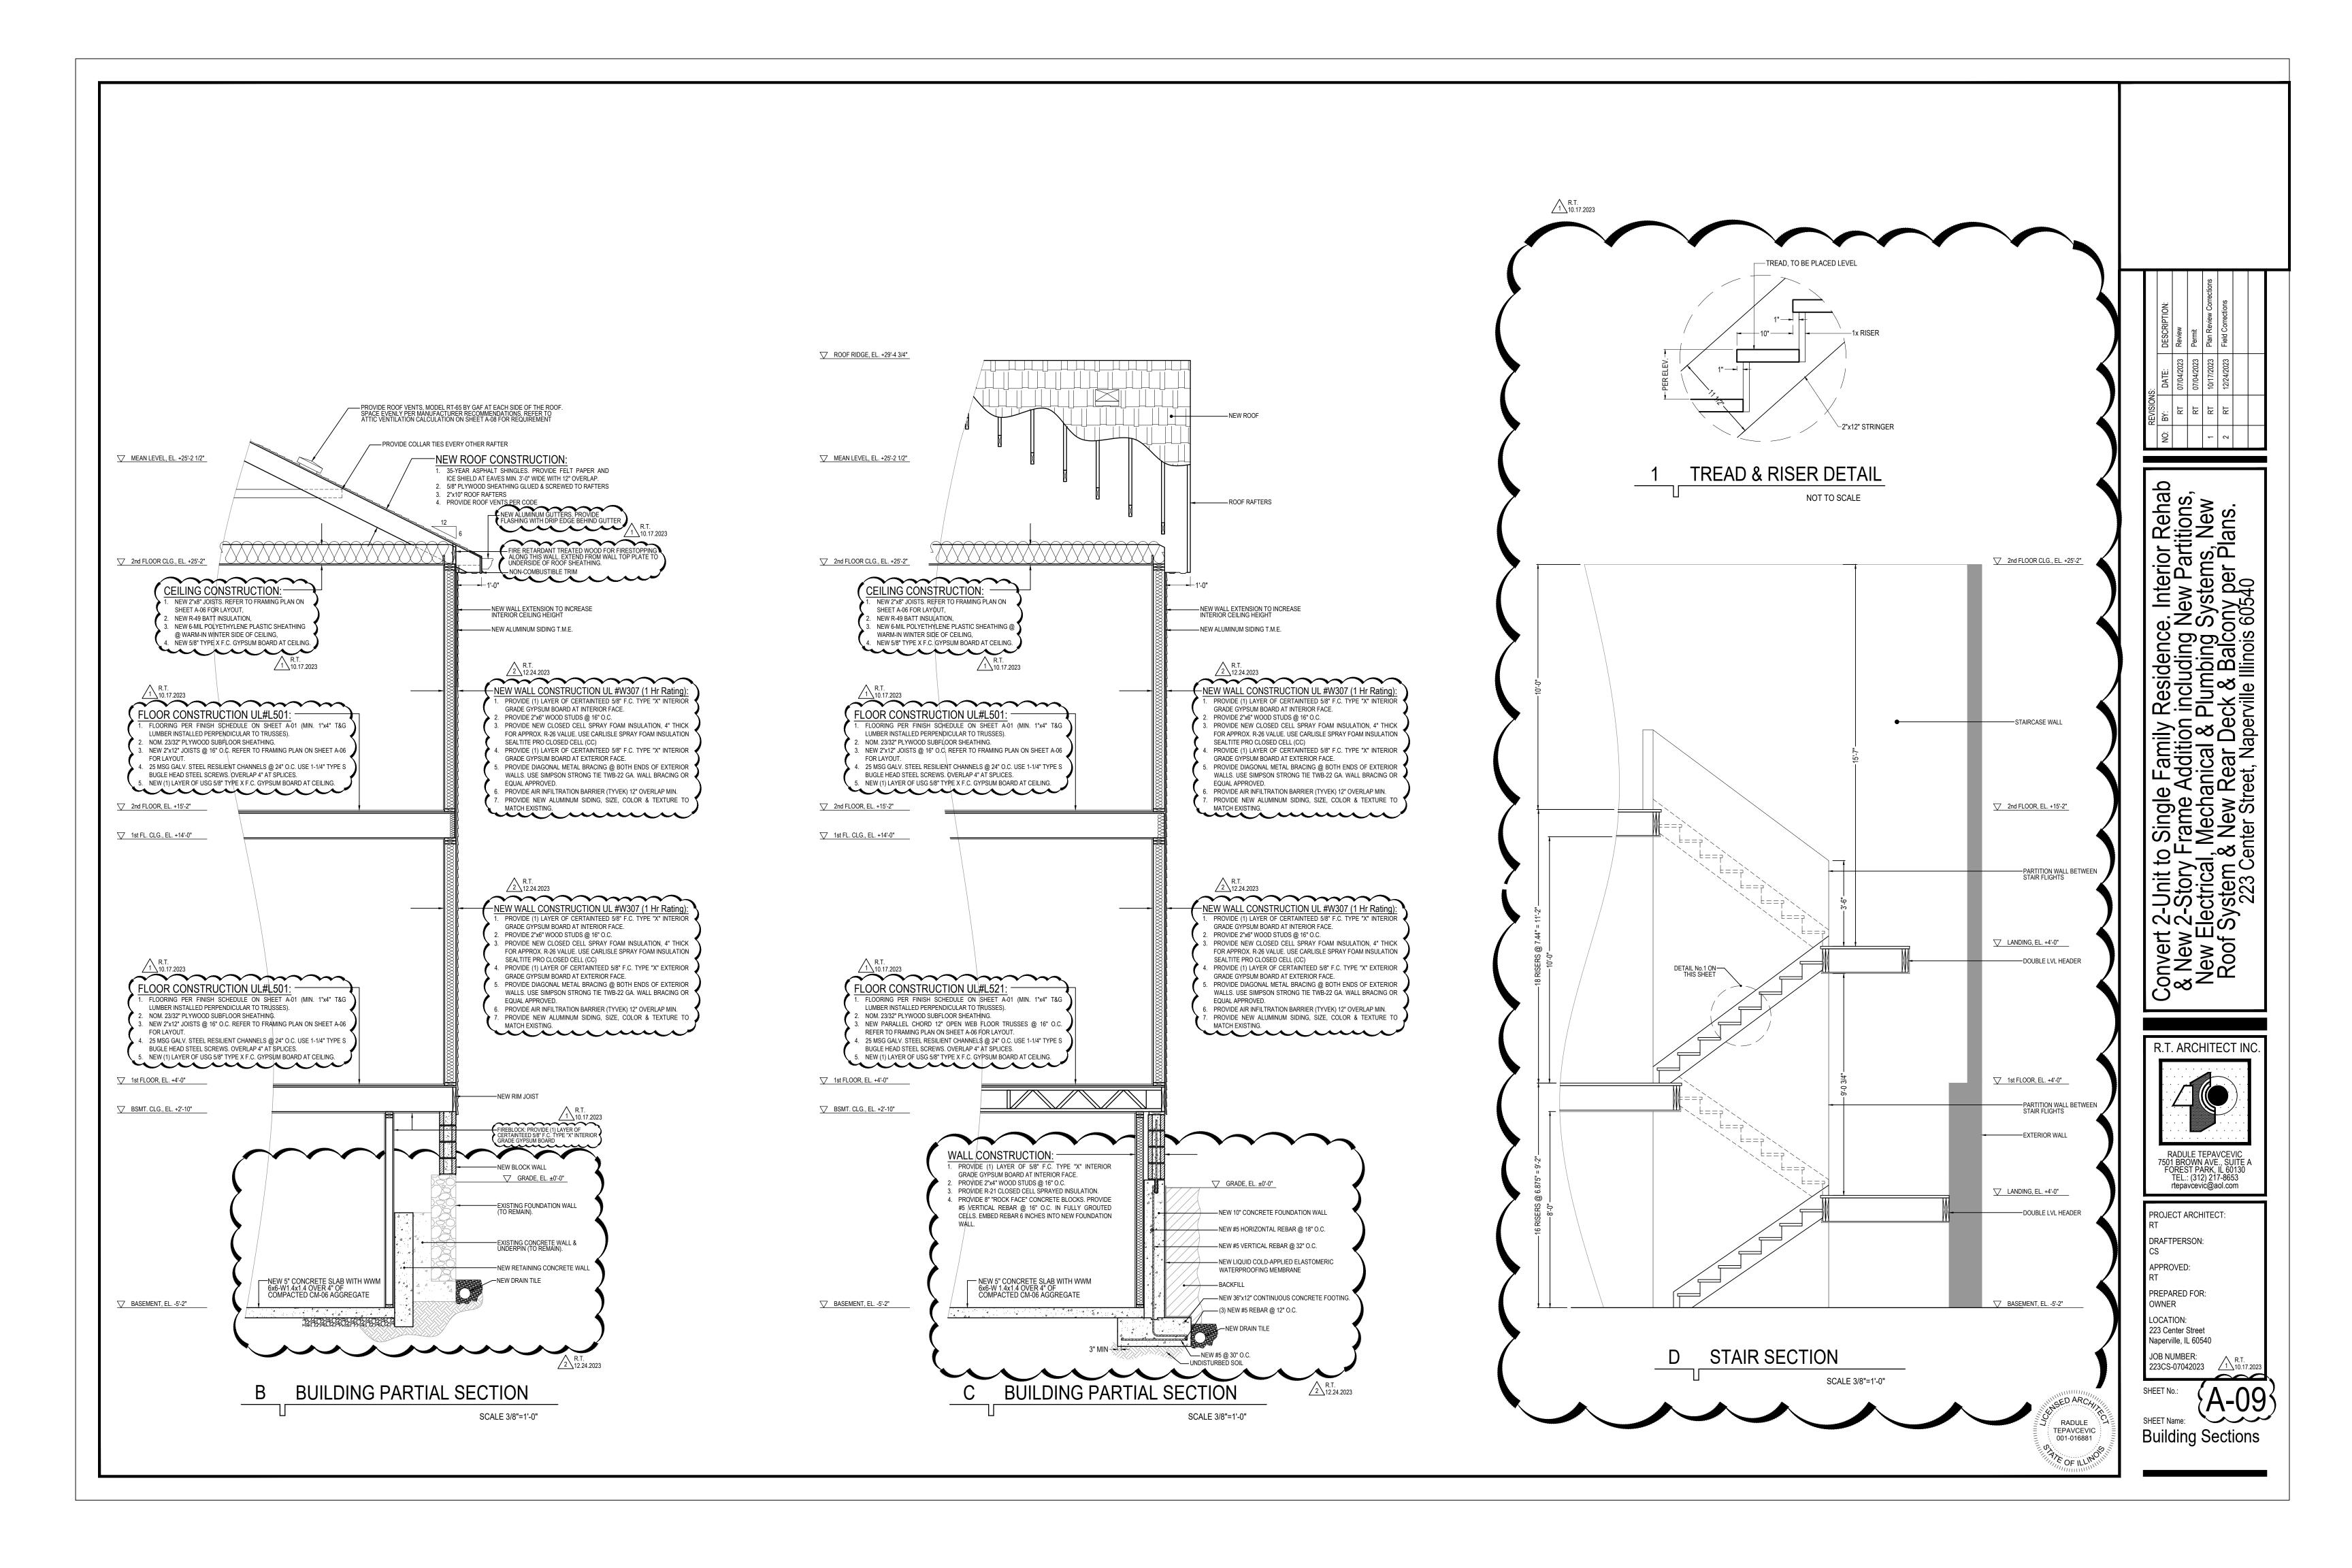

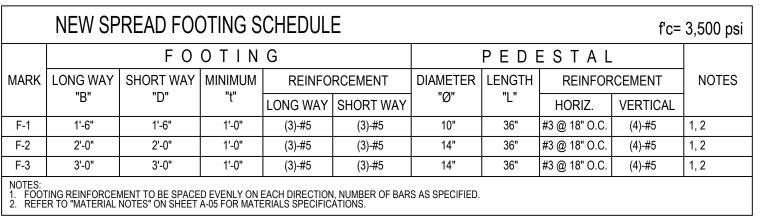

 MARK
 TYPE
 SIZE
 MATERIAL
 BASE CONNECTOR
 NOTES

 C-1 to C-3
 NEW
 8"x8"
 P.T. WOOD
 CBSQ88-SDS2
 1, 2

 C-4 to C-10
 NEW
 6"x6"
 P.T. WOOD
 CBSQ66-SDS2
 1, 2

 NOTES:
 1. SEE TABLE A ON SHEET G-01 FOR CONNECTOR DESCRIPTION.
 2. REFER TO "MATERIAL NOTES" ON SHEET G-01 FOR MATERIALS SPECIFICATIONS.

COLUMN SCHEDULE


ARCHITECTURAL NOTES

THE ABOVE PLANS SHOW ONLY A PARTIAL PORTION OF THE FRAME BUILDING. REFER TO PROPOSED PLAN ON SHEETS A-01 & A-02 FOR LOCATION OF DECK & BALCONY IN GENERAL VIEW.
 THRUSTS ON HANDRAILS:

 HANDRAILS
 HANDRAILS
 SHALL BE DESIGNED TO RESIST A

HANDRAILS SHALL BE DESIGNED TO RESIST A SIMULTANEOUS VERTICAL & HORIZONTAL THRUST OF 50 lb/ft. APPLIED AT THE TOP OF THE RAILING OR A CONCENTRATED LOAD OF 200 lb/ft. IN ANY DIRECTION.

r	V	V V		VV	V	V 1				V		
<u>'</u>		CALC	ULATED	DESIGN	LOAD ON	DECK FO	OOTING (A	ABOVE BE	EARING)			
	COLUMN MARK	C-1	C-2	C-3	C-4	C-5	C-6	C-7	C-8	C-9	C-10	1
1	LOAD (Lbs.)	9,134	6,652	9,134	1,432	1,203	922	2,582	2,922	2,454	2,490	

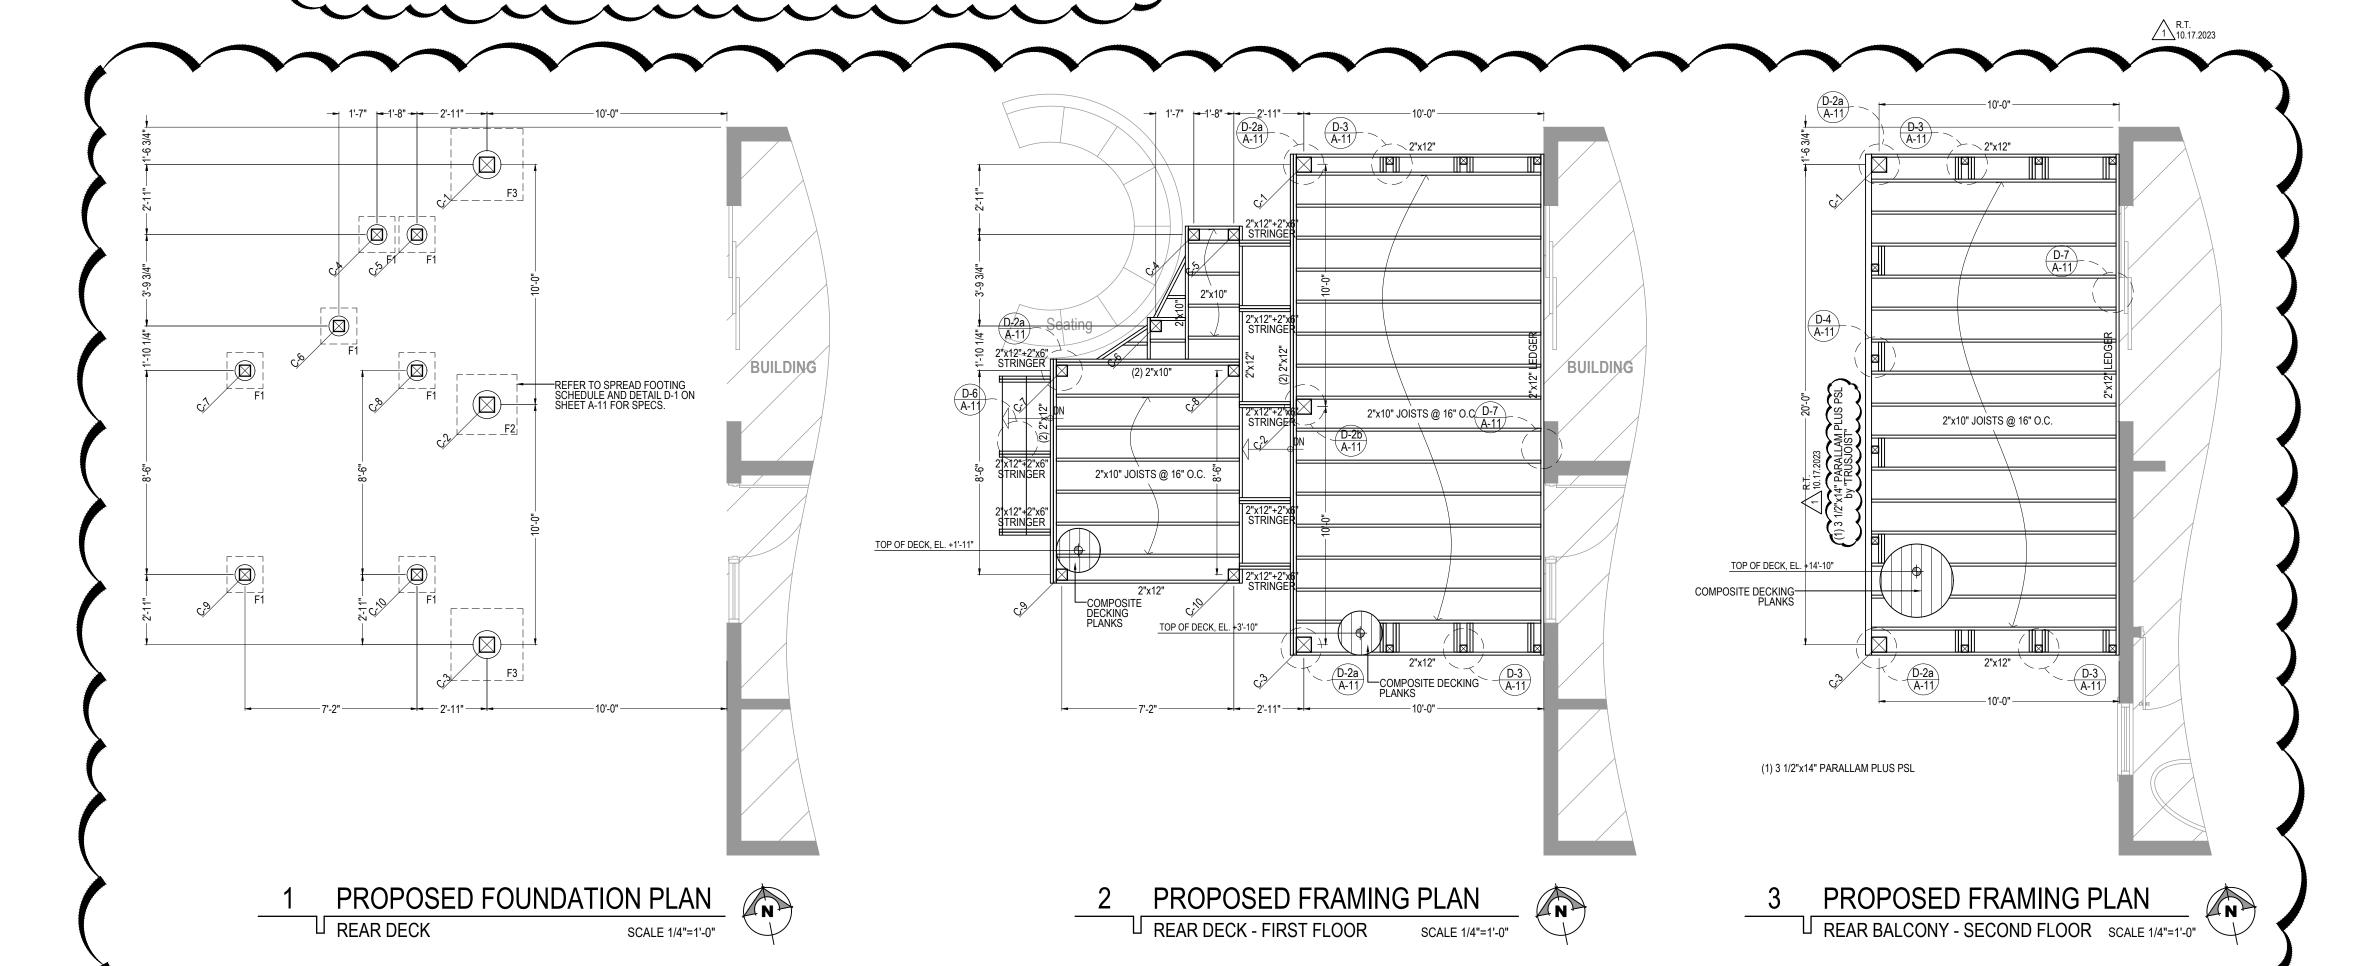



 REVISIONS:


 NO:
 BY:
 DATE:
 DESCRIPTION:

 RT
 07/04/2023
 Review

 1
 RT
 10/17/2023
 Plan Review Corrections

Convert 2-Unit to Single Family Residence. Interior Rehab & New 2-Story Frame Addition including New Partitions, New Electrical, Mechanical & Plumbing Systems, New Roof System & New Rear Deck & Balcony per Plans.

223 Center Street, Naperville Illinois 60540



PROJECT ARCHITECT:
RT

DRAFTPERSON:
CS

APPROVED:
RT


PREPARED FOR:
OWNER


LOCATION:
223 Center Street

LOCATION:
223 Center Street
Naperville, IL 60540


JOB NUMBER:
223CS-07042023

SHEET Name:
Porch & Balcony Plans

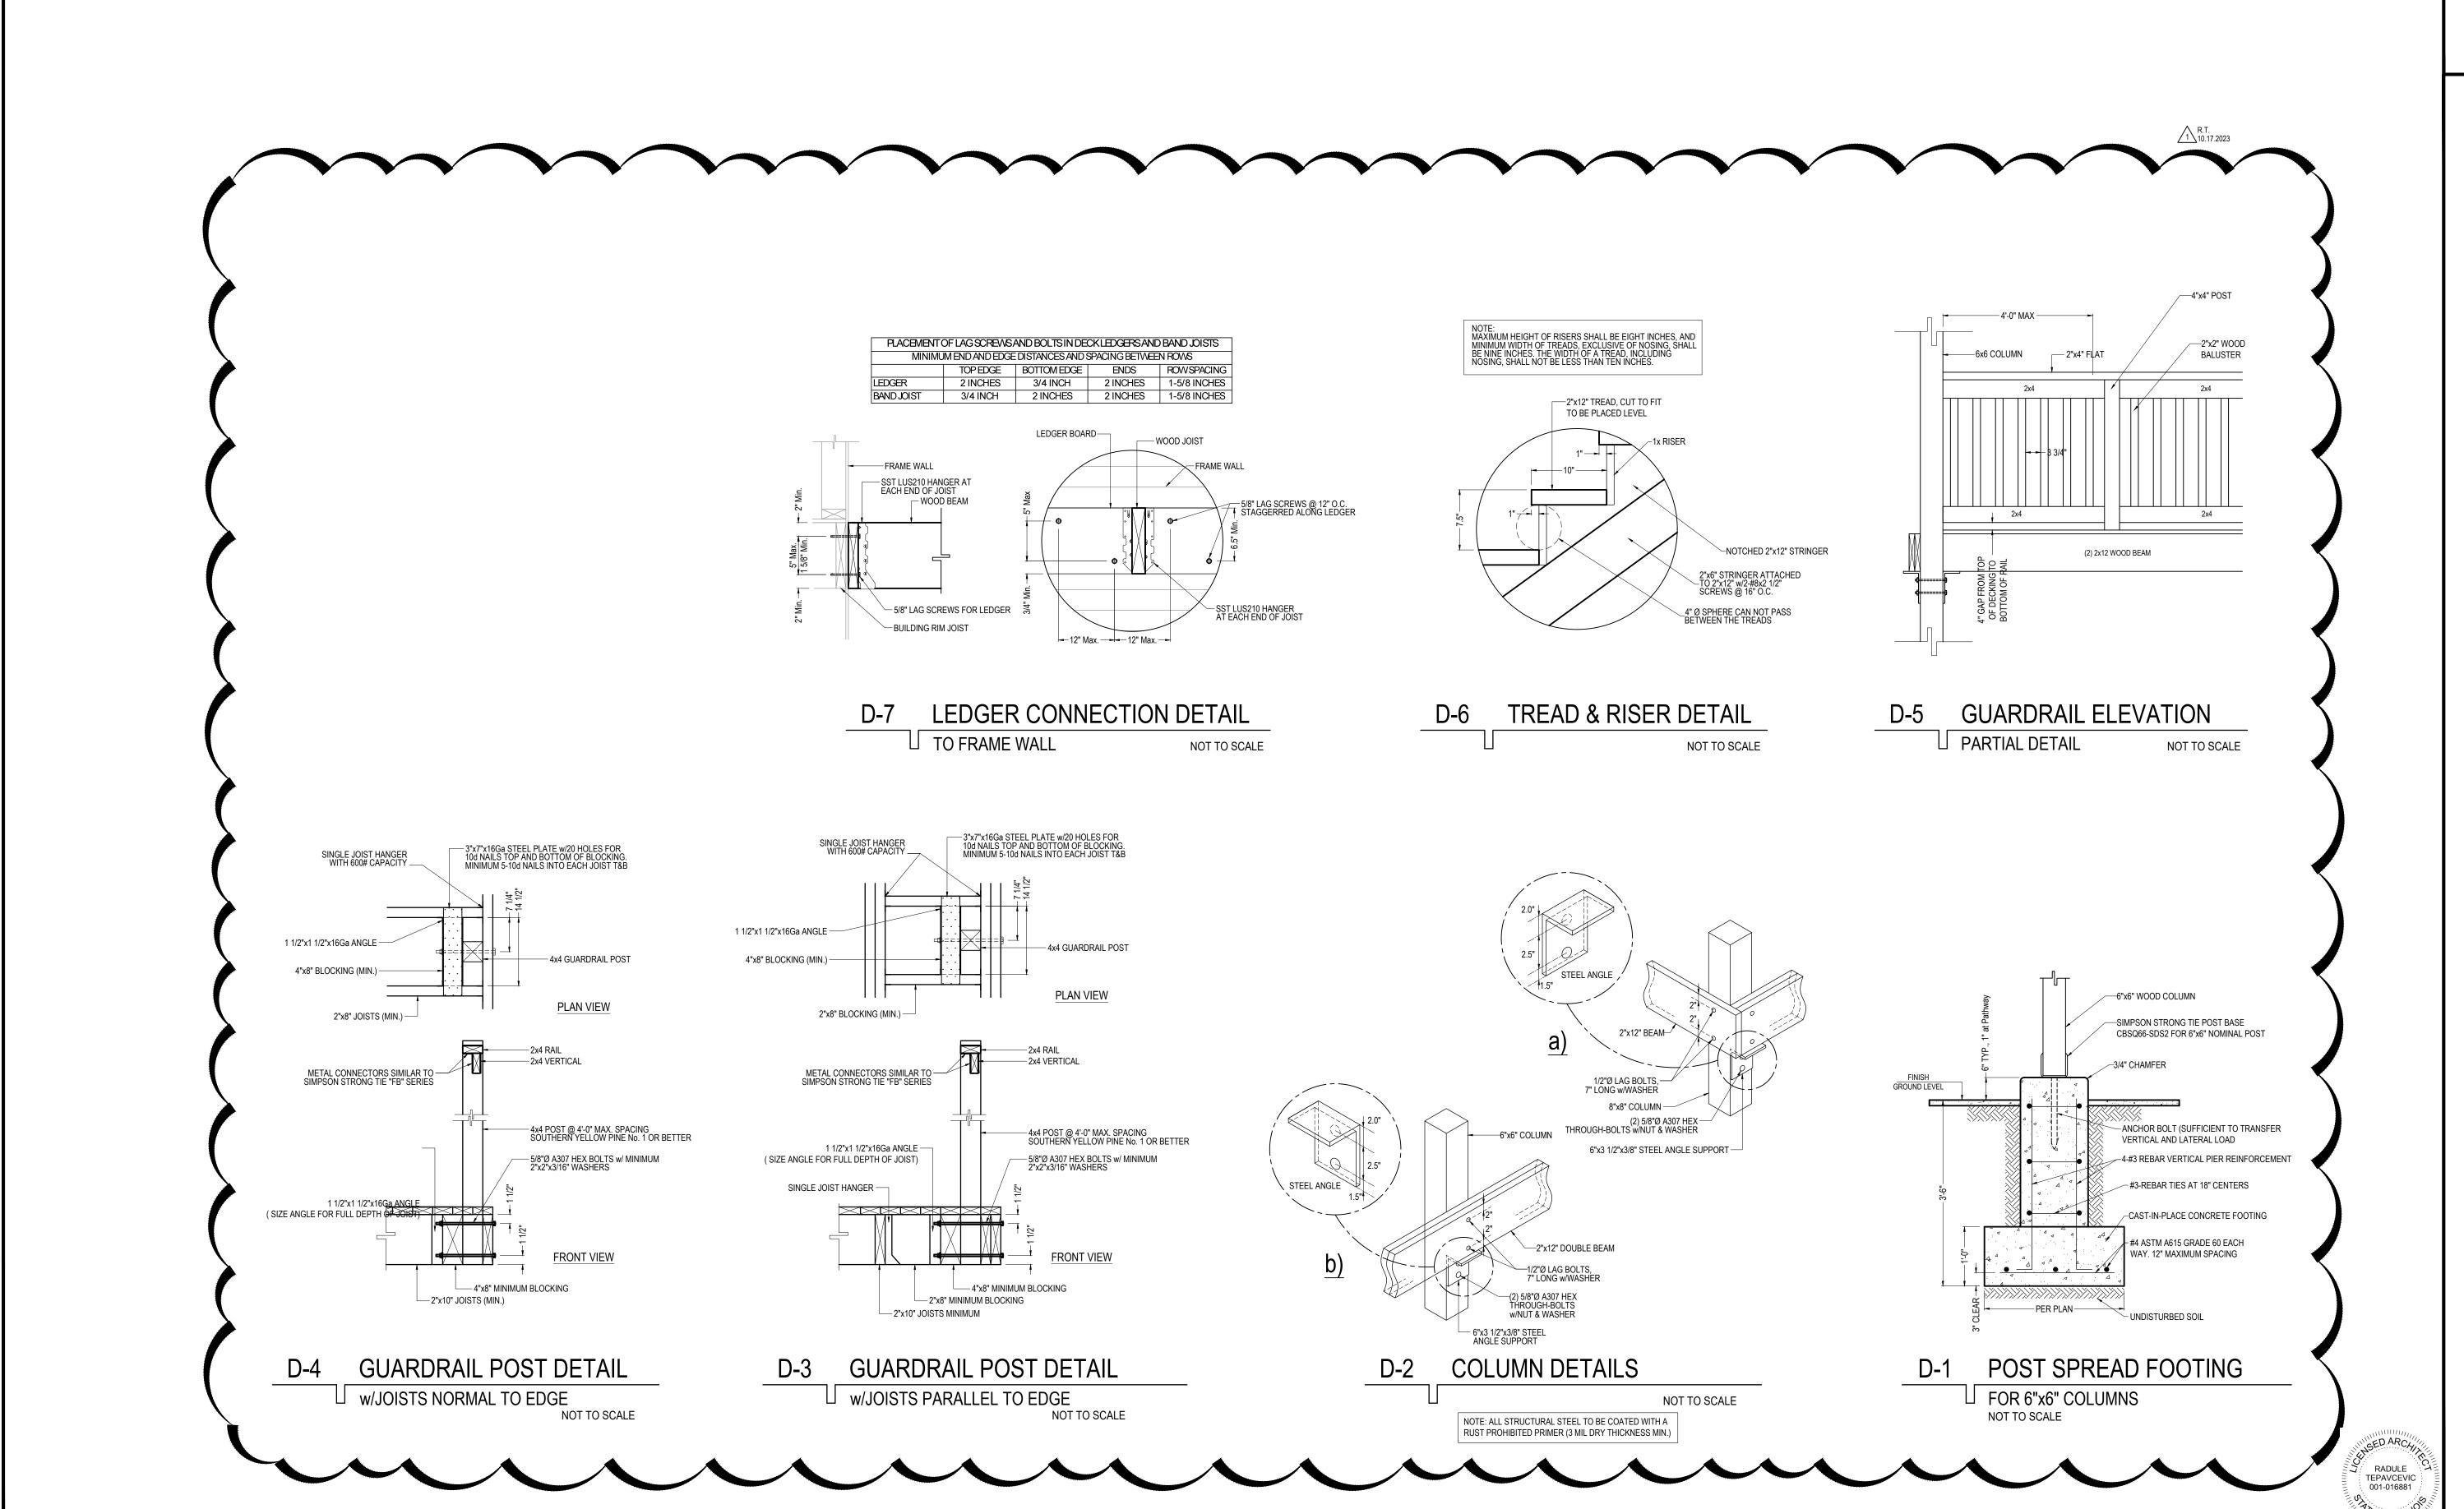



single Family Residence. Interior Rehab ame Addition including New Partitions, lechanical & Plumbing Systems, New New Rear Deck & Balcony per Plans. Street, Naperville Illinois 60540





RADULE TEPAVCEVIC 7501 BROWN AVE., SUITE A FOREST PARK, IL 60130 TEL.: (312) 217-8653 rtepavcevic@aol.com

PROJECT ARCHITECT: DRAFTPERSON: APPROVED: PREPARED FOR: OWNER LOCATION: 223 Center Street Naperville, IL 60540 JOB NUMBER:

223CS-07042023


Porch **Connection Details**

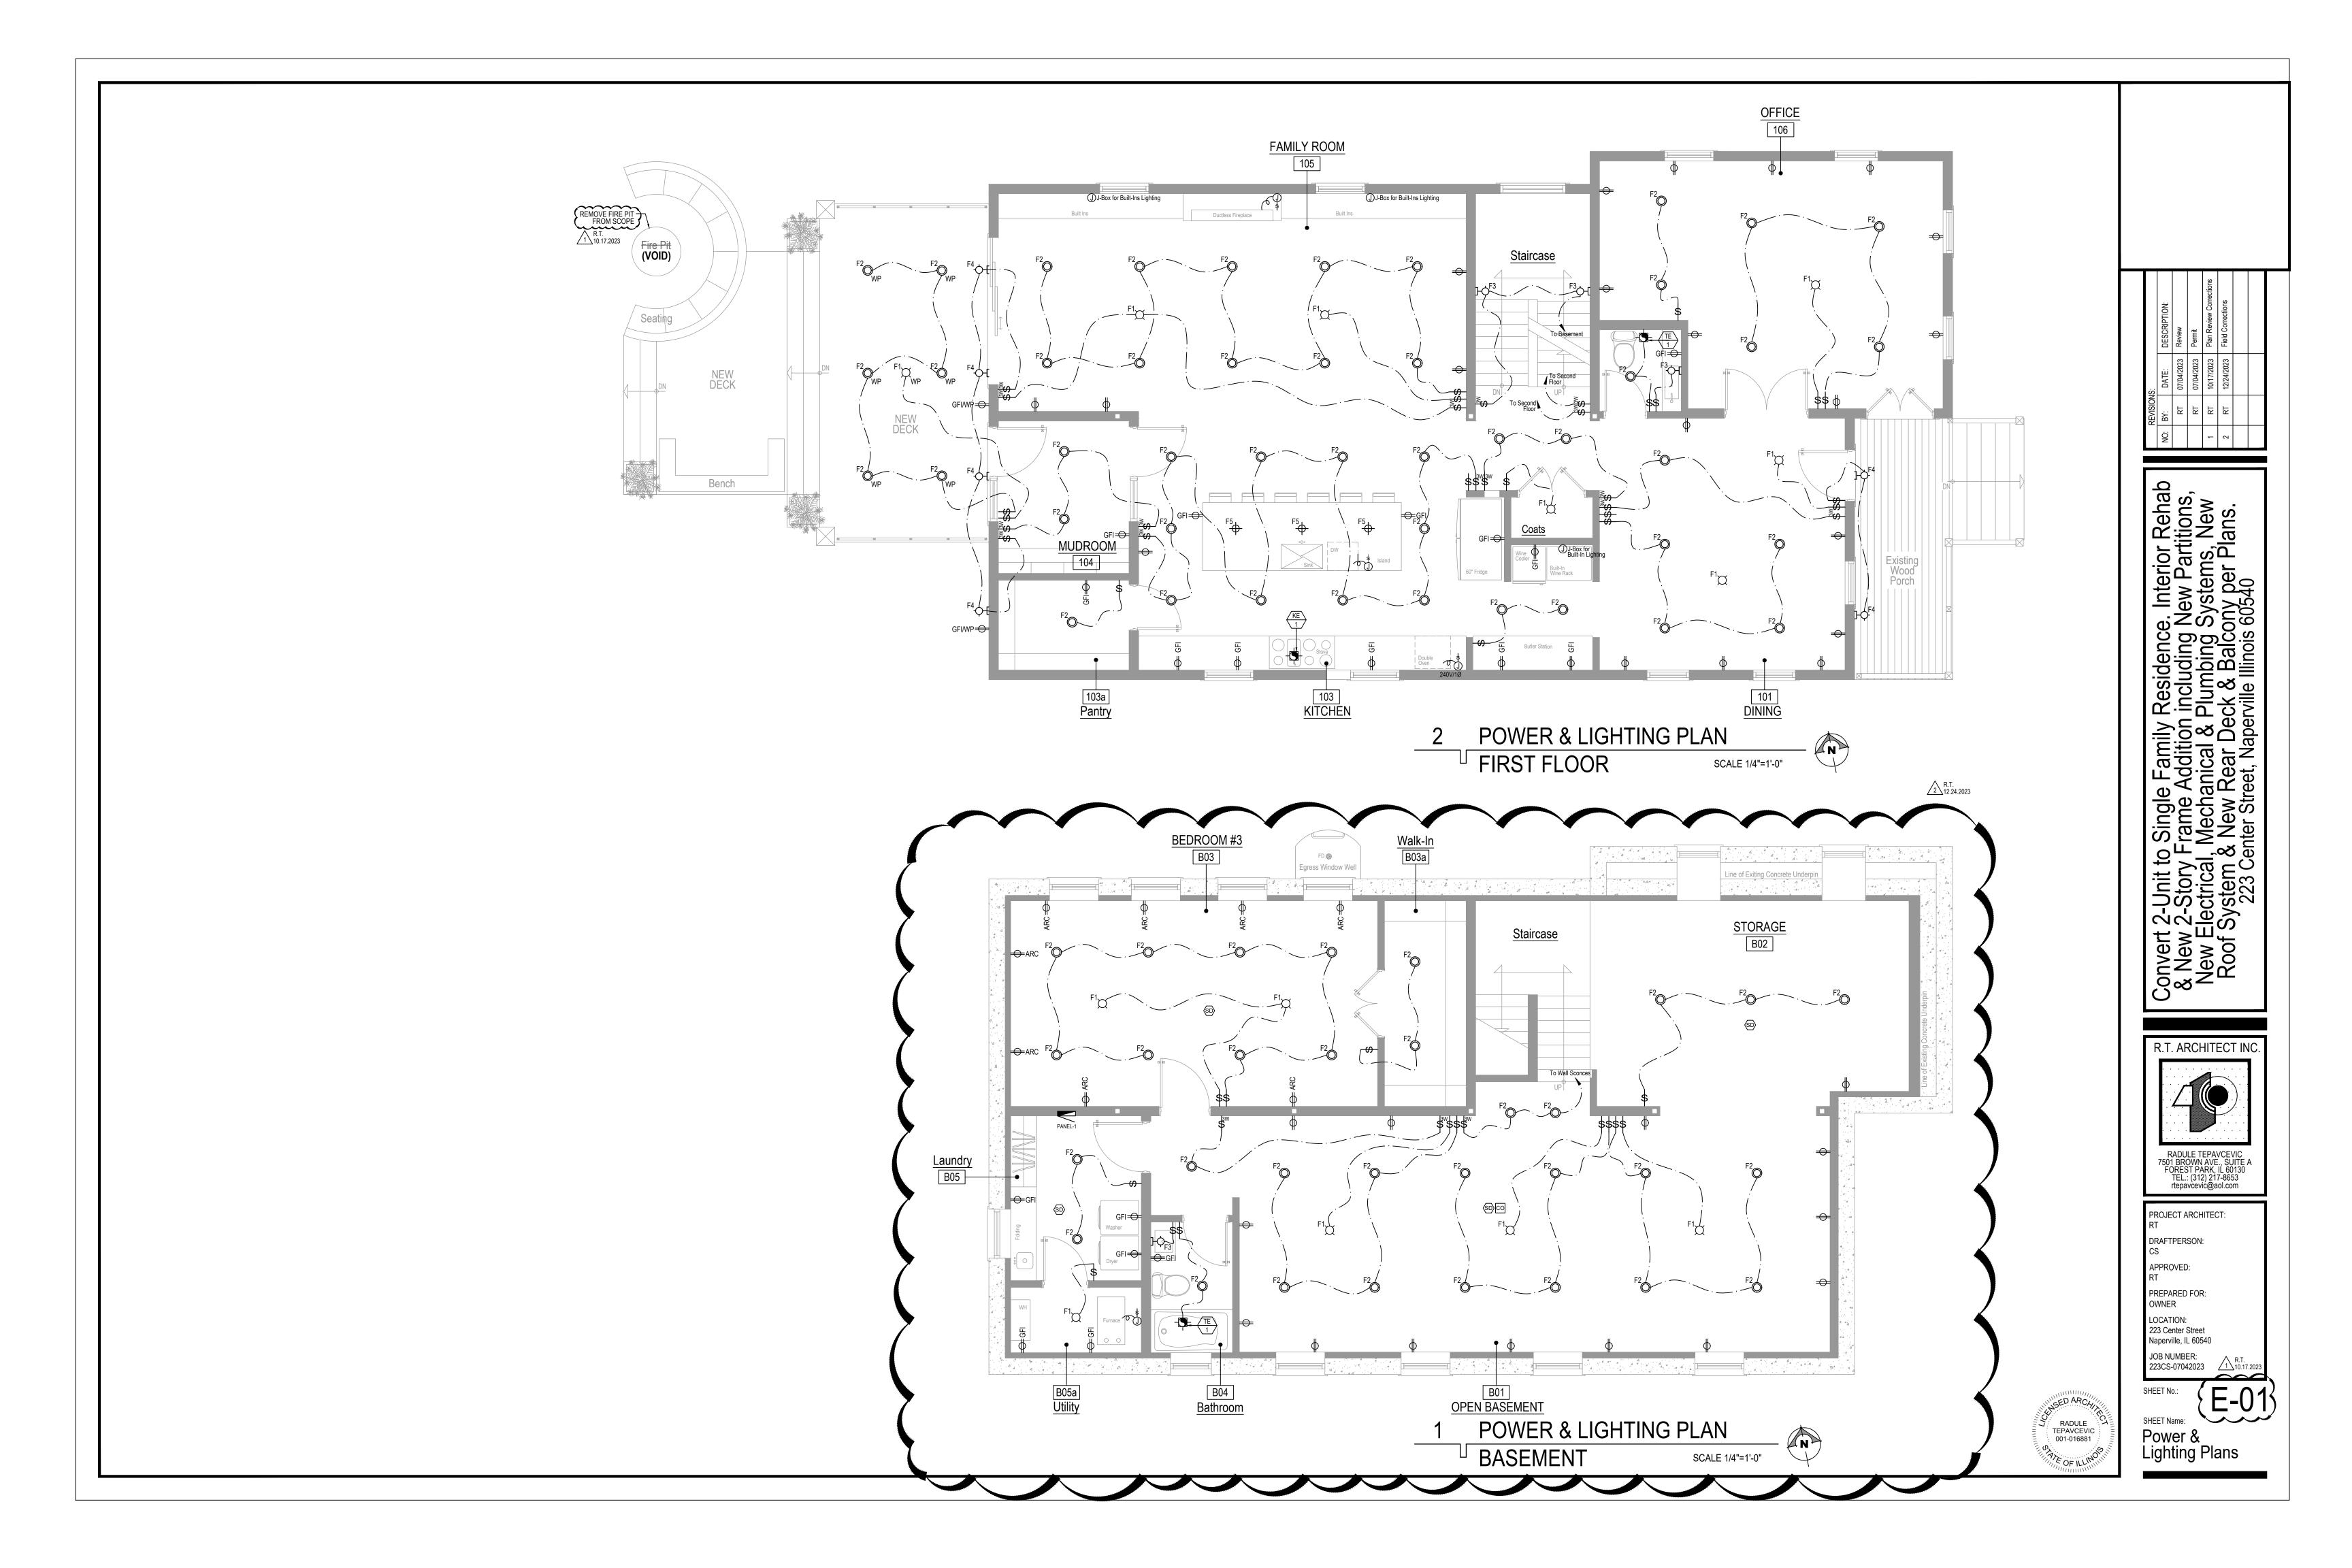

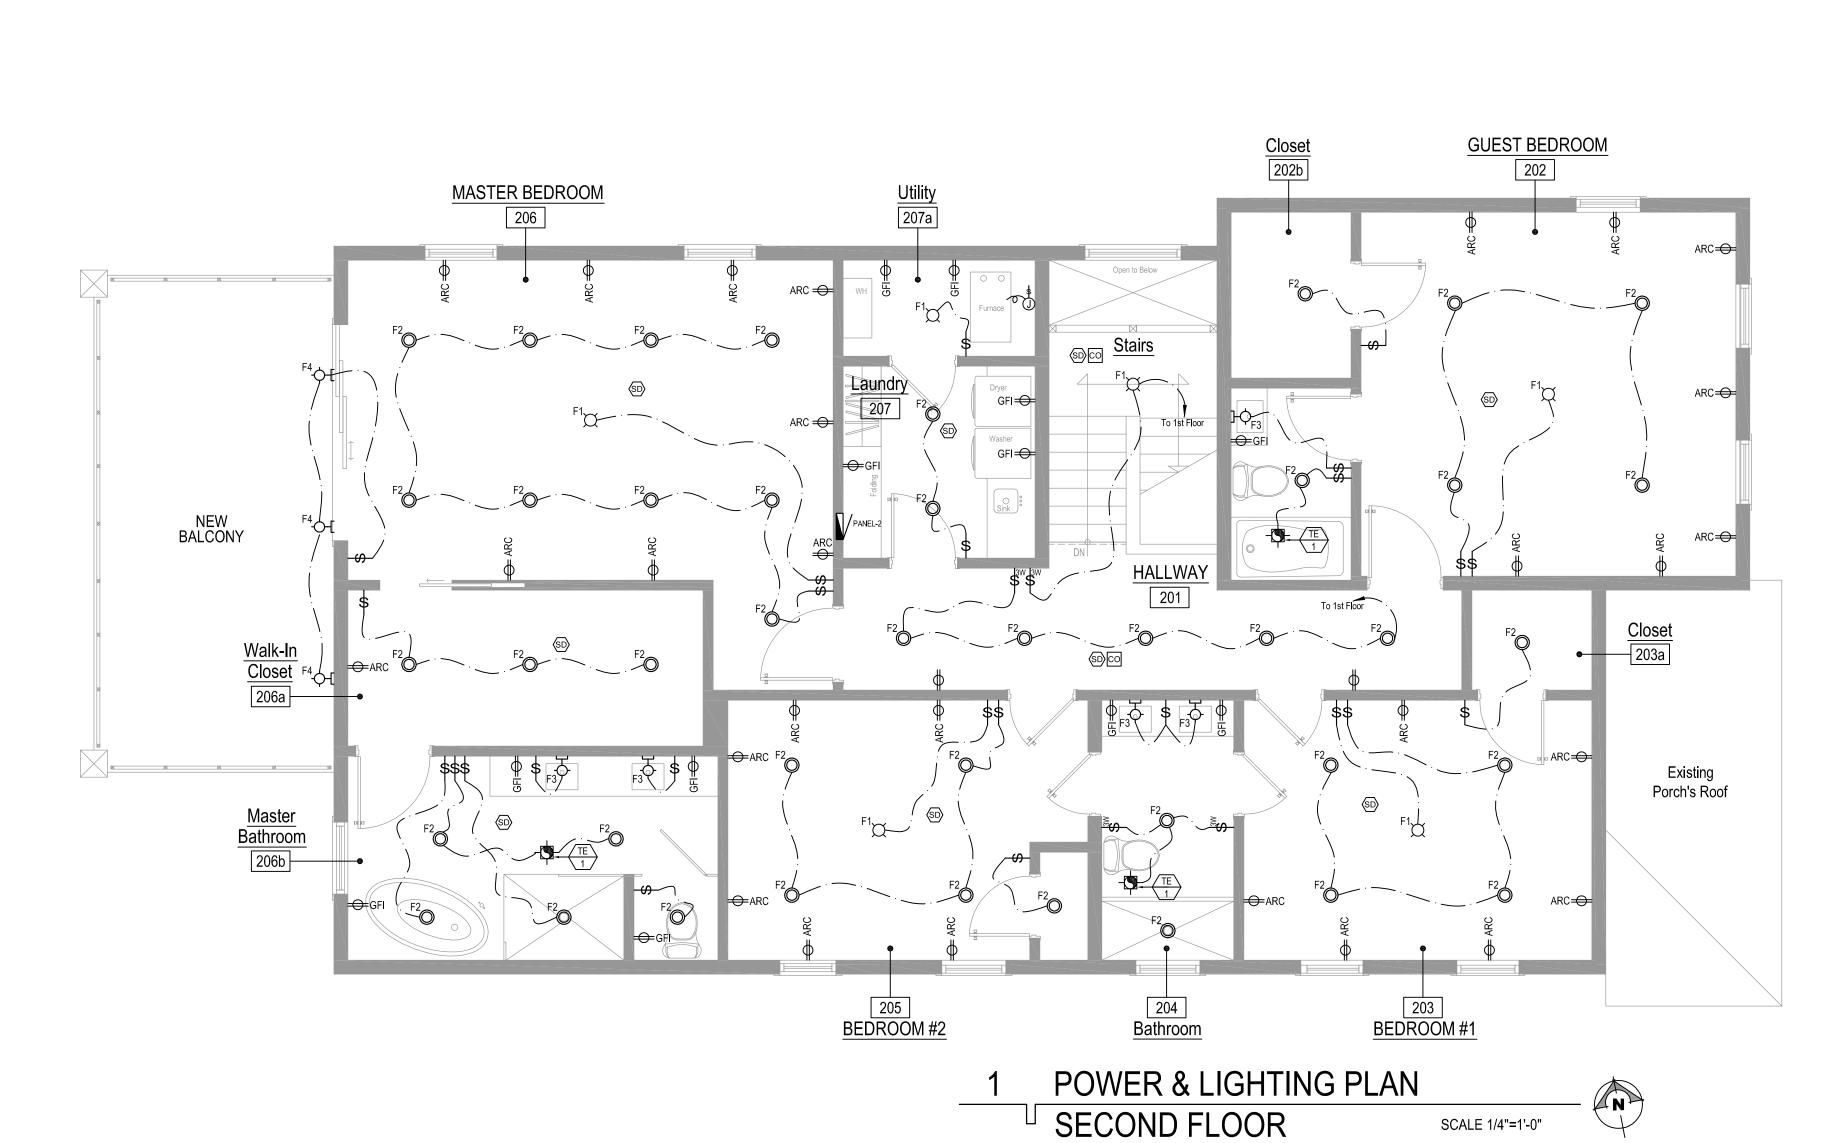







PROJECT ARCHITECT:
RT

DRAFTPERSON:
CS

APPROVED:
RT

PREPARED FOR:
OWNER

LOCATION:
223 Center Street
Naperville, IL 60540


JOB NUMBER:
223CS-07042023

SHEET No.: E-O

Power & Lighting Plans

ELECTRICAL NOTES

- 1. ALL ELECTRICAL WORK SHALL BE PERFORMED IN A WORKMANLIKE MANNER BY A LICENSED ELECTRICIAN IN THE CITY OF NAPERVILLE. ALL ELECTRICAL WORK MUST COMPLY WITH THE CITY OF NAPERVILLE ADOPTED ELECTRICAL CODE.
- 2. ALL MATERIALS SHALL BE U.L. LISTED, AND APPROVED FOR THE PURPOSE INTENDED. 3. OBTAIN AND PAY ALL FEES, TAXES, AND PERMITS REQUIRED FOR ELECTRICAL WORK. PREPARE AND SUBMIT TO THE CITY OF NAPERVILLE ANY AND ALL DATA, DRAWINGS, AND
- DETAILS WHICH MAY BE REQUIRED FOR APPROVAL PRIOR TO INSTALLATION OF SAME. 4. FURNISH ALL LABOR, MATERIALS, EQUIPMENT AND RELATED APPURTENANCES REQUIRED FOR ALL WORK INCLUDED AS PART OF THE ELECTRICAL INSTALLATION FOR THIS PROJECT.
- 5. COORDINATE ELECTRICAL WORK WITH ALL OTHER TRADES TO AVOID CONFLICTS AND
- 6. FURNISH AND INSTALL ALL AUXILIARY SUPPORTS AND MATERIAL NECESSARY TO INSTALL EQUIPMENT, MATERIAL, LIGHTING FIXTURES, DEVICES, CONDUIT AND WIRING.
- 7. ALL SYSTEMS WHICH ARE INCLUDED AS PART OF THE ELECTRICAL INSTALLATION FOR THIS PROJECT SHALL BE COMPLETE IN ALL DETAILS, INCLUDING ALL COMPONENTS REQUIRED FOR PROPER AND SATISFACTORY OPERATION.
- 8. ALL WIRE SHALL BE INSTALLED IN CONDUIT. MINIMUM SIZE OF CONDUIT SHALL BE 1/2" I.D. LARGER SIZES SHALL BE USED WHERE REQUIRED BY ADOPTED ELECTRICAL CODE.
- 9. ELECTRICAL METALLIC TUBING (EMT) MAY BE USED WITHIN CODE LIMITATIONS ON
- 10. CONDUITS SHALL BE CONCEALED IN ALL "FINISHED" AREAS. IN "UNFINISHED" AREAS CONDUITS MAY BE RUN EXPOSED, PARALLEL WITH OR PERPENDICULAR TO BUILDING LINES. 11. FURNISH AND INSTALL ALL OUTLET BOXES RAISED COVERS, COVER PLATES, AND
- 12. FURNISH AND INSTALL BREAKERS FOR ALL EQUIPMENT, INCLUDING EQUIPMENT FURNISHED BY OWNER AND OTHERS.
- 13. ALL ELECTRICAL OUTLETS NEAR WATER MUST BE GFCI.
- 14. ALL CLOSETS SHALL BE: A. RECESSED LIGHTS WITH 6" CLEARANCE BETWEEN FIXTURE AND
- B. NEAREST POINT OF STORAGE SPACE.
- C. FLUORESCENT LIGHTS WITH 6" CLEARANCE BETWEEN FIXTURE D. AND NEAREST POINT OF STORAGE SPACE.
- E. INCANDESCENT LIGHTS WITH 12" CLEARANCE BETWEEN FIXTURE AND NEAREST POINT OF STORAGE SPACE.

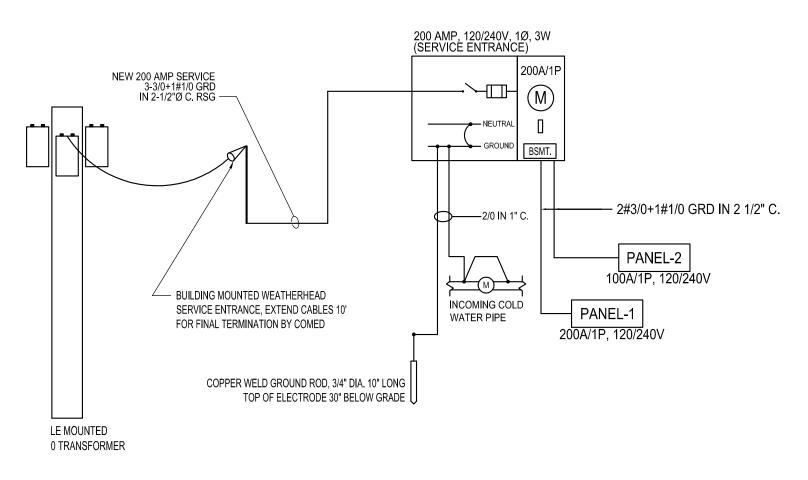

ELECTRICAL SINGLE LINE DIAGRAM

CALCULATION FOR ELECTRICAL SERVICE
IOUTINO*

LIGHTING*

Basement 1,272 Sq.Ft. x 3 (W per Sq.Ft.)= 3,816 W 1st Floor 1,543 Sq.Ft. x 3 (W per Sq.Ft.) = 4,629 W 2nd Floor 1,510 Sq.Ft. x 3 (W per Sq.Ft.) = 4,530 W

Basement 1,272 Sq.Ft. x 4 (W per Sq.Ft.)= 5,088 W 1st Floor 1,543 Sq.Ft. x 4 (W per Sq.Ft.) = 6,172 W 2nd Floor 1,510 Sq.Ft. x 4 (W per Sq.Ft.) = 6,040 W

MOTOR LOAD @ 100%=..... 18,000 W

(52,775 W/240V)*0.80 = 176 AMPS

TOTAL LOAD 52,775 W

SELECTED 200 AMPS


*FROM MECHANICAL AND ELECTRICAL SYSTEMS IN BUILDINGS BY

RICHARD R. LEWIS AND ALD. TABLE 13-3 PG. 419

	ELECTRICAL SYMBO	OL LIST	Γ
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
\$	NEW SINGLE POLE LIGHT SWITCH 4'-0" ABOVE FINISH FLOOR (TYP.)	F2 ©	NEW RECESSED CAN LIGHT
SD	NEW CEILING MOUNTED HARDWIRED SMOKE DETECTOR W/BATTERY BACK UP	F3]- (>	NEW WALL MOUNTED LIGHT FIXTURE
СО	NEW CEILING-MTD HARDWIRED CARBON MONOXIDE DETECTOR W/BATTERY BACK UP	F4]- (>	NEW WALL MOUNTED WEATHERPROOF LIGHT FIXTURE "MS" TAG FOR MOTION SENSOR ACTIVATED FIXTURES.
	NEW EXHAUST FAN - SINGLE PHASE	F5 +	NEW CEILING MOUNTED PENDANT LIGHT FIXTURE
ф	NEW 120V. 1Ø. WALL-MOUNTED DUPLEX GROUND OUTLET 19" ABOVE FLOOR (TYP.)		NEW ELECTRICAL PANEL
∯ ^{GFI}	NEW 120V. 1Q/ WALL-MOUNTED DUPLEX GROUND FAULTED INTERRUPTOR OUTLET		NEW ELECTRICAL METER
∯ ^{ARC}	NEW 120V. 1Ø WALL-MOUNTED DUPLEX ARC-FAULTED INTERRUPTOR OUTLET		EMERGENCY LIGHT w/ BATTERY BACK-UP
F1 🂢	NEW CEILING MOUNTED LIGHT FIXTURE. "PC" TAG FOR PHOTOVOLTAIC SENSOR ACTIVATED FIXTURES.	8	EXIT SIGN w/ BATTERY BACK-UP

			PANELBO	DARD SC	HE	EDUL	E, PANE	L-1		
PAN	EL MTG	i.	WALL MOUNTED	VOLTAGE		120/240) V	PANEL DIMENS	SIONS	
MAIN	I FUSE		200 AMP BREAKER	LOCATION		BASEME	:NT	HEIGHT	AS R	EQ'D.
MAIN	1 S			PHASE		1Ø (3W)	WIDTH		
LUG	S			FEEDER SIZE		SEE ONE	LINE DIAGRAM	DEPTH		
No. (OF CCT	s.	30	SERVED FROI	VI	METER	1	CONN. LOAD	38.95	KW
GR.	BAR		YES	DESIGNED LO	D LOAD 48.00 KW		(W			
ISO.	GR.		NO							
CCT. No.	CCT. AMP			A WATTS	,	B WATTS			CCT. AMP	CCT. No.
1	15	GE	N. LIGHTING (BSMT.)	2112		GEN. LI		HTING (BSMT.)	15	2
3	15	GE	N. LIGHTING (BSMT.)			2112	GEN. LIG	HTING (BSMT.)	15	4
5	15		N. LIGHTING (1st FL.)	2112			GEN. LIGHTING (1st FL.)		15	6
7	15		N. LIGHTING (1st FL.)			2112 GEN. LI		HTING (1st FL.)	15	8
9	15		N. LIGHTING (1st FL.)	2112		GEN. LI		HTING (1st FL.)	15	10
11	20		CEPTACLE (BSMT.)			2480		TACLE (BSMT.)	20	12
13	20		CEPTACLE (BSMT.)	2480				TACLE (BSMT.)	20	14
15	20		CEPTACLE (1st FL.)			2480		TACLE (1st FL.)	20	16
17	20		CEPTACLE (1st FL.)	2480				TACLE (1st FL.)	20	18
19	20		CEPTACLE (1st FL.)			2480		TACLE (1st FL.)	20	20
21	20		MT. EQUIPMENT	220		2770		OR EQUIPMENT	20	22
23 25	40/	DC	OUBLE OVEN	4000		2//0		VC UNIT (CU-1)	15 60 /	24 26
27	40	ELL	RNACE (FUR-1)	4000	\vdash	4500	<u> </u>	AC ONT (CO-1)	100/	28
29	7	10	THACL (LOIG-1)	4500		+000			 / _	30
			TOTAL WATTS / PHASE			18,934				- 55
					<u> </u>		TOTA	AL CONN. LOAD	38.9	5 KW
			DEMAND FAC	TOR 0.81						
			SPARE LOAD FACT	TOR 0.19				•		
REM.	ARKS:									

			PANELB	<u> </u>	יועט טט	1 I L	-DOLI	_, /\INL	L- <u>-</u> L		
PAN	EL MTG	i.	WALL MOUNTED	\	OLTAGE		120/240) V	PANEL DIMENS	SIONS	
MAIN	I FUSE		100 AMP BREAKER	L	OCATION		SECONE	FLOOR	HEIGHT	AS RI	EQ'D
MAIN	IS			F	HASE		1Ø (3W)	WIDTH		
LUG	S			F	EEDER SIZE		SEE ONE	LINE DIAGRAM	DEPTH		
No. (OF CCT	S.	20	5	ERVED FROM	vI	METER		CONN. LOAD	23.43	KW
GR. BAR YES		YES	1 .	DESIGNED LOAD		24.00 KW					
ISO.	GR.		NO	▮							
CCT.	CCT.	1		"	A WATTS	<u> </u>	B WATTS			CCT.	CC'
1	15	GE	N. LIGHTING (2nd FL.)		1943	\mathbb{Z}	/////	GEN. LIG	HTING (2nd FL.)	15	2
3	15	GE	N. LIGHTING (2nd FL.)				1943	GEN. LIG	HTING (2nd FL.)	15	4
5	15	GE	N. LIGHTING (2nd FL.)		1943	\mathbb{Z}		GEN. LIG	HTING (2nd FL.)	15	6
7	20		CEPTACLE (2nd FL.)		<u>/////</u>	L	2100		TACLE (2nd FL.)	20	8
9	20		CEPTACLE (2nd FL.)		2100	\mathbb{Z}	<u>////</u>		TACLE (2nd FL.)	20	10
11	20		CEPTACLE (2nd FL.)		<u>//////</u>	L	2100		TACLE (2nd FL.)	20	12
13	20	_	CEPTACLE (2nd FL.)		2100	\mathbb{Z}	<u>////</u>	RECEP'	TACLE (2nd FL.)	20	14
15	20		d FL. EQUIPMENT	_[<u>//////</u>	Ļ	2200		A/C UNIT	60/	1 16
17	40/	FU	RNACE	_	3500	\swarrow	////			$+ \angle$	18
19				-[<u>//////</u>	⊢	3500			<u> </u>	20
			TOTAL WATTS / PHASI	E	11,586		11,843				
								TOTA	AL CONN. LOAD	23.4	3 KV
			DEMAND FAC	TOF	R 0.98						
			SPARE LOAD FAC	TOF	R 0.02						

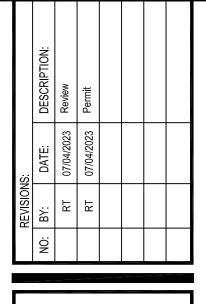

convert 2-Unit to Single Family Residence. Interior Rehab & New 2-Story Frame Addition including New Partitions, New Electrical, Mechanical & Plumbing Systems, New Roof System & New Rear Deck & Balcony per Plans. 223 Center Street, Naperville Illinois 60540

R.T. ARCHITECT INC

RADULE TEPAVCEVIC 7501 BROWN AVE., SUITE A FOREST PARK, IL 60130 TEL.: (312) 217-8653 rtepavcevic@aol.com PROJECT ARCHITECT:

DRAFTPERSON: APPROVED:


PREPARED FOR:


OWNER LOCATION: 223 Center Street Naperville, IL 60540 JOB NUMBER:

223CS-07042023

Riser Diagram, Load Calc's & Schedules & Panelboards



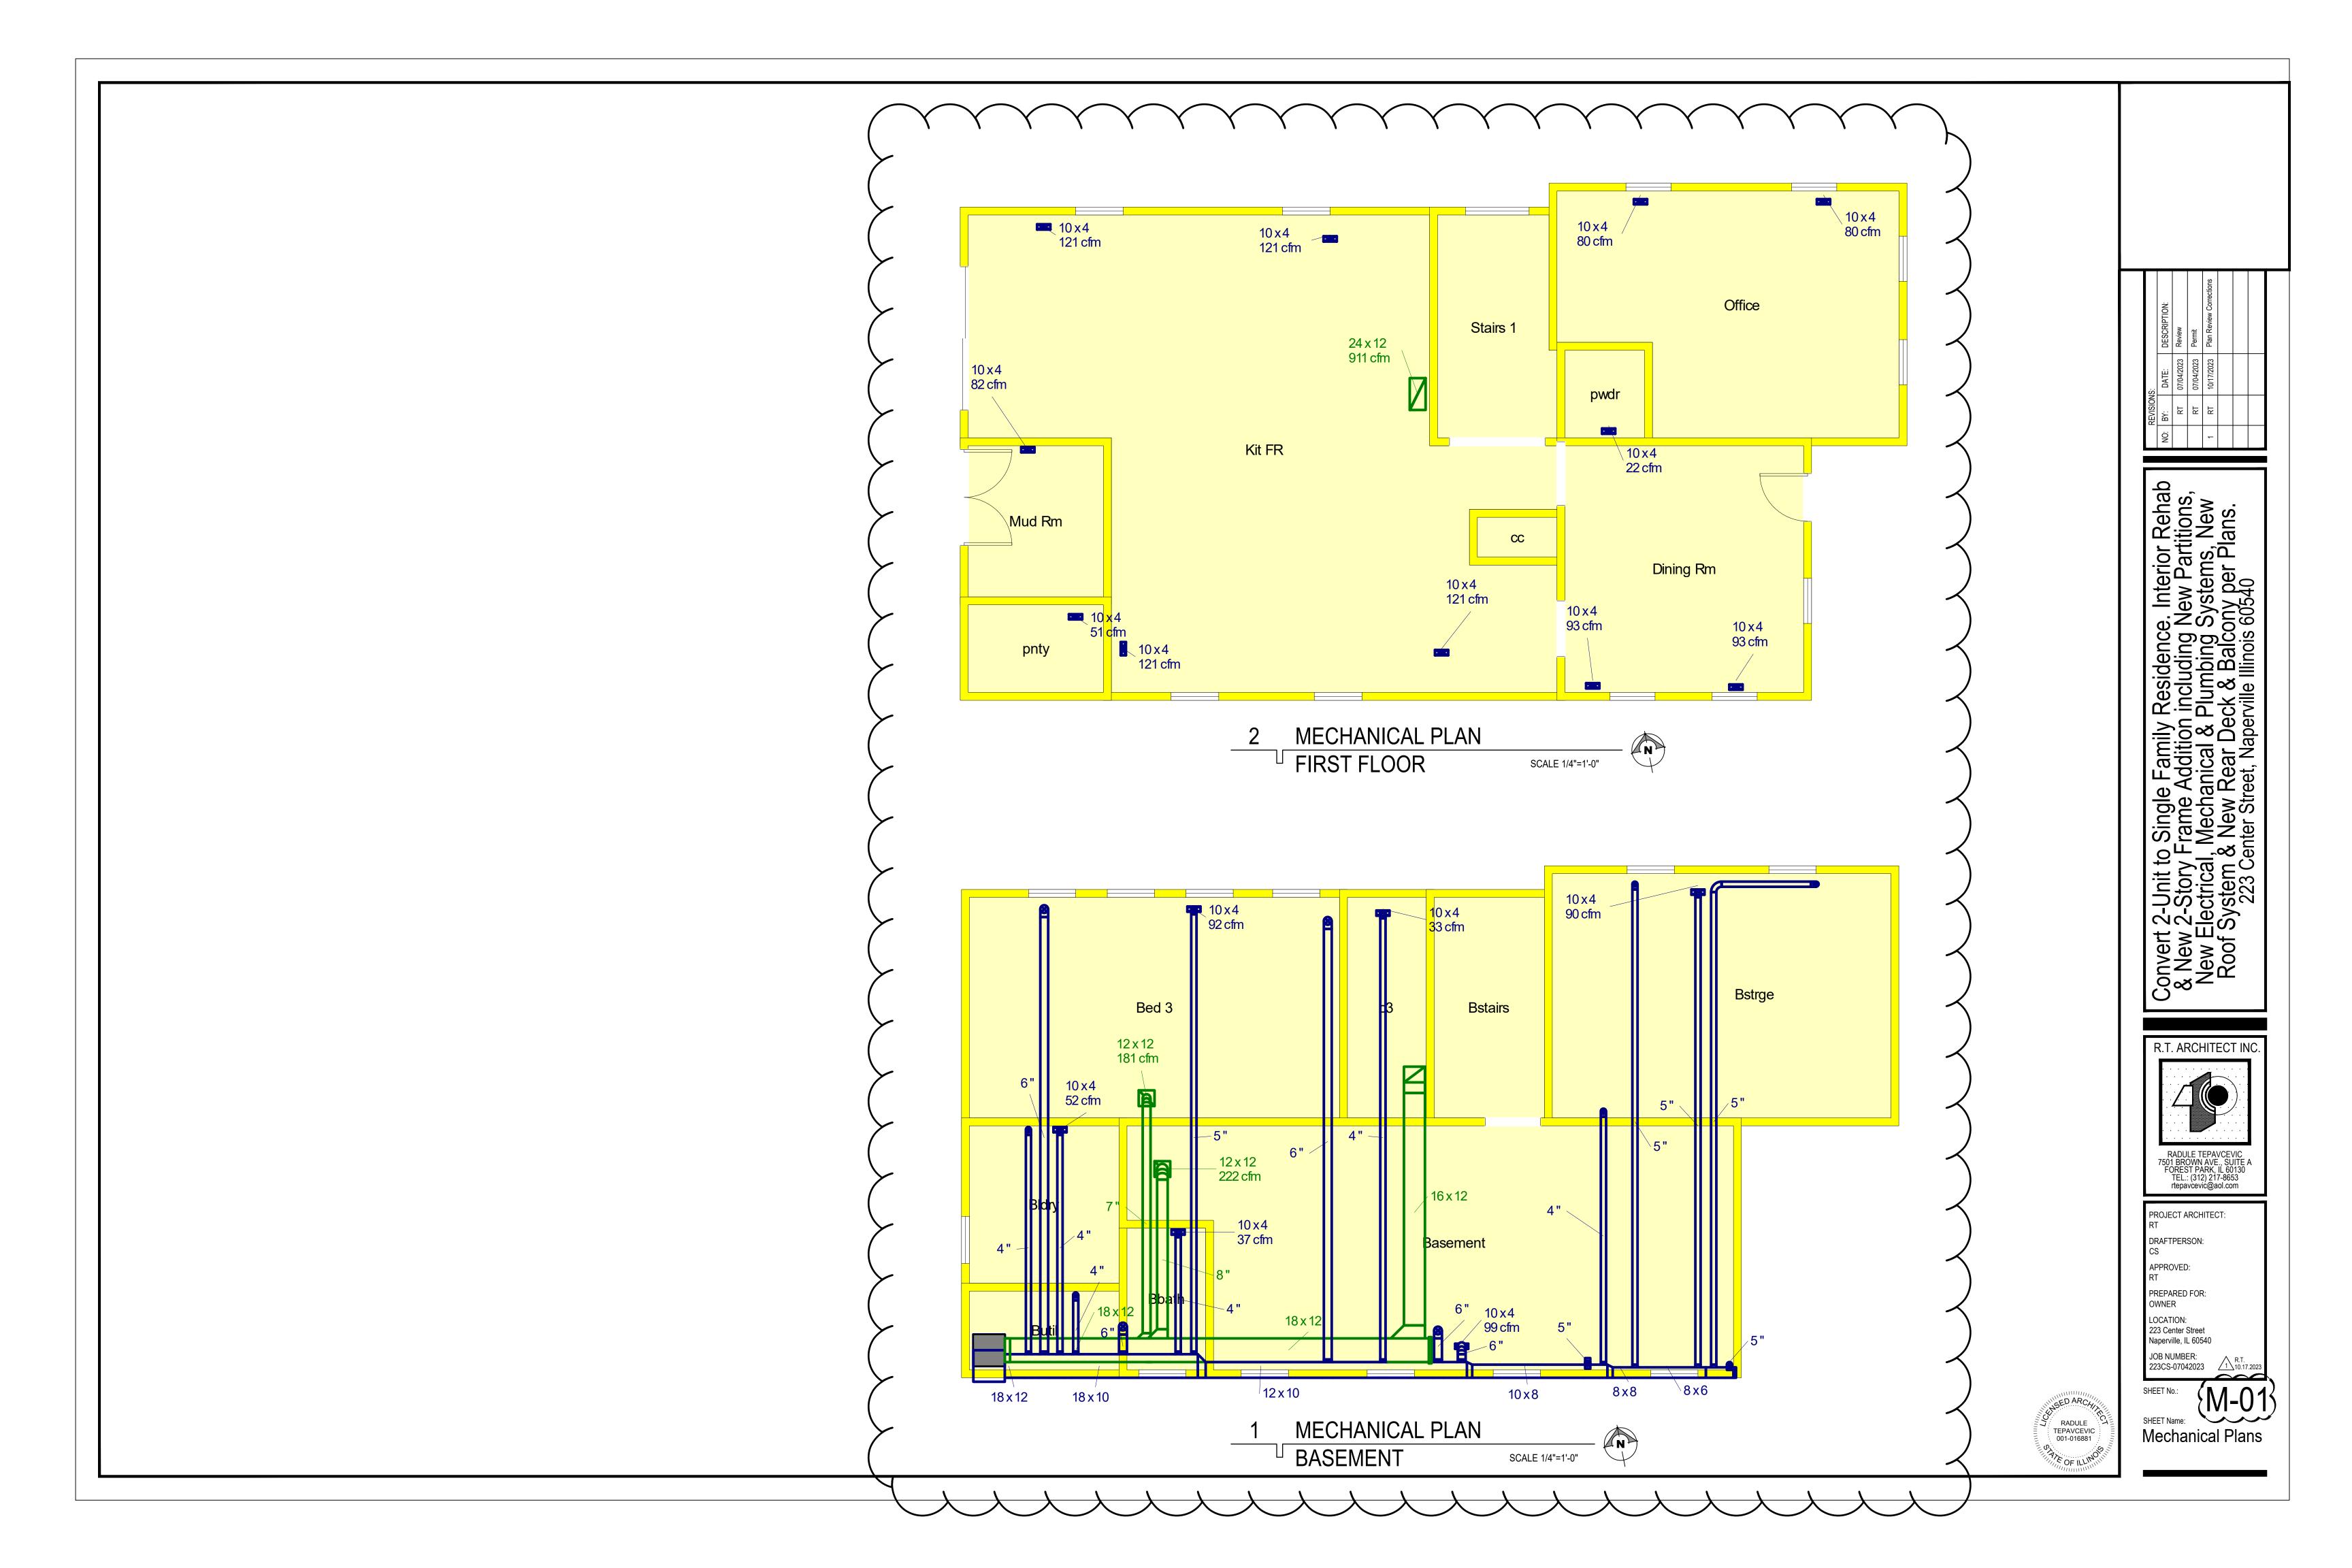

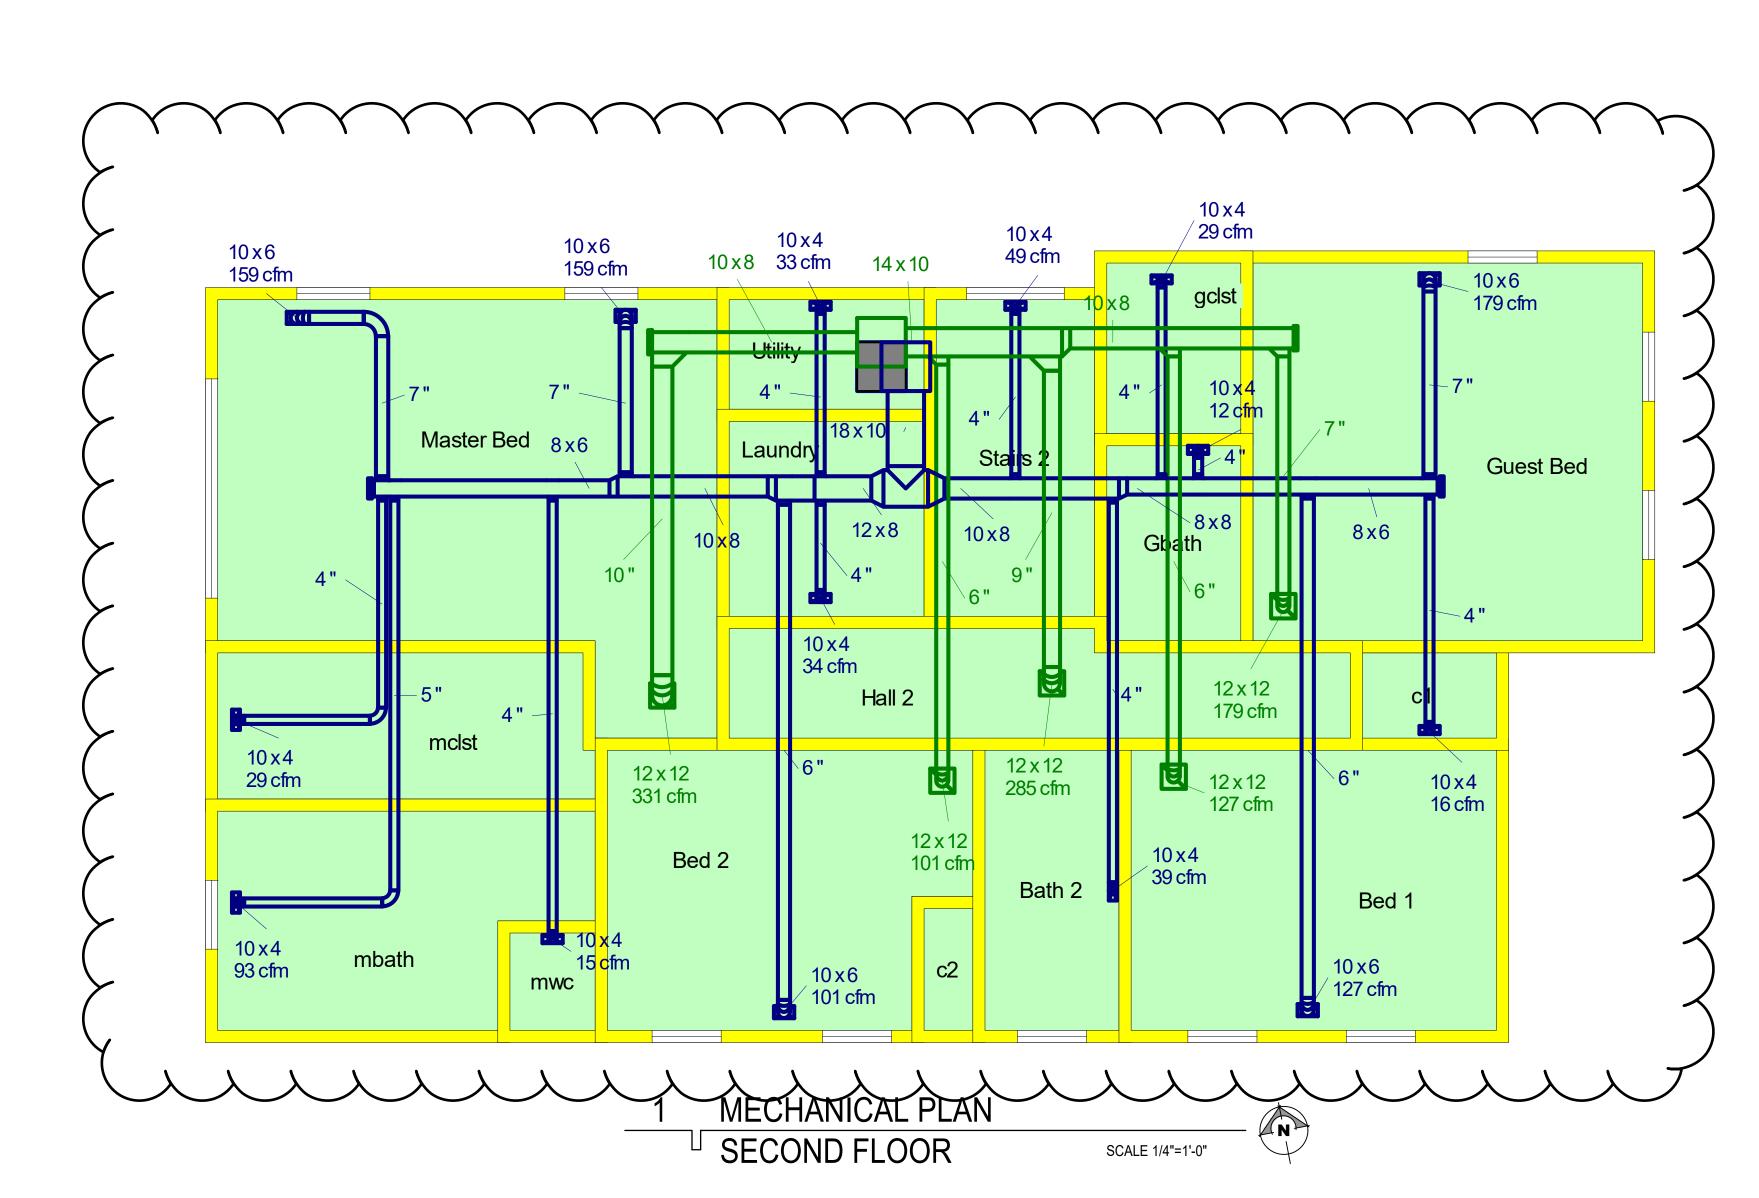



Convert 2-Unit to Single Family Residence. Interior Rehab & New 2-Story Frame Addition including New Partitions, New Electrical, Mechanical & Plumbing Systems, New Roof System & New Rear Deck & Balcony per Plans.


223 Center Street, Naperville Illinois 60540

R.T. ARCHITECT INC. RADULE TEPAVCEVIC 7501 BROWN AVE., SUITE A FOREST PARK, IL 60130 TEL.: (312) 217-8653 rtepavcevic@aol.com

> PROJECT ARCHITECT: DRAFTPERSON: APPROVED: PREPARED FOR:

OWNER LOCATION: 223 Center Street Naperville, IL 60540 JOB NUMBER: 223CS-07042023 10.17.2023

SHEET Name: Mechanical Plans

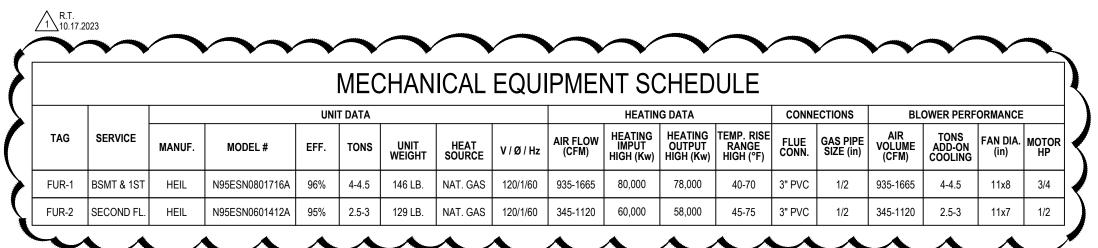

1. ALL FURNACES TO BE PROVIDED WITH PLENUM MOUNTED HUMIDIFIER, APRIL AIR MDL. #550, WITH ALL NECESSAI WATER & DRAIN PIPING; INTERLOCK TO HEATING CYCLE.

ALL FURNACE UNITS TO BE PROVIDED WITH ROOM THERMOSTAT AND SUBBASE WITH ALL CONTROL WIRING.
 ALL EXHAUST FANS TO BE PROVIDED WITH INTEGRATED DAMPER.

EXHAUST FAINS TO BE PROVIDED WITH INTEGRATED DANIFER.

			REF	RIGER	RATIO	N SC	HE	DULE	<u> </u>			
TAC	SERVICE	COMP.	COMP. HP	DEEDIG	WT	MOTE	SELF CONT.	LOCAT	IIA I	- 1	VATER S	SPECIAL
CU-1 BSMT. & PER ATTACHED MANUAL J, SEE SHEET M-04 FOR SUMMARY												
CU-	2 2ND FL.											
		•	EVI	<u> </u>		,						
			EXI	HAUS ⁻		,		ULE		ELE	ECTRICAL I	DATA
TAG	SYSTEM	LOCATION	EXI	HAUST		,				un	ECTRICAL [
TAG	SYSTEM BATH EXHAUST				ΓFAN	SCH	PERI	FORMANCE	DISCHARGE	HP or		DATA AMPS

	MECHANICAL SYMBOL LIST
SYMBOL	DESCRIPTION
<u></u>	NEW 10"x6" CLG-MTD. SUPPLY DIFFUSER WITH ADJUSTABLE LOUVERED SCREEN
	NEW 10"x6" FLOOR-MTD. SUPPLY DIFFUSER WITH ADJUSTABLE LOUVERED SCREEN
	NEW CEILING-MTD. RETURN GRILL, SIZE AS SPECIFIED
	NEW WALL-MTD. RETURN GRILL, SIZE AS SPECIFIED
	NEW FURNACE, REFER TO EQUIP. SCHEDULE FOR SPECS.
(SD)	NEW CEILING MOUNTED HARDWIRED SMOKE DETECTOR W/BATTERY BACK UP
CO	NEW CEILING-MTD HARDWIRED CARBON MONOXIDE DETECTOR W/BATTERY BACK UP
	NEW EXHAUST FAN
8"Ø	NEW SUPPLY DUCT, SIZE AS SPECIFIED, REFER TO SHEET METAL NOTES
_22"x8"-R _	NEW RETURN DUCT, SIZE AS SPECIFIED, REFER TO SHEET METAL NOTES
	NEW VOLUME DAMPER
< □ →	NEW SUPPLY DIFFUSER WITH VOLUME DAMPER

MECHANICAL GENERAL NOTES

- 1. ALL NEW MECHANICAL WORK SHALL COMPLY WITH STATE AND VILLAGE BUILDING CODES, LATEST EDITION, AND SHALL BE LEFT IN PERFECT OPERATING CONDITIONS.
- 2. PROVIDE GAS SERVICE WITH SHUT-OFF VALVE TO ALL GAS FIRED EQUIPMENT. ALL GAS PIPING SHALL BE BLACK STEEL SCHEDULE 40 WITH MALLEABLE FITTINGS.
- PROVIDE VOLUME DAMPERS AT ALL DUCTWORK SUPPLY LINES.
 ALL GAS LINES MUST BE PRESSURE TESTED.
- 5. THE CONTRACTOR SHALL CONFORM TO ALL APPLICABLE OSHA STANDARDS.6. THIS CONTRACTOR SHALL COORDINATE WORK WITH GENERAL CONTRACTOR AND ALL
- OTHER TRADES TO AVOID INTERFERENCE DURING CONSTRUCTION.

 7. ALL CONTROL WIRING SHALL BE BY THIS CONTRACTOR.
- ALL REFRIGERANT PIPING SHALL BE INSULATED WITH 1/2" ARMAFLEX.
- 9. PROVIDE CARBON MONOXIDE DETECTORS AS SPECIFIED ON DRAWINGS.
- 10. DUCTWORK PENETRATIONS THRU WALLS /CEILING BETWEEN CONFINED SPACES MUST BE TIGHT-SEALED TO PREVENT FIRE SPREADING.
- MECHANICAL CONTRACTOR.

 12. ALL EQUIPMENT MUST BE AS SPECIFIED OR EQUAL IN IT'S PERFORMANCE, CAPACITY AND

11. MECHANICAL DRAWINGS ARE SCHEMATIC FOR PERMIT PROCESS ONLY, VERIFY WITH

- APPROVED BY THE VILLAGE.

 13. COMBUSTION AIR DUCTS SHALL BE OF GALVANIZED STEEL, SERVE A SINGLE APPLIANCE
- ENCLOSURE AND MUST CONFORM WITH THE VILLAGE CODE.

 14. ANY CHANGE OR DEVIATION IN THE MECHANICAL SPECIFICATIONS MUST BE SUBMITTED
- IN WRITING TO THE ENGINEER/ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.

 15. DOWNFLOW EXHAUST DUCTS NOT PERMITTED.

SHEET METAL NOTES

- 1. ALL DUCTWORK MUST BE GALVANIZED IRON, GAUGES PER ASHRAE GUIDE, UNLESS OTHERWISE NOTED. ALL SQUARE ELBOWS TO HAVE DOUBLE THICKNESS TYPE TURNING VANES. UNLESS OTHERWISE NOTED, ALL ROUND ELBOWS SHALL HAVE INSIDE RADIUS EQUAL TO 75% OF DUCT WIDTH. MANUAL VOLUME DAMPERS TO HAVE LOCKING QUADRANT.
- DIFFUSER, GRILLES, AND REGISTERS: EACH REGISTER SHALL BE FURNISHED WITH AN OPPOSING BLADE VOLUME DAMPER WITH ADJUSTABLE AIR RETURN LOUVER.
 ALL DUCTWORK IN UNHEATED AREAS SHALL BE ADEQUATELY PROTECTED AGAINTS THE

VENT NOTES

- 1. VENTS SHALL TERMINATE NOT LESS THAN 2 FEET ABOVE THE HIGHEST POINT OF THE ROOF PENETRATION AND NOT LESS THAN 2 FEET HIGHER THAN ANY PORTION OF A BUILDING WITHIN 10 FEET.
- 2. HORIZONTAL TERMINATIONS FOR VENTS ARE PERMITTED ON CATEGORY IV APPLIANCES ONLY AND SHALL BE LOCATED PER APPLICABLE CODE.

COMBUSTION AIR DUCTS

COMBUSTION AIR DUCTS SHALL:

1. BE OF GALVANIZED STEEL COMPLYING WITH CHAPTER 6 OR OF EQUIVALENT

- CORROSION-RESISTANT MATERIAL APPROVED FOR THIS APPLICATION.

 2. HAVE A MINIMUM CROSS-SECTIONAL DIMENSION OF 3 INCHES.
- TERMINATE IN AN UNOBSTRUCTED SPACE ALLOWING FREE MOVEMENT OF COMBUSTION AIR TO THE APPLIANCES.
 HAVE THE SAME CROSS-SECTIONAL AREAS AS THE FREE AREA OF THE OPENINGS TO
- WHICH THEY CONNECT.

 5. SERVE A SINGLE APPLIANCE ENCLOSURE.
- NOT SLOPE DOWNWARD TOWARD THE SOURCE OF COMBUSTION AIR.

REFRIGERATION NOTES


REFRIGERATION PIPING:

1. COPPER TUBING MAY BE TYPE ACR OR TYPE "K" UNLESS THE PRESSURE EXCEEDS THE

- RATED CAPACITY OF ACR TUBING.
 2. ALL JOINTS & CONNECTIONS TO BE BRAZED
- REMOVE EXPANSION VALVES, DEVICES, AND CONNECTIONS FROM THE AIR STREAM.
 INSTALL PRESSURE RELIEF VALVE ON HIGH PRESSURE SIDE OF SYSTEM, UPSTREAM OF ANY INTERVENING VALVES.


CONDENSATE PIPING NOTES

 FUEL-BURNING, EVAPORATIVE & COOLING DEVICES THAT PRODUCE CONDENSATING MUST BE DRAINED. CONDENSATE SHALL BE COLLECTED AND DISCHAGED TO AN APPROVED PLACE OF DISPOSAL. CONDENSATE PIPING SHALL BE TYPE M COPPER OR SCHEDULE 40 PVC AND SHALL NOT BE SMALLER THAN THE DRAIN CONNECTION ON THE APPLIANCE SUCH PIPE SHALL MAINTAIN A MIN. HORIZONTAL SLOPE IN THE DIRECTION OF DISCHARGE OF NOT LESS THAN ONE-EIGHT UNIT VERTICAL IN 12 UNITS HORIZ.
 OVERFLOW DRAINS SHOULD DISCHARGE IN A CONSPICUOUS LOCATION.

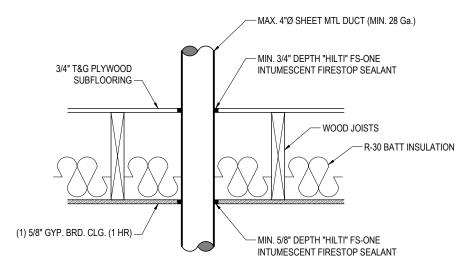


2 METAL DUCT THRU-PENETRATION

FIRE STOP SYSTEM # FC-7013, 1 HR. RATING NTS

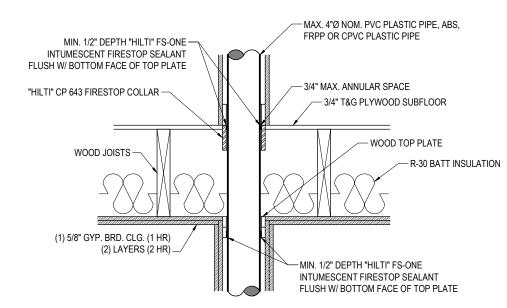


3 PLASTIC PIPE THRU-PENETRATION FIRE STOP SYSTEM # FC-2025, 1 & 2 HR. RATING NTS

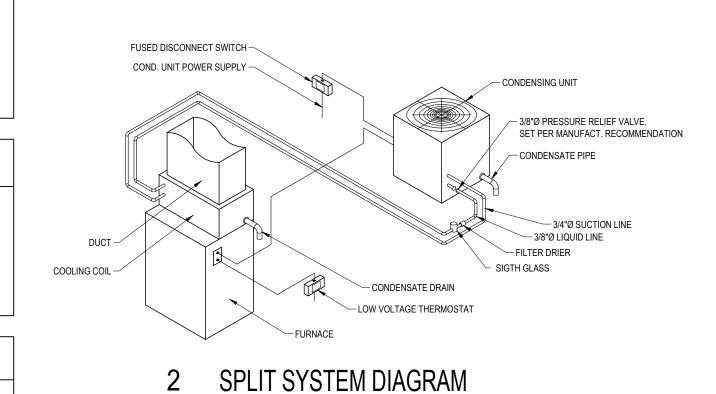




NTS



Convert 2-Unit to Single Family Residence. Interior Rehab & New 2-Story Frame Addition including New Partitions, New Electrical, Mechanical & Plumbing Systems, New Roof System & New Rear Deck & Balcony per Plans.

223 Center Street, Naperville Illinois 60540



PROJECT ARCHITECT:
RT

DRAFTPERSON:
CS


APPROVED:
RT

PREPARED FOR:
OWNER

LOCATION:
223 Center Street
Naperville, IL 60540

JOB NUMBER:
223CS-07042023



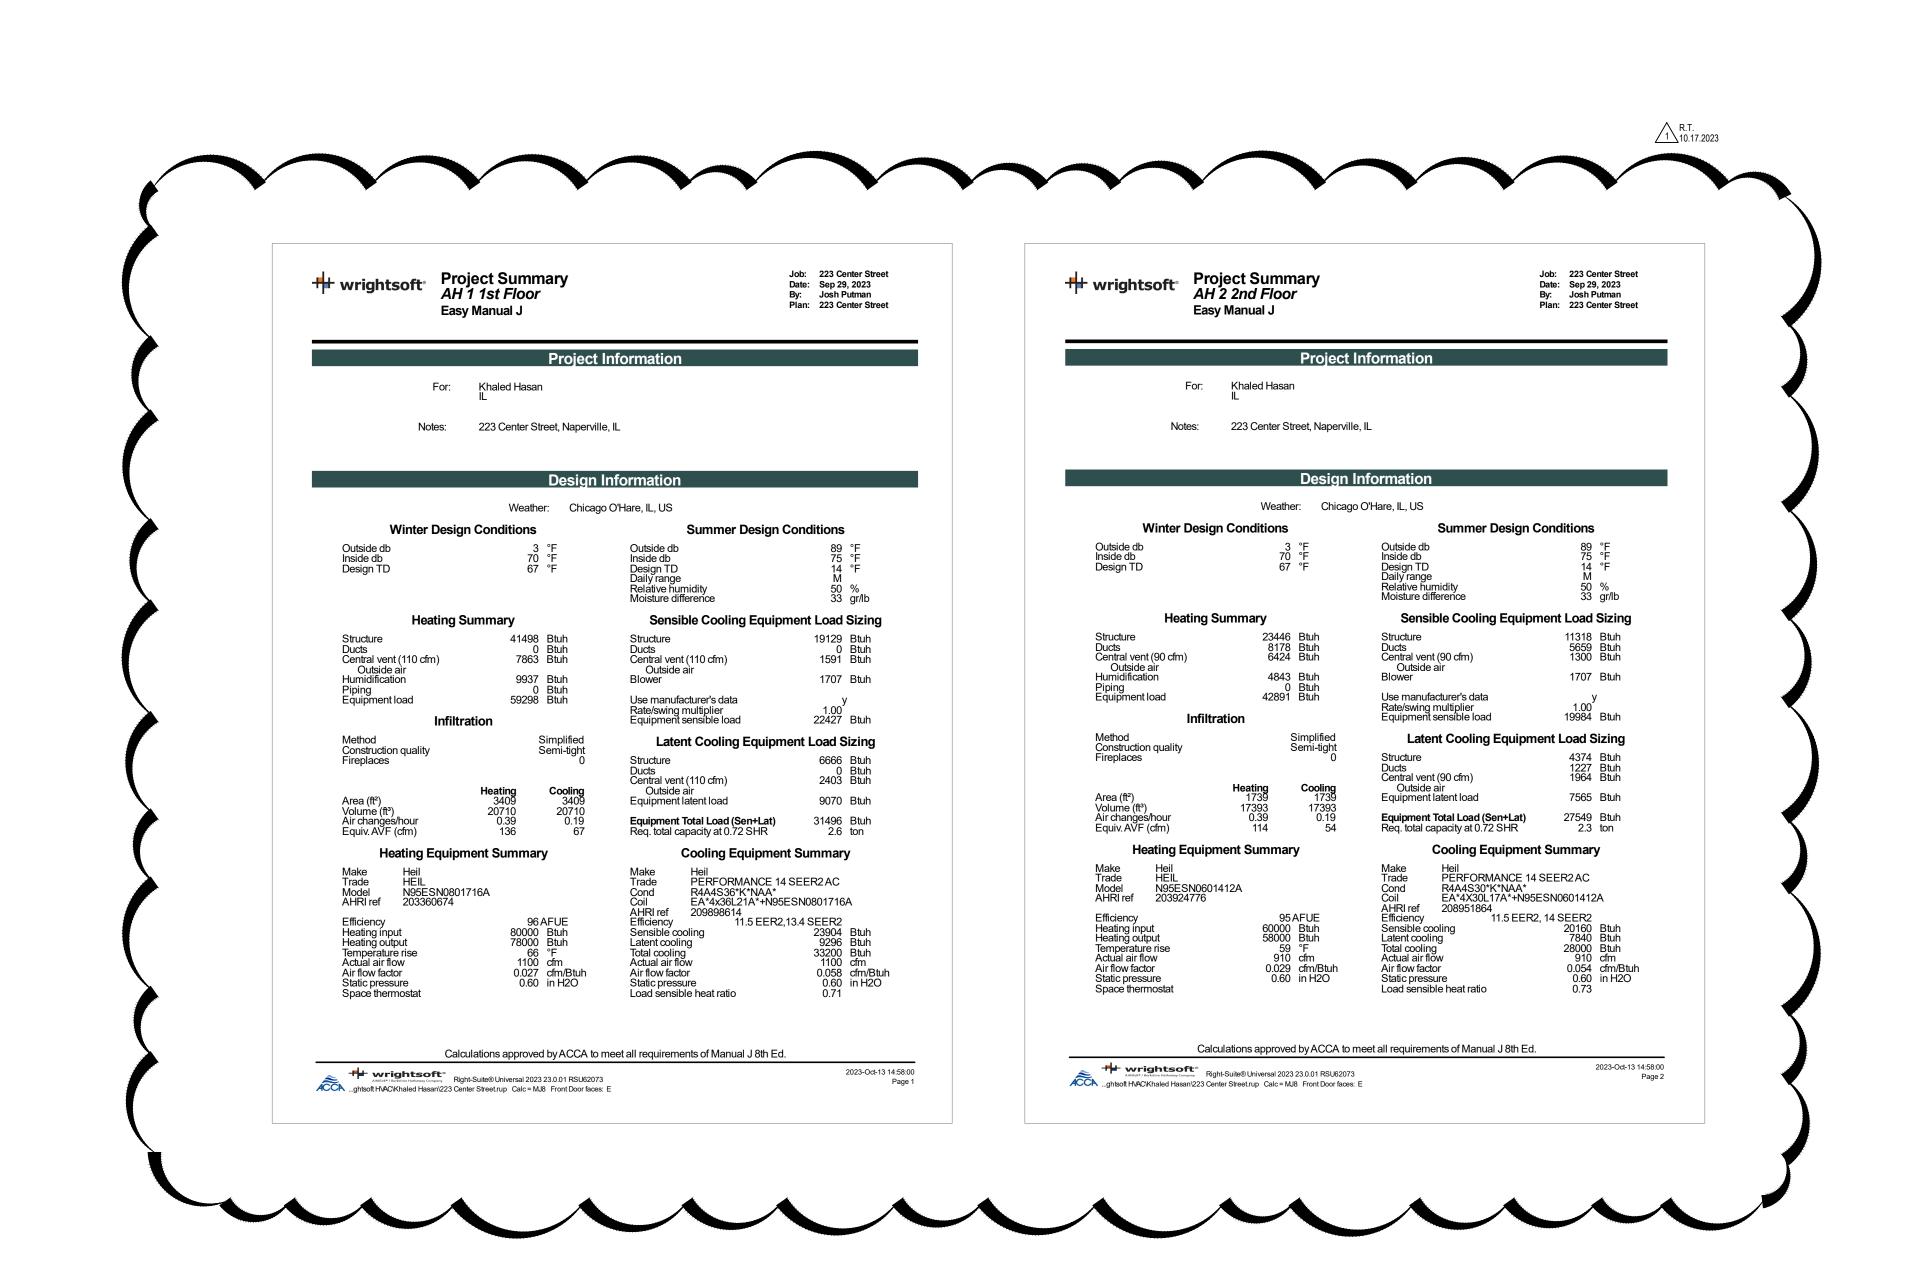



Sonvert 2-Unit to Single Family Residence. Interior Rehab & New 2-Story Frame Addition including New Partitions, New Electrical, Mechanical & Plumbing Systems, New Roof System & New Rear Deck & Balcony per Plans.

223 Center Street, Naperville Illinois 60540

R.T. ARCHITECT INC RADULE TEPAVCEVIC 7501 BROWN AVE., SUITE A FOREST PARK, IL 60130 TEL.: (312) 217-8653 rtepavcevic@aol.com

PROJECT ARCHITECT: DRAFTPERSON: APPROVED:

PREPARED FOR: OWNER

LOCATION: 223 Center Street Naperville, IL 60540 JOB NUMBER: 223CS-07042023 /1\10.17.2023

SHEET Name: Manual J **Summary Sheets**