

END VIEW



ACRYLIC FACED INTERNALLY ILLUMINATED (Remote) CHANNEL LETTERS

MANUFACTURE AND INSTALL CHANNEL LETTERS AS SHOWN AND NOTED


SIGN TYPE	A	B	C	AMPS CIRCUITS	SQ.FT.
OPU12-REMOTE-R	1'-0"	10'-11 1/2"	1'-7 3/4"		18.03
OPU14-REMOTE-R	1'-2"	12'-10"	1'-11"		24.59

MATERIAL FINISH COLORS

 MP# 82074LVG (FULL GLOSS)	 2795 LD Red Modified Acrylic (Angles or Equiv.)	 Red	 Sloan Red LED
Returns	Faces	Trimcap/Retainer	Illumination

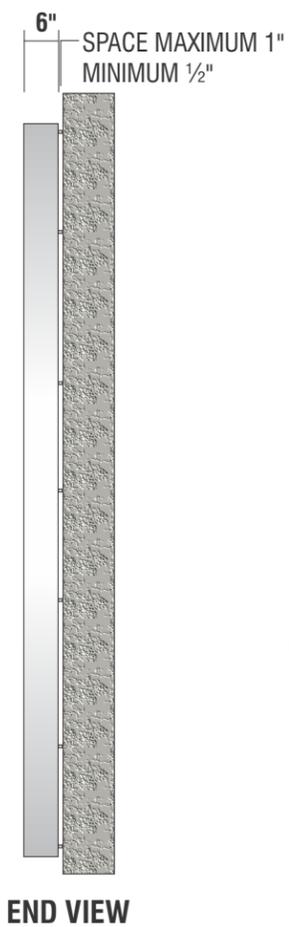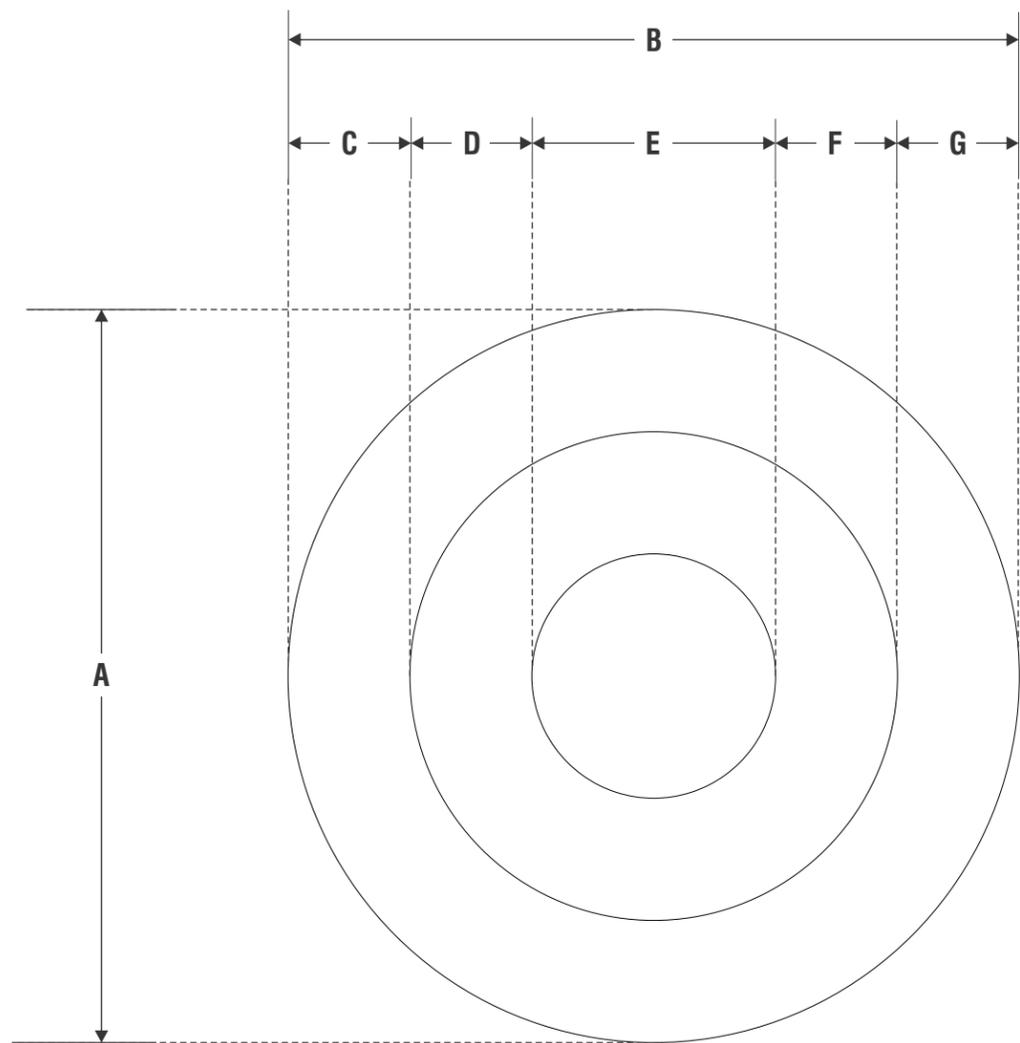

MATERIAL FINISH COLORS			
	WHITE		7328 WHITE ATUGLAS Acrylic
	WHITE		Sloan White LED
Returns		Retainer/Trim-Cap	Illumination

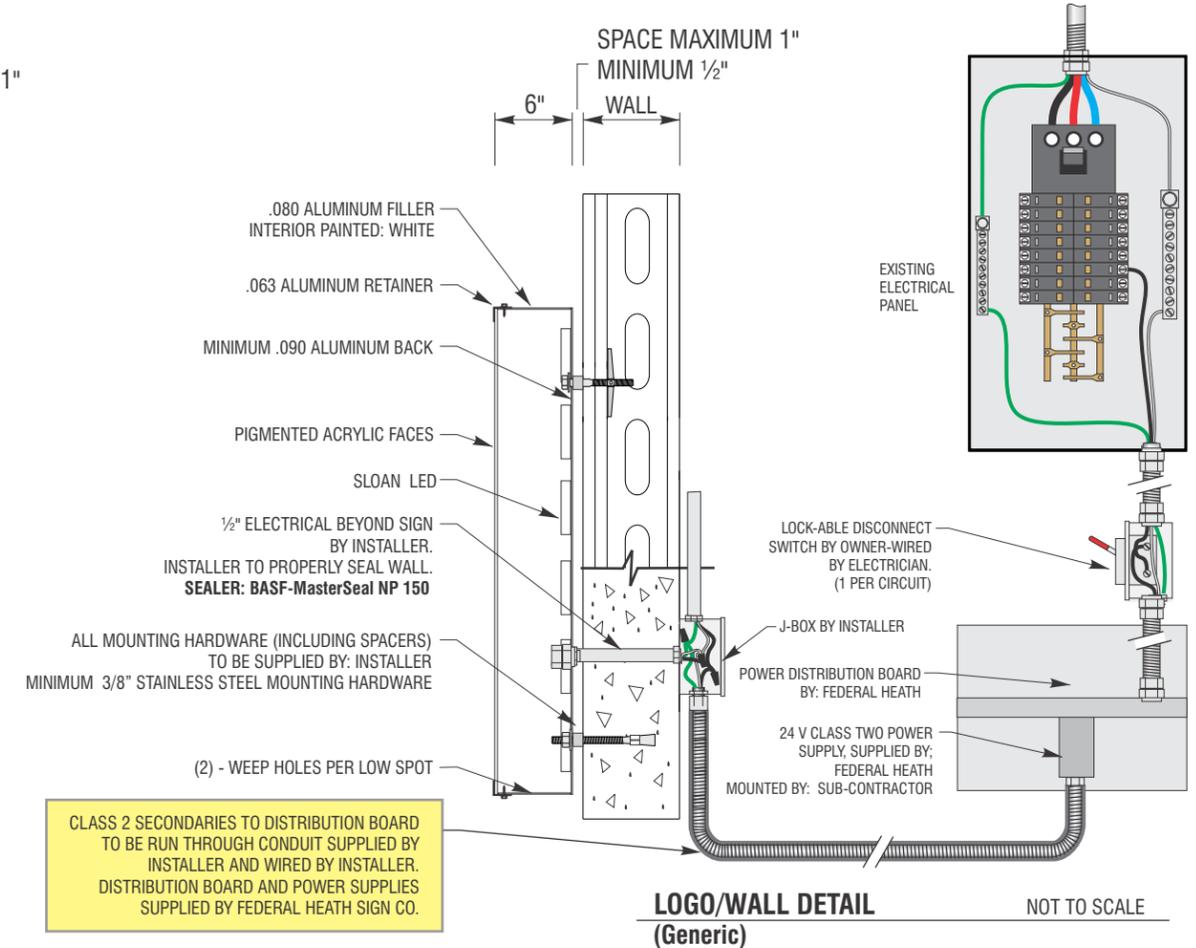

ACRYLIC FACED INTERNALLY ILLUMINATED "BULLSEYE"

MANUFACTURE AND INSTALL CHANNEL LOGO AS SHOWN AND NOTED

SIGN TYPE	A	B	C	D	E	F	G	RETAINER	SQ.FT.	QTY
156 BULLSEYE-W	6'-0"	6'-0"	1'-0"	1'-0"	2'-0"	1'-0"	1'-0"	1"	28.3	1

ELECTRICAL REQUIREMENTS

Total: 0.0 Amps

(1) 120V 20A Circuit Required.

ALL BRANCH CIRCUITS SHALL BE DEDICATED TO SIGNS (INCLUDING GROUND AND NEUTRAL) AND SHALL NOT BE SHARED WITH OTHER LOADS.

CUSTOMER TO PROVIDE DEDICATED BRANCH CIRCUITS FOR SIGNS ONLY PER NEC CODE 600.5

ALL BRANCH CIRCUITS SHALL BE DEDICATED TO SIGNS (INCLUDING GROUND AND NEUTRAL) AND SHALL NOT BE SHARED WITH OTHER LOADS. PROPERLY SIZED GROUND WIRE THAT CAN BE TRACED BACK TO BREAKER PANEL IS REQUIRED.

INSTALLER REQUIREMENTS

ALL MOUNTING HARDWARE, SECONDARY WIRING AND CONDUITS ARE TO BE PROVIDED BY THE INSTALLATION CONTRACTOR. ALL PENETRATIONS IN THE WALL ARE TO BE SEALED WITH SILICONE AND TO BE WATERTIGHT.

ANY DEVIATION FROM FEDERAL HEATH REQUIREMENTS MAY RESULT IN DAMAGE TO OR IMPROPER OPERATION OF SIGNAGE, CAUSING DELAYS AND ADDITIONAL COSTS.

NEW & REMODEL CONSTRUCTION


ADEQUATE BEHIND THE WALL BACKING AND ACCESS IS REQUIRED FOR THE INSTALLATION OF NEW SIGNAGE. CUSTOMER TO FORWARD APPROVED SIGNAGE DRAWINGS TO THE ON SITE CONTACT TO INSURE THAT THE REQUIRED PROVISIONS ARE MADE DURING CONSTRUCTION, PRIOR TO THE SIGN INSTALLATION.

INSTALLER REQUIREMENTS FOR EIFS WALLS

IT IS THE RESPONSIBILITY OF THE INSTALLATION CONTRACTOR TO PROVIDE ANY WALL SPACERS REQUIRED TO KEEP EIFS WALL MATERIAL FROM BEING COMPACTED DURING INSTALLATION OF ANY MOUNTING BOLTS REQUIRED FOR SIGNAGE.

GENERAL NOTE



- INSTALLER SHALL VERIFY WALL CONDITION IN THE FIELD.
- TYPE, SIZE AND NUMBER OF FASTENERS TO BE DETERMINED.
- ALL BOLT HOLES TO BE DRILLED OR PUNCHED.
- ISOLATE ALL ALUMINUM FROM STEEL.

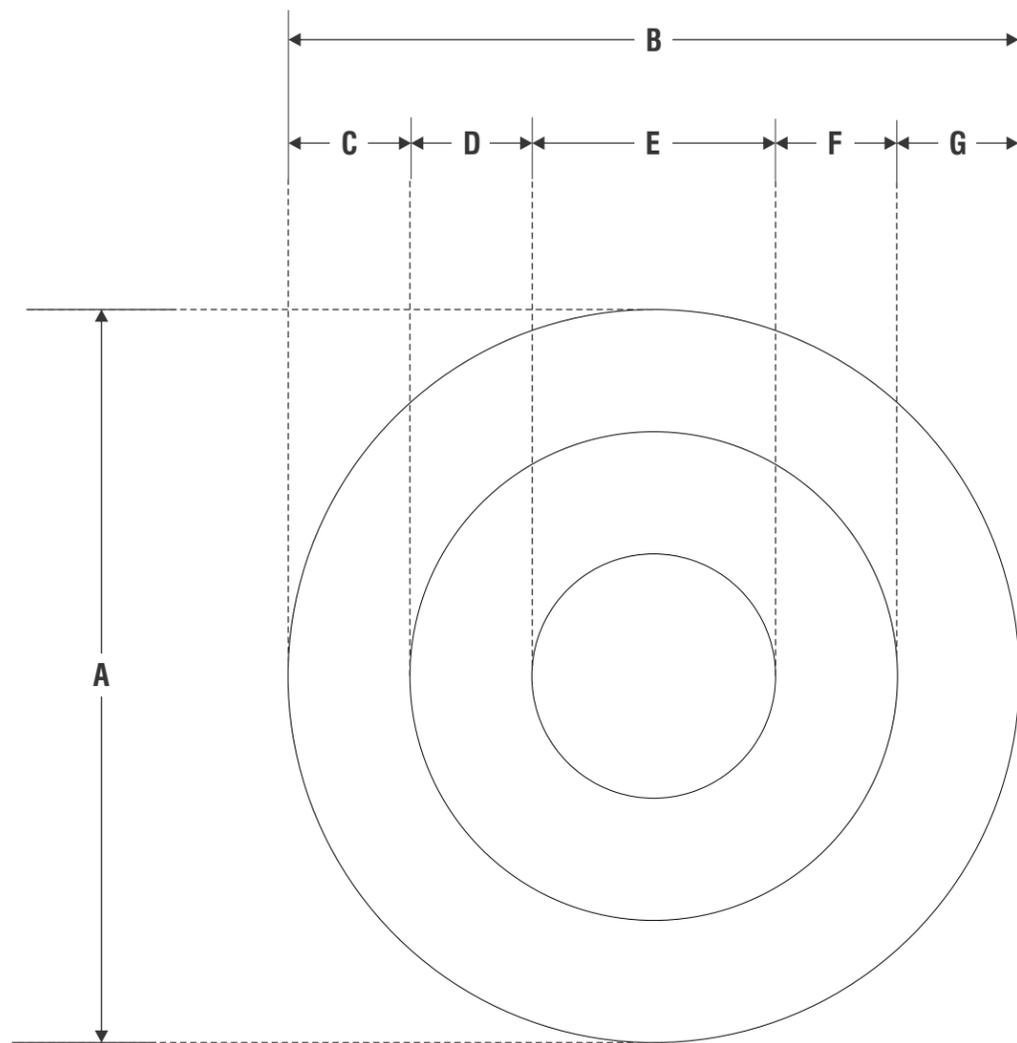

ACRYLIC FACED INTERNALLY ILLUMINATED "BULLSEYE"

MANUFACTURE AND INSTALL CHANNEL LOGO AS SHOWN AND NOTED

SIGN TYPE	A	B	C	D	E	F	G	RETAINER	SQ.FT.	QTY
156 BULLSEYE-W	12'-0"	12'-0"	2'-0"	2'-0"	4'-0"	2'-0"	2'-0"		113.1	1

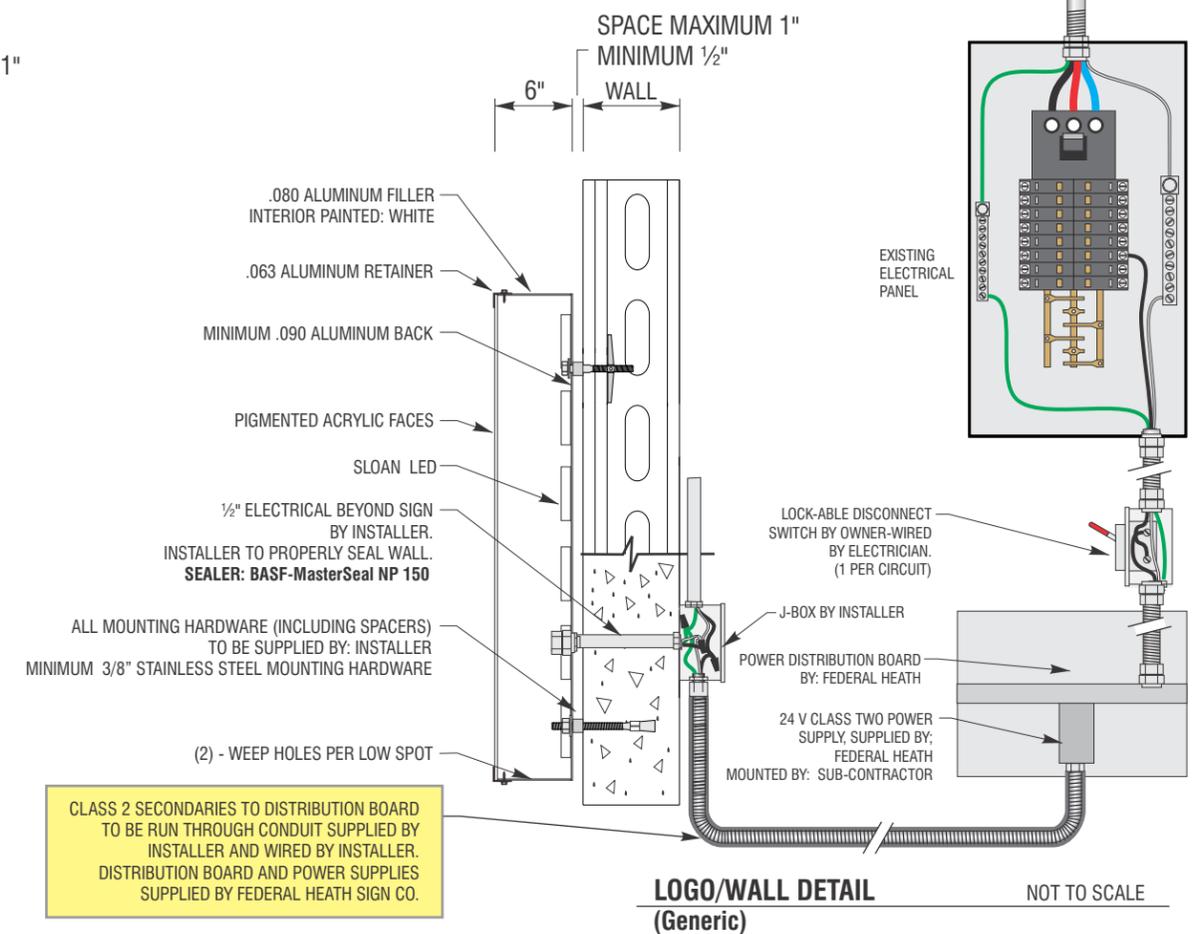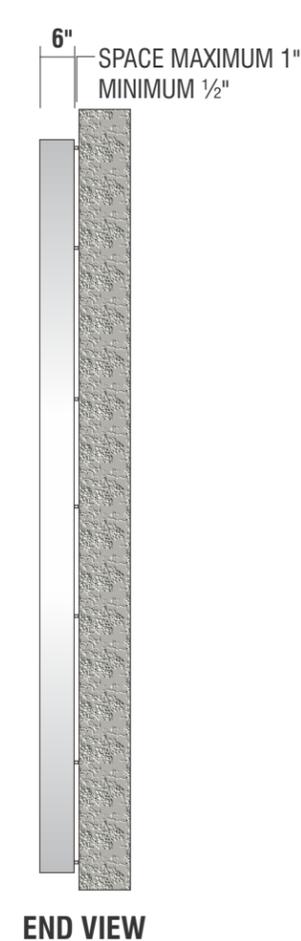

MATERIAL FINISH COLORS

WHITE Returns	7328 WHITE ATUGLAS Acrylic Faces	WHITE Retainer/Trim-Cap	Sloan White LED Illumination
---------------	----------------------------------	-------------------------	------------------------------

ELECTRICAL REQUIREMENTS

Total: 0.0 Amps

(1) 120V 20A Circuit Required.

ALL BRANCH CIRCUITS SHALL BE DEDICATED TO SIGNS (INCLUDING GROUND AND NEUTRAL) AND SHALL NOT BE SHARED WITH OTHER LOADS.

CUSTOMER TO PROVIDE DEDICATED BRANCH CIRCUITS FOR SIGNS ONLY PER NEC CODE 600.5

ALL BRANCH CIRCUITS SHALL BE DEDICATED TO SIGNS (INCLUDING GROUND AND NEUTRAL) AND SHALL NOT BE SHARED WITH OTHER LOADS. PROPERLY SIZED GROUND WIRE THAT CAN BE TRACED BACK TO BREAKER PANEL IS REQUIRED.

INSTALLER REQUIREMENTS

ALL MOUNTING HARDWARE, SECONDARY WIRING AND CONDUITS ARE TO BE PROVIDED BY THE INSTALLATION CONTRACTOR. ALL PENETRATIONS IN THE WALL ARE TO BE SEALED WITH SILICONE AND TO BE WATERTIGHT.

ANY DEVIATION FROM FEDERAL HEATH REQUIREMENTS MAY RESULT IN DAMAGE TO OR IMPROPER OPERATION OF SIGNAGE, CAUSING DELAYS AND ADDITIONAL COSTS.

NEW & REMODEL CONSTRUCTION


ADEQUATE BEHIND THE WALL BACKING AND ACCESS IS REQUIRED FOR THE INSTALLATION OF NEW SIGNAGE. CUSTOMER TO FORWARD APPROVED SIGNAGE DRAWINGS TO THE ON SITE CONTACT TO INSURE THAT THE REQUIRED PROVISIONS ARE MADE DURING CONSTRUCTION, PRIOR TO THE SIGN INSTALLATION.

INSTALLER REQUIREMENTS FOR EIFS WALLS

IT IS THE RESPONSIBILITY OF THE INSTALLATION CONTRACTOR TO PROVIDE ANY WALL SPACERS REQUIRED TO KEEP EIFS WALL MATERIAL FROM BEING COMPACTED DURING INSTALLATION OF ANY MOUNTING BOLTS REQUIRED FOR SIGNAGE.

GENERAL NOTE

- INSTALLER SHALL VERIFY WALL CONDITION IN THE FIELD.
- TYPE, SIZE AND NUMBER OF FASTENERS TO BE DETERMINED.
- ALL BOLT HOLES TO BE DRILLED OR PUNCHED.
- ISOLATE ALL ALUMINUM FROM STEEL.

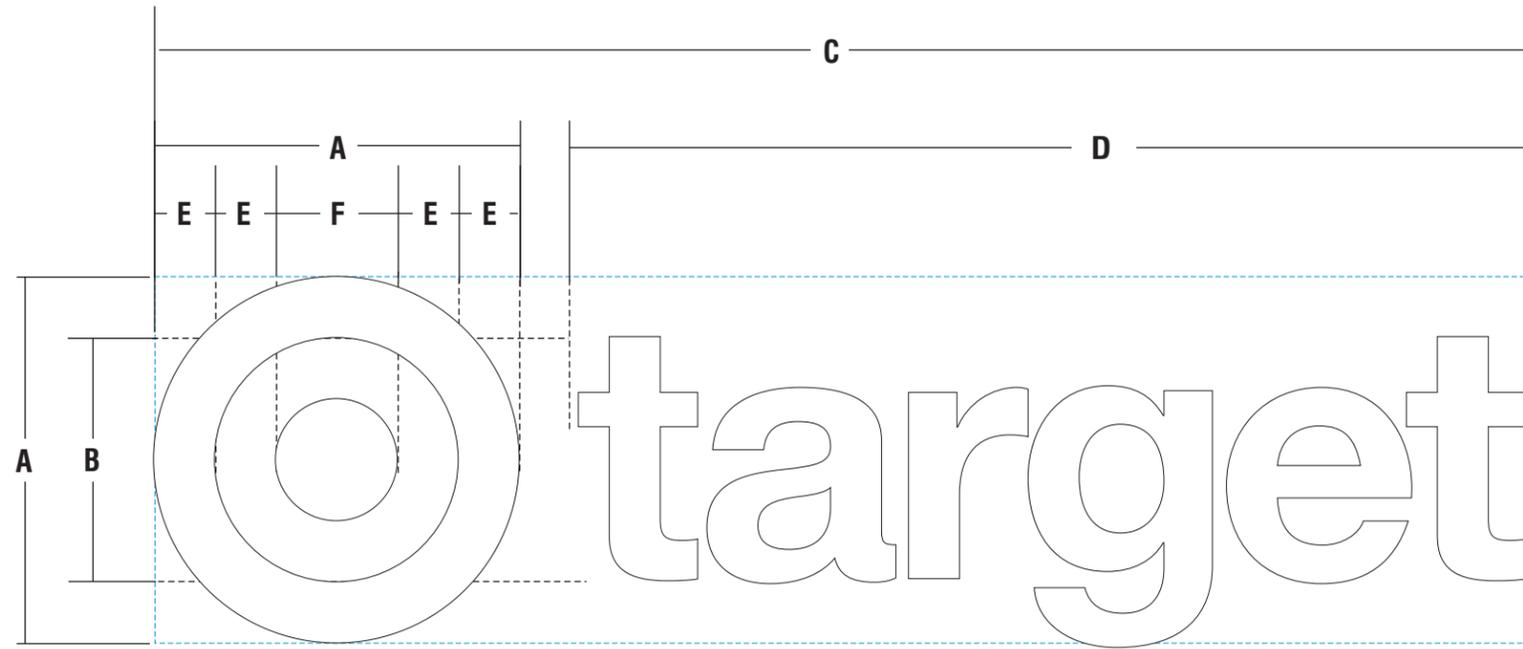


ACRYLIC FACED INT. ILLUM. "LOGO & LETTER" SET | LC-3 W

SCOPE OF WORK:
MANUFACTURE AND INSTALL CHANNEL LOGO & LETTERS

SIGN TYPE	A	B	C	D	E	F	RETAINER	AMPS CIRCUITS	SQ.FT.
LL72/48 LC-3 W	12'-0"	8'-0"	45' - 1/2"	31' - 1"	2'-0"	4'-0"	1'-1/2"		540.25

MATERIAL FINISH COLORS

RETURNS	FACES	TRIMCAP/RETAINER	ILLUMINATION
---------	-------	------------------	--------------

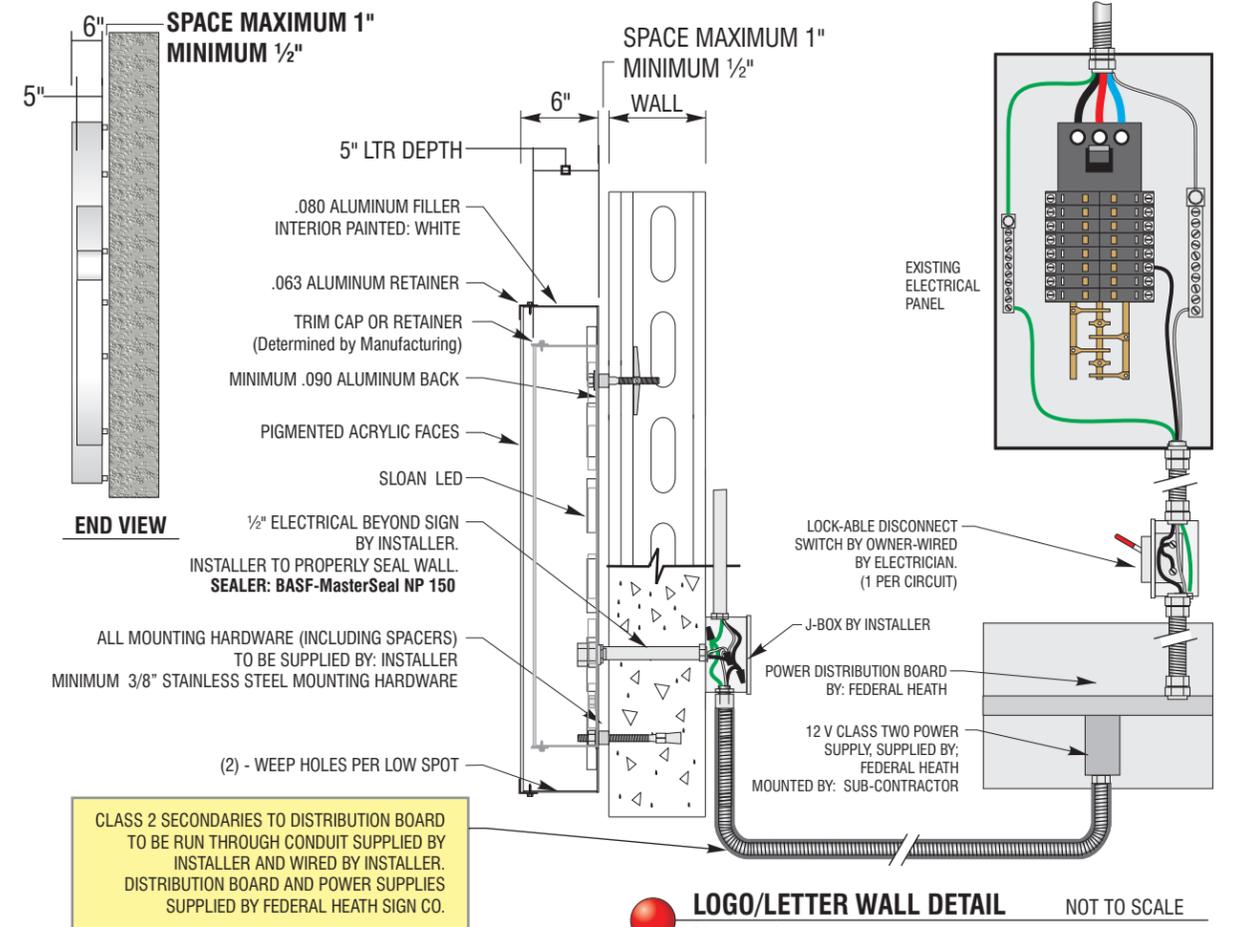

LOGO/LETTER WALL DETAIL (Generic) NOT TO SCALE

ELECTRICAL REQUIREMENTS

Total: 0.0 Amps

(1) 120V 20A Circuit Required.

ALL BRANCH CIRCUITS SHALL BE DEDICATED TO SIGNS (INCLUDING GROUND AND NEUTRAL) AND SHALL NOT BE SHARED WITH OTHER LOADS.

CUSTOMER TO PROVIDE DEDICATED BRANCH CIRCUITS FOR SIGNS ONLY PER NEC CODE 600.5

ALL BRANCH CIRCUITS SHALL BE DEDICATED TO SIGNS (INCLUDING GROUND AND NEUTRAL) AND SHALL NOT BE SHARED WITH OTHER LOADS. PROPERLY SIZED GROUND WIRE THAT CAN BE TRACED BACK TO BREAKER PANEL IS REQUIRED.

INSTALLER REQUIREMENTS

ALL MOUNTING HARDWARE, SECONDARY WIRING AND CONDUITS ARE TO BE PROVIDED BY THE INSTALLATION CONTRACTOR. ALL PENETRATIONS IN THE WALL ARE TO BE SEALED WITH SILICONE AND TO BE WATERTIGHT.

ANY DEVIATION FROM FEDERAL HEATH REQUIREMENTS MAY RESULT IN DAMAGE TO OR IMPROPER OPERATION OF SIGNAGE, CAUSING DELAYS AND ADDITIONAL COSTS.

NEW & REMODEL CONSTRUCTION


ADEQUATE BEHIND THE WALL BACKING AND ACCESS IS REQUIRED FOR THE INSTALLATION OF NEW SIGNAGE. CUSTOMER TO FORWARD APPROVED SIGNAGE DRAWINGS TO THE ON SITE CONTACT TO INSURE THAT THE REQUIRED PROVISIONS ARE MADE DURING CONSTRUCTION, PRIOR TO THE SIGN INSTALLATION.

INSTALLER REQUIREMENTS FOR EIFS WALLS

IT IS THE RESPONSIBILITY OF THE INSTALLATION CONTRACTOR TO PROVIDE ANY WALL SPACERS REQUIRED TO KEEP EIFS WALL MATERIAL FROM BEING COMPACTED DURING INSTALLATION OF ANY MOUNTING BOLTS REQUIRED FOR SIGNAGE.

GENERAL NOTE

- INSTALLER SHALL VERIFY WALL CONDITION IN THE FIELD.
- TYPE, SIZE AND NUMBER OF FASTENERS TO BE DETERMINED.
- ALL BOLT HOLES TO BE DRILLED OR PUNCHED.
- ISOLATE ALL ALUMINUM FROM STEEL.

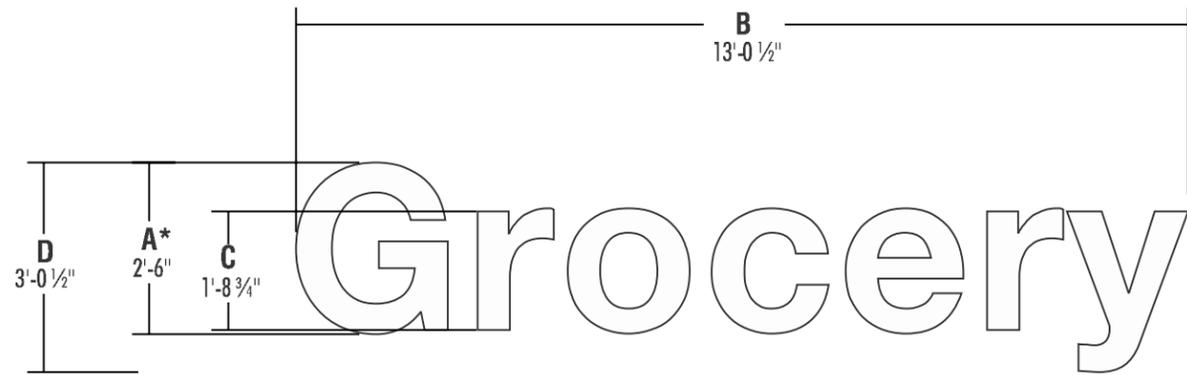

ACRYLIC FACED INTERNALLY ILLUMINATED CHANNEL LETTERS

scale 3/8"=1'-0"


MANUFACTURE AND INSTALL CHANNEL LETTERS AS SHOWN AND NOTED

SIGN TYPE	A*	B	C	D	SQ.FT.	QTY
Grocery30-W	2'-6"	13'-0 1/2"	1'-8 3/4"	3'-0 1/2"	39.6	1

* = Lock-Up Letter

SIGN TYPE	A*	B	C	D	SQ.FT.	QTY
Grocery24-W	2'-0"	10'-5"	1'-4 1/2"	2'-5 1/4"	25.3	1

MATERIAL FINISH COLORS

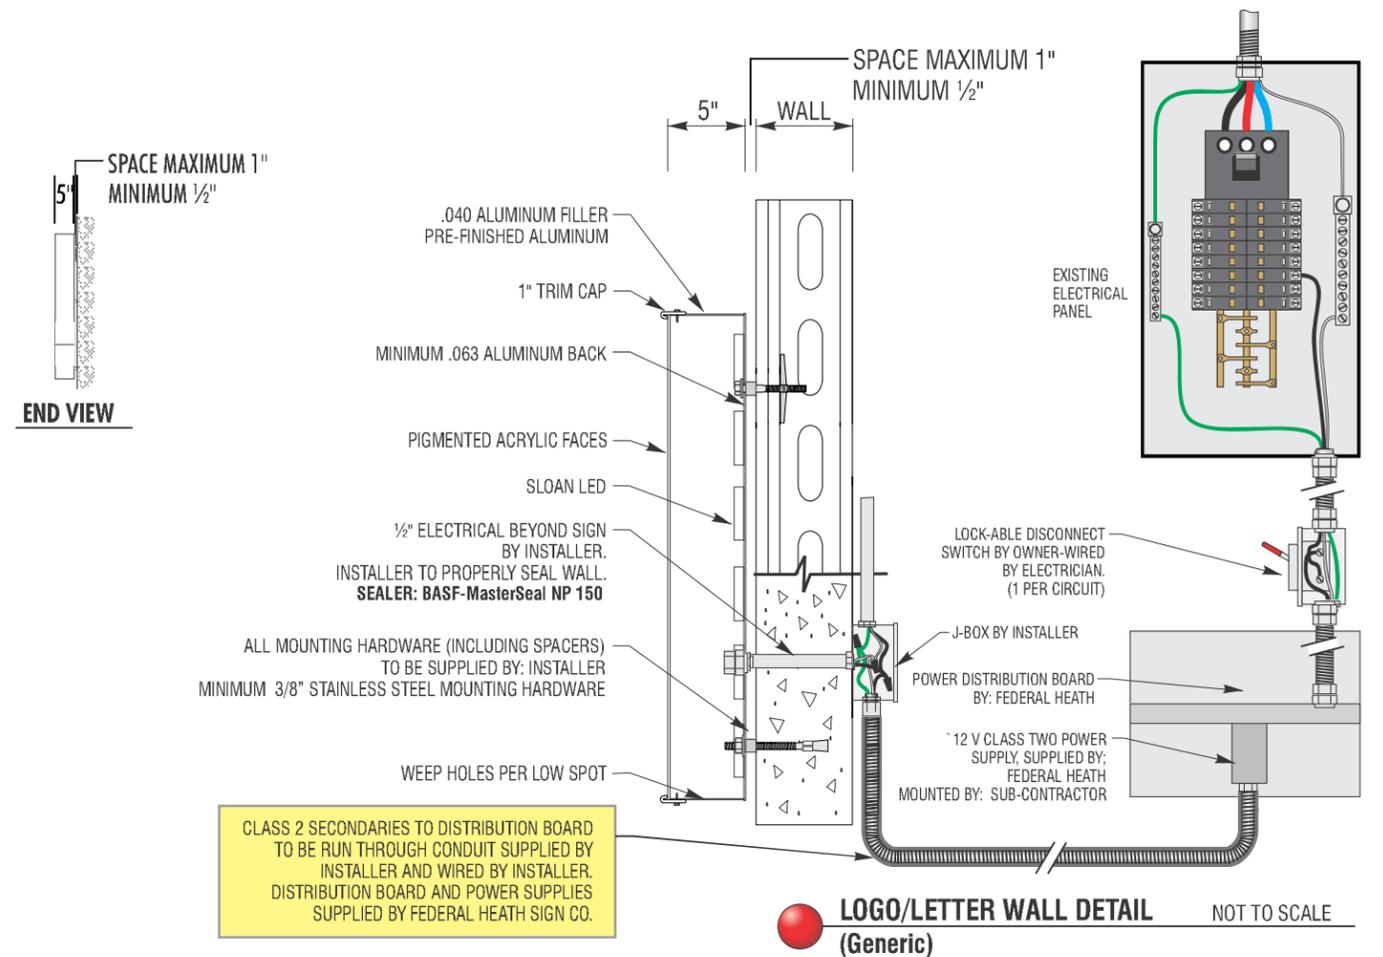

CLASS 2 SECONDARIES TO DISTRIBUTION BOARD TO BE RUN THROUGH CONDUIT SUPPLIED BY INSTALLER AND WIRED BY INSTALLER. DISTRIBUTION BOARD AND POWER SUPPLIES SUPPLIED BY FEDERAL HEATH SIGN CO.

ELECTRICAL REQUIREMENTS

Total: 0.0 Amps

(1) 120V 20A Circuit Required.

ALL BRANCH CIRCUITS SHALL BE DEDICATED TO SIGNS (INCLUDING GROUND AND NEUTRAL) AND SHALL NOT BE SHARED WITH OTHER LOADS.

CUSTOMER TO PROVIDE DEDICATED BRANCH CIRCUITS FOR SIGNS ONLY PER NEC CODE 600.5
 ALL BRANCH CIRCUITS SHALL BE DEDICATED TO SIGNS (INCLUDING GROUND AND NEUTRAL) AND SHALL NOT BE SHARED WITH OTHER LOADS. PROPERLY SIZED GROUND WIRE THAT CAN BE TRACED BACK TO BREAKER PANEL IS REQUIRED.



INSTALLER REQUIREMENTS
 ALL MOUNTING HARDWARE, SECONDARY WIRING AND CONDUITS ARE TO BE PROVIDED BY THE INSTALLATION CONTRACTOR. ALL PENETRATIONS IN THE WALL ARE TO BE SEALED WITH SILICONE AND TO BE WATERTIGHT.

ANY DEVIATION FROM FEDERAL HEATH REQUIREMENTS MAY RESULT IN DAMAGE TO OR IMPROPER OPERATION OF SIGNAGE, CAUSING DELAYS AND ADDITIONAL COSTS.

NEW & REMODEL CONSTRUCTION
 ADEQUATE BEHIND THE WALL BACKING AND ACCESS IS REQUIRED FOR THE INSTALLATION OF NEW SIGNAGE. CUSTOMER TO FORWARD APPROVED SIGNAGE DRAWINGS TO THE ON SITE CONTACT TO INSURE THAT THE REQUIRED PROVISIONS ARE MADE DURING CONSTRUCTION, PRIOR TO THE SIGN INSTALLATION.

INSTALLER REQUIREMENTS FOR EIFS WALLS
 IT IS THE RESPONSIBILITY OF THE INSTALLATION CONTRACTOR TO PROVIDE ANY WALL SPACERS REQUIRED TO KEEP EIFS WALL MATERIAL FROM BEING COMPACTED DURING INSTALLATION OF ANY MOUNTING BOLTS REQUIRED FOR SIGNAGE.

GENERAL NOTE
 • INSTALLER SHALL VERIFY WALL CONDITION IN THE FIELD.
 • TYPE, SIZE AND NUMBER OF FASTENERS TO BE DETERMINED.
 • ALL BOLT HOLES TO BE DRILLED OR PUNCHED.
 • ISOLATE ALL ALUMINUM FROM STEEL.

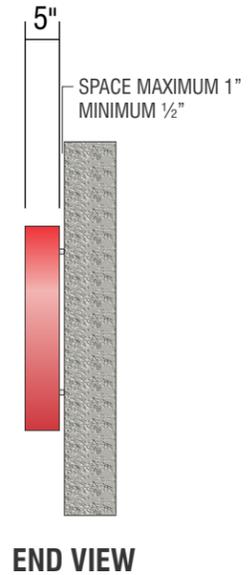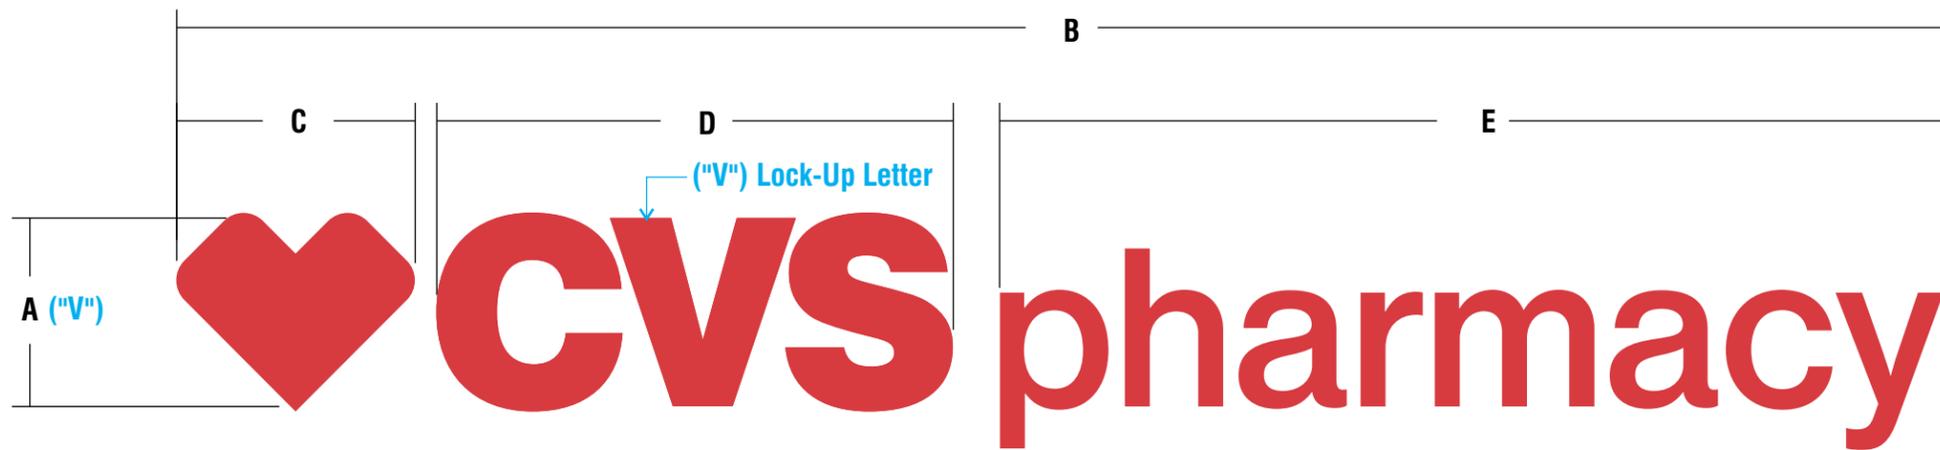

ACRYLIC FACED INTERNALLY ILLUMINATED CHANNEL LETTERS

MANUFACTURE AND INSTALL CHANNEL LOGO & LETTERS AS SHOWN AND NOTED

↓ DESIGNATES HEIGHT OF LOGO (Heart)
CVS-12-CL

SIGN TYPE	A	B	C	D	E	AMPS CIRCUITS	SQ.FT.
CVS-12-CL	11 5/8"	9'-1 1/4"	1' 2 3/4"	2'-8"	4' -10 1/2"		9.48
CVS-16-CL	12 1/2"	12'-2 1/4"	1'-7 3/4"	3'- 6 3/4"	6'-6 1/4"		16.63
CVS-18-CL	17 1/2"	13'-9"	1'-10 1/4"	4'- 0 1/4"	7'-4"		20.62
CVS-20-CL	19 1/2"	15'-3"	2'-0 3/4"	4'- 5 1/2"	8'-1 3/4"		25.41
CVS-24-CL	23 3/8"	18'-3 3/4"	2'-5 3/4"	5'-4 1/4"	9'-9 1/4"		36.62
CVS-30-CL	29 1/8"	22'-10 "	3'-1"	6'-8"	12'-2 1/4"		57.08
CVS-32-CL	31 1/8"	24'-4 3/4"	3'-3 1/2"	7'-1 1/2"	13'-0 1/4"		65.05
CVS-36-CL	34 7/8"	27'-4 3/4"	3'-8 1/4"	8'-0"	14'-7 1/2"		82.18

MATERIAL FINISH COLORS

 Returns	MP# 82074LVG (FULL GLOSS)	 Faces	2793 LD Red Modified Acrylic (Altuglas or Equiv.)	 Trimcap/Retainer	Red	 Illumination	Stoan Red LED
---	------------------------------	---	---	--	-----	--	------------------